

TABLE 2

**GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

Effluent Water Quality Results

Date Sampled ^{2/}	pH ^{1/}	TDS (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	cis-1,2-DCE (ug/l)	trans-1,2-DCE (ug/l)	Xylene (ug/l)	Toluene (ug/l)	Ethylbenzene (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Naphthalene (ug/l)	Chloroform (ug/l)	Total Iron (mg/l)	Dissolved Iron (mg/l)
SPDES Limits	5.0 to 8.5	---	5	5	5	5	5	5	5	5	5	5	5	---	10	7	---	---
1-Jul-13	7.2	117	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	1.99	0.100
9-Jul-13	7.0	118	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	33.0	0.044
16-Jul-13	7.0	122	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	0.49 J	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	2.23	0.061
25-Jul-13	7.5	125	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	42.80	ND<0.02
29-Jul-13	7.3	93	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5	7.36	0.130

SPDES: State Pollutant Discharge Elimination System

mg/l: Milligrams per liter
ug/l: Micrograms per liter

---: Not established

J: Analyte detected below quantitation limits, value shown is a laboratory estimate.

B: Analyte was found in the associated analysis batch blank. For volatiles, methylene chloride and acetone are common lab contaminants.

ND: Not detected

NM: Not Measured

TDS: Total dissolved solids

PCE: Tetrachloroethylene

1,1,1-TCA: 1,1,1-Trichloroethane

TCE: Trichloroethene

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

cis-1,2-DCE: cis-1,2-Dichloroethene

trans-1,2,-DCE: trans-1,2-Dichloroethene


Notes:

1. Based on the SPDES criteria from an NYSDEC letter dated on October 21, 2011, the new allowable pH range for the Rowe Site is between 5.0 and 8.5.


2. "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted.

**GRAPH 1
GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**Effluent Flow Data
(July 1, 2013 to July 31, 2013)**

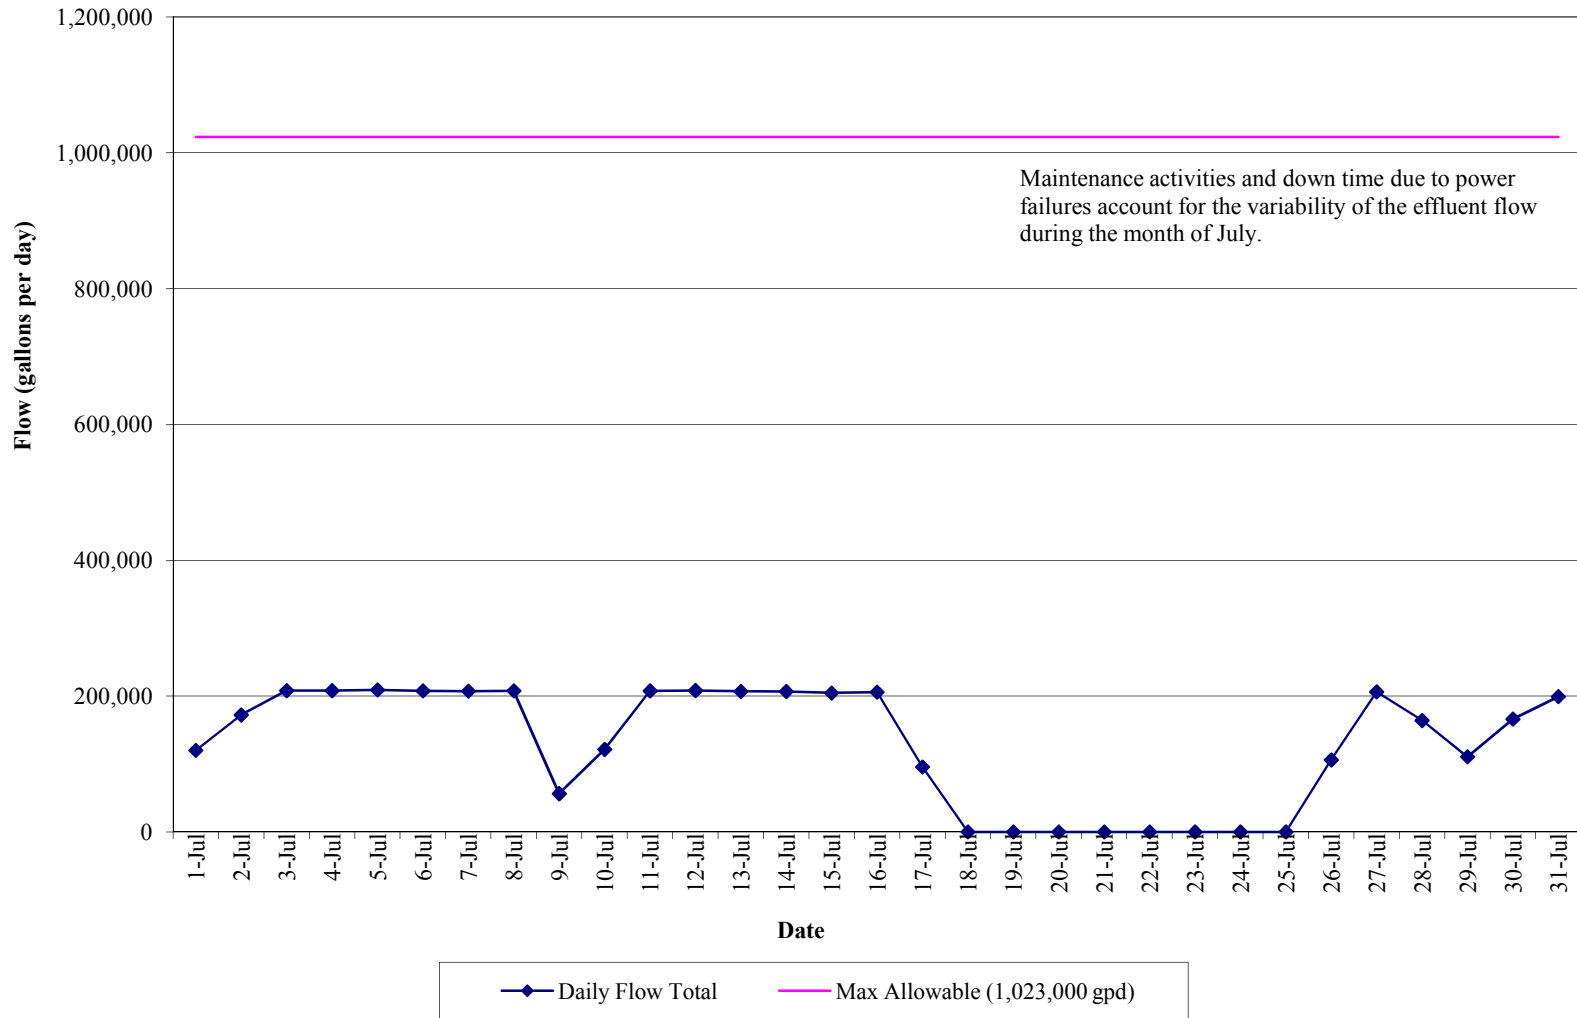

APPENDIX I
JULY 2013 LABORATORY ANALYTICAL REPORTS
FOR FSP&T SYSTEM



Technical Report

prepared for:

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301

Shelton CT, 06484

Attention: Tunde Komuves-Sandor

Report Date: 07/08/2013

Client Project ID: Rowe Industries

York Project (SDG) No.: 13G0088

CT Cert. No. PH-0723

New Jersey Cert. No. CT-005



New York Cert. No. 10854

PA Cert. No. 68-04440

Report Date: 07/08/2013
Client Project ID: Rowe Industries
York Project (SDG) No.: 13G0088

Leggette Brashears & Graham Shelton Office
4 Research Drive, Suite 301
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on July 02, 2013 and listed below. The project was identified as your project: **Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Notes section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the attachment to this report, and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
13G0088-01	WQ070113:1100NP2-6	Water	07/01/2013	07/02/2013
13G0088-02	WQ070113:1105NP2-7	Water	07/01/2013	07/02/2013
13G0089-01	WQ070113:1110NP2-10	Water	07/01/2013	07/02/2013

General Notes for York Project (SDG) No.: 13G0088

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All samples were received in proper condition for analysis with proper documentation, unless otherwise noted.
6. All analyses conducted met method or Laboratory SOP requirements. See the Qualifiers and/or Narrative sections for further information.
7. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
8. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 07/08/2013

YORK



Sample Information

Client Sample ID: WQ070113:1100NP2-6

York Sample ID: 13G0088-01

York Project (SDG) No.
13G0088

Client Project ID
Rowe Industries

Matrix
Water

Collection Date/Time
July 1, 2013 11:00 am

Date Received
07/02/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
71-55-6	1,1,1-Trichloroethane	0.64		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK



Sample Information

Client Sample ID: WQ070113:1100NP2-6

York Sample ID: 13G0088-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0088

Rowe Industries

Water

July 1, 2013 11:00 am

07/02/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
156-59-2	cis-1,2-Dichloroethylene	0.77		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
127-18-4	Tetrachloroethylene	13		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
79-01-6	Trichloroethylene	0.76		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 12:34	BK



Sample Information

Client Sample ID: WQ070113:1100NP2-6

York Sample ID: 13G0088-01

Table with 5 columns: York Project (SDG) No., Client Project ID, Matrix, Collection Date/Time, Date Received. Values: 13G0088, Rowe Industries, Water, July 1, 2013 11:00 am, 07/02/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

Table with 12 columns: CAS No., Parameter, Result, Flag, Units, MDL, RL, Dilution, Reference Method, Date/Time Prepared, Date/Time Analyzed, Analyst. Includes Surrogate Recoveries table with columns Result and Acceptance Range.

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

Table with 12 columns: CAS No., Parameter, Result, Flag, Units, MDL, RL, Dilution, Reference Method, Date/Time Prepared, Date/Time Analyzed, Analyst. Value: Iron, ND, mg/L.

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

Table with 12 columns: CAS No., Parameter, Result, Flag, Units, MDL, RL, Dilution, Reference Method, Date/Time Prepared, Date/Time Analyzed, Analyst. Value: Iron, 1.91, mg/L.

Sample Information

Client Sample ID: WQ070113:1105NP2-7

York Sample ID: 13G0088-02

Table with 5 columns: York Project (SDG) No., Client Project ID, Matrix, Collection Date/Time, Date Received. Values: 13G0088, Rowe Industries, Water, July 1, 2013 11:05 am, 07/02/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

Table with 12 columns: CAS No., Parameter, Result, Flag, Units, MDL, RL, Dilution, Reference Method, Date/Time Prepared, Date/Time Analyzed, Analyst. Lists various volatile organics and their results.



Sample Information

Client Sample ID: WQ070113:1105NP2-7

York Sample ID: 13G0088-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0088

Rowe Industries

Water

July 1, 2013 11:05 am

07/02/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK



Sample Information

Client Sample ID: WQ070113:1105NP2-7

York Sample ID: 13G0088-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0088

Rowe Industries

Water

July 1, 2013 11:05 am

07/02/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
127-18-4	Tetrachloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:16	BK
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	112 %	72.6-129								
460-00-4	Surrogate: p-Bromofluorobenzene	117 %	63.5-145								
2037-26-5	Surrogate: Toluene-d8	100 %	81.2-127								

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	0.0953		mg/L	0.0100	0.0200	1	EPA SW846-6010B	07/05/2013 16:51	07/05/2013 19:33	MW



Sample Information

Client Sample ID: WQ070113:1105NP2-7

York Sample ID: 13G0088-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0088

Rowe Industries

Water

July 1, 2013 11:05 am

07/02/2013

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	1.05		mg/L	0.0100	0.0200	1	EPA 200.7	07/05/2013 16:56	07/05/2013 20:52	MW

Sample Information

Client Sample ID: WQ070113:1110NP2-10

York Sample ID: 13G0089-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0089

Rowe Industries

Water

July 1, 2013 11:10 am

07/02/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK



Sample Information

Client Sample ID: WQ070113:1110NP2-10

York Sample ID: 13G0089-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0089

Rowe Industries

Water

July 1, 2013 11:10 am

07/02/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK



Sample Information

Client Sample ID: WQ070113:1110NP2-10

York Sample ID: 13G0089-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0089

Rowe Industries

Water

July 1, 2013 11:10 am

07/02/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
127-18-4	Tetrachloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/03/2013 09:10	07/03/2013 13:56	BK
Surrogate Recoveries		Result			Acceptance Range						
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	105 %			72.6-129						
460-00-4	Surrogate: p-Bromofluorobenzene	119 %			63.5-145						
2037-26-5	Surrogate: Toluene-d8	106 %			81.2-127						

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	0.100		mg/L	0.0100	0.0200	1	EPA SW846-6010B	07/05/2013 16:51	07/05/2013 19:38	MW

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	1.99		mg/L	0.0100	0.0200	1	EPA 200.7	07/05/2013 16:56	07/05/2013 20:57	MW

Total Dissolved Solids

Log-in Notes:

Sample Notes:

Sample Prepared by Method: % Solids Prep

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Total Dissolved Solids	117		mg/L	1.00	1.00	1	SM 2540C	07/05/2013 15:24	07/06/2013 08:54	ALD



Analytical Batch Summary

Batch ID: BG30195

Preparation Method: EPA 5030B

Prepared By: KH

YORK Sample ID	Client Sample ID	Preparation Date
13G0088-01	WQ070113:1100NP2-6	07/03/13
13G0088-02	WQ070113:1105NP2-7	07/03/13
13G0089-01	WQ070113:1110NP2-10	07/03/13
BG30195-BLK1	Blank	07/03/13
BG30195-BS1	LCS	07/03/13
BG30195-BSD1	LCS Dup	07/03/13

Batch ID: BG30324

Preparation Method: % Solids Prep

Prepared By: ALD

YORK Sample ID	Client Sample ID	Preparation Date
13G0089-01	WQ070113:1110NP2-10	07/05/13
BG30324-BLK1	Blank	07/05/13
BG30324-DUP1	Duplicate	07/05/13

Batch ID: BG30326

Preparation Method: EPA 3010A

Prepared By: MW

YORK Sample ID	Client Sample ID	Preparation Date
13G0088-01	WQ070113:1100NP2-6	07/05/13
13G0088-02	WQ070113:1105NP2-7	07/05/13
13G0089-01	WQ070113:1110NP2-10	07/05/13
BG30326-BLK1	Blank	07/05/13
BG30326-DUP1	Duplicate	07/05/13
BG30326-MS1	Matrix Spike	07/05/13
BG30326-SRM1	Reference	07/05/13

Batch ID: BG30327

Preparation Method: EPA 3010A

Prepared By: MW

YORK Sample ID	Client Sample ID	Preparation Date
13G0088-01	WQ070113:1100NP2-6	07/05/13
13G0088-02	WQ070113:1105NP2-7	07/05/13
13G0089-01	WQ070113:1110NP2-10	07/05/13
BG30327-BLK1	Blank	07/05/13
BG30327-DUP1	Duplicate	07/05/13
BG30327-MS1	Matrix Spike	07/05/13
BG30327-SRM1	Reference	07/05/13



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG30195 - EPA 5030B

Blank (BG30195-BLK1)

Prepared & Analyzed: 07/03/2013

1,1,1,2-Tetrachloroethane	ND	0.50	ug/L								
1,1,1-Trichloroethane	ND	0.50	"								
1,1,2,2-Tetrachloroethane	ND	0.50	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.50	"								
1,1,2-Trichloroethane	ND	0.50	"								
1,1-Dichloroethane	ND	0.50	"								
1,1-Dichloroethylene	ND	0.50	"								
1,1-Dichloropropylene	ND	0.50	"								
1,2,3-Trichlorobenzene	ND	2.0	"								
1,2,3-Trichloropropane	ND	0.50	"								
1,2,4-Trichlorobenzene	ND	2.0	"								
1,2,4-Trimethylbenzene	ND	0.50	"								
1,2-Dibromo-3-chloropropane	ND	2.0	"								
1,2-Dibromoethane	ND	0.50	"								
1,2-Dichlorobenzene	ND	0.50	"								
1,2-Dichloroethane	ND	0.50	"								
1,2-Dichloropropane	ND	0.50	"								
1,3,5-Trimethylbenzene	ND	0.50	"								
1,3-Dichlorobenzene	ND	0.50	"								
1,3-Dichloropropane	ND	0.50	"								
1,4-Dichlorobenzene	ND	0.50	"								
2,2-Dichloropropane	ND	0.50	"								
2-Chlorotoluene	ND	0.50	"								
2-Hexanone	0.21	0.50	"								
4-Chlorotoluene	ND	0.50	"								
Acetone	ND	2.0	"								
Benzene	ND	0.50	"								
Bromobenzene	ND	0.50	"								
Bromochloromethane	ND	0.50	"								
Bromodichloromethane	ND	0.50	"								
Bromoform	ND	0.50	"								
Bromomethane	ND	0.50	"								
Carbon tetrachloride	ND	0.50	"								
Chlorobenzene	ND	0.50	"								
Chloroethane	ND	0.50	"								
Chloroform	ND	0.50	"								
Chloromethane	ND	0.50	"								
cis-1,2-Dichloroethylene	ND	0.50	"								
cis-1,3-Dichloropropylene	ND	0.50	"								
Dibromochloromethane	ND	0.50	"								
Dibromomethane	ND	0.50	"								
Dichlorodifluoromethane	ND	0.50	"								
Ethyl Benzene	ND	0.50	"								
Hexachlorobutadiene	ND	0.50	"								
Isopropylbenzene	ND	0.50	"								
Methyl tert-butyl ether (MTBE)	ND	0.50	"								
Methylene chloride	ND	2.0	"								
Naphthalene	ND	2.0	"								
n-Butylbenzene	ND	0.50	"								
n-Propylbenzene	ND	0.50	"								
o-Xylene	ND	0.50	"								



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG30195 - EPA 5030B

Blank (BG30195-BLK1)

Prepared & Analyzed: 07/03/2013

p- & m- Xylenes	ND	1.0	ug/L								
p-Isopropyltoluene	ND	0.50	"								
sec-Butylbenzene	ND	0.50	"								
Styrene	ND	0.50	"								
tert-Butylbenzene	ND	0.50	"								
Tetrachloroethylene	ND	0.50	"								
Toluene	ND	0.50	"								
trans-1,2-Dichloroethylene	ND	0.50	"								
trans-1,3-Dichloropropylene	ND	0.50	"								
Trichloroethylene	ND	0.50	"								
Trichlorofluoromethane	ND	0.50	"								
Vinyl Chloride	ND	0.50	"								
Xylenes, Total	ND	1.5	"								

Surrogate: 1,2-Dichloroethane-d4

10.0 " 10.0 100 72.6-129

Surrogate: p-Bromofluorobenzene

11.8 " 10.0 118 63.5-145

Surrogate: Toluene-d8

9.97 " 10.0 99.7 81.2-127

LCS (BG30195-BS1)

Prepared & Analyzed: 07/03/2013

1,1,1,2-Tetrachloroethane	10.4		ug/L	10.0		104	82.3-130				
1,1,1-Trichloroethane	10.4		"	10.0		104	75.6-137				
1,1,2,2-Tetrachloroethane	9.96		"	10.0		99.6	71.3-131				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.5		"	10.0		105	71.1-129				
1,1,2-Trichloroethane	9.24		"	10.0		92.4	74.5-129				
1,1-Dichloroethane	9.90		"	10.0		99.0	79.6-132				
1,1-Dichloroethylene	9.56		"	10.0		95.6	80.2-146				
1,1-Dichloropropylene	10.2		"	10.0		102	75-136				
1,2,3-Trichlorobenzene	9.36		"	10.0		93.6	66.1-136				
1,2,3-Trichloropropane	10.4		"	10.0		104	63-131				
1,2,4-Trichlorobenzene	10.0		"	10.0		100	70.6-136				
1,2,4-Trimethylbenzene	8.72		"	10.0		87.2	75.3-135				
1,2-Dibromo-3-chloropropane	11.1		"	10.0		111	58.9-140				
1,2-Dibromoethane	9.80		"	10.0		98.0	79-130				
1,2-Dichlorobenzene	10.3		"	10.0		103	76.1-122				
1,2-Dichloroethane	9.77		"	10.0		97.7	74.6-132				
1,2-Dichloropropane	10.4		"	10.0		104	76.9-129				
1,3,5-Trimethylbenzene	9.67		"	10.0		96.7	70.6-127				
1,3-Dichlorobenzene	9.96		"	10.0		99.6	77-124				
1,3-Dichloropropane	10.0		"	10.0		100	75.8-126				
1,4-Dichlorobenzene	10.0		"	10.0		100	76.6-125				
2,2-Dichloropropane	11.7		"	10.0		117	69-133				
2-Chlorotoluene	10.0		"	10.0		100	66.3-119				
2-Hexanone	10.2		"	10.0		102	70-130				
4-Chlorotoluene	9.00		"	10.0		90.0	69.2-127				
Acetone	8.58		"	10.0		85.8	70-130				
Benzene	9.97		"	10.0		99.7	76.2-129				
Bromobenzene	9.84		"	10.0		98.4	71.3-123				
Bromochloromethane	9.92		"	10.0		99.2	70.8-137				
Bromodichloromethane	10.7		"	10.0		107	79.7-134				
Bromoform	9.66		"	10.0		96.6	70.5-141				
Bromomethane	8.92		"	10.0		89.2	43.9-147				
Carbon tetrachloride	10.8		"	10.0		108	78.1-138				
Chlorobenzene	10.2		"	10.0		102	80.4-125				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike Level	Source*	%REC	%REC Limits	Flag	RPD	RPD	Flag
		Limit			Result					Limit	

Batch BG30195 - EPA 5030B

LCS (BG30195-BS1)

Prepared & Analyzed: 07/03/2013

Chloroethane	9.53		ug/L	10.0		95.3	55.8-140				
Chloroform	10.0		"	10.0		100	76.6-133				
Chloromethane	8.50		"	10.0		85.0	48.8-115				
cis-1,2-Dichloroethylene	9.79		"	10.0		97.9	75.1-128				
cis-1,3-Dichloropropylene	11.5		"	10.0		115	74.5-128				
Dibromochloromethane	9.94		"	10.0		99.4	79.8-134				
Dibromomethane	10.4		"	10.0		104	79-130				
Dichlorodifluoromethane	5.31		"	10.0		53.1	47.1-101				
Ethyl Benzene	11.4		"	10.0		114	80.8-128				
Hexachlorobutadiene	10.9		"	10.0		109	64.8-128				
Isopropylbenzene	10.8		"	10.0		108	75.5-135				
Methyl tert-butyl ether (MTBE)	9.59		"	10.0		95.9	65.1-140				
Methylene chloride	8.79		"	10.0		87.9	61.3-120				
Naphthalene	10.2		"	10.0		102	62.3-148				
n-Butylbenzene	11.7		"	10.0		117	67.2-123				
n-Propylbenzene	10.9		"	10.0		109	70.5-127				
o-Xylene	10.1		"	10.0		101	75.9-122				
p- & m- Xylenes	21.7		"	20.0		108	77.7-127				
p-Isopropyltoluene	11.0		"	10.0		110	75.6-129				
sec-Butylbenzene	11.0		"	10.0		110	71.5-125				
Styrene	0.350		"	10.0		3.50	77.8-123	Low Bias			
tert-Butylbenzene	11.4		"	10.0		114	75.9-151				
Tetrachloroethylene	11.2		"	10.0		112	63.6-167				
Toluene	10.6		"	10.0		106	77-123				
trans-1,2-Dichloroethylene	9.91		"	10.0		99.1	76.3-139				
trans-1,3-Dichloropropylene	10.5		"	10.0		105	72.5-137				
Trichloroethylene	11.4		"	10.0		114	77.9-130				
Trichlorofluoromethane	10.0		"	10.0		100	57.4-133				
Vinyl Chloride	8.46		"	10.0		84.6	54.9-124				
Surrogate: 1,2-Dichloroethane-d4	9.70		"	10.0		97.0	72.6-129				
Surrogate: p-Bromofluorobenzene	9.77		"	10.0		97.7	63.5-145				
Surrogate: Toluene-d8	10.2		"	10.0		102	81.2-127				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG30195 - EPA 5030B											
LCS Dup (BG30195-BSD1)											
										Prepared & Analyzed: 07/03/2013	
1,1,1,2-Tetrachloroethane	10.4		ug/L	10.0		104	82.3-130		0.385	21.1	
1,1,1-Trichloroethane	10.8		"	10.0		108	75.6-137		4.15	19.7	
1,1,2,2-Tetrachloroethane	10.5		"	10.0		105	71.3-131		5.09	20.8	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.3		"	10.0		103	71.1-129		2.21	21.7	
1,1,2-Trichloroethane	9.74		"	10.0		97.4	74.5-129		5.27	20.3	
1,1-Dichloroethane	10.6		"	10.0		106	79.6-132		6.55	20.6	
1,1-Dichloroethylene	9.42		"	10.0		94.2	80.2-146		1.48	20	
1,1-Dichloropropylene	10.4		"	10.0		104	75-136		2.72	19.3	
1,2,3-Trichlorobenzene	10.3		"	10.0		103	66.1-136		9.56	21.6	
1,2,3-Trichloropropane	10.7		"	10.0		107	63-131		3.42	23.9	
1,2,4-Trichlorobenzene	10.6		"	10.0		106	70.6-136		5.81	21.7	
1,2,4-Trimethylbenzene	9.09		"	10.0		90.9	75.3-135		4.15	18.8	
1,2-Dibromo-3-chloropropane	12.0		"	10.0		120	58.9-140		7.27	27.7	
1,2-Dibromoethane	10.5		"	10.0		105	79-130		6.80	23	
1,2-Dichlorobenzene	10.5		"	10.0		105	76.1-122		1.74	19.8	
1,2-Dichloroethane	10.6		"	10.0		106	74.6-132		8.43	20.2	
1,2-Dichloropropane	10.4		"	10.0		104	76.9-129		0.481	20.7	
1,3,5-Trimethylbenzene	9.41		"	10.0		94.1	70.6-127		2.73	18.9	
1,3-Dichlorobenzene	9.70		"	10.0		97.0	77-124		2.64	19.2	
1,3-Dichloropropane	10.2		"	10.0		102	75.8-126		1.58	22.1	
1,4-Dichlorobenzene	9.95		"	10.0		99.5	76.6-125		0.601	18.6	
2,2-Dichloropropane	11.4		"	10.0		114	69-133		2.25	19.8	
2-Chlorotoluene	9.73		"	10.0		97.3	66.3-119		3.24	21.6	
2-Hexanone	10.5		"	10.0		105	70-130		2.90	30	
4-Chlorotoluene	8.92		"	10.0		89.2	69.2-127		0.893	19	
Acetone	9.29		"	10.0		92.9	70-130		7.95	30	
Benzene	10.6		"	10.0		106	76.2-129		5.94	19	
Bromobenzene	10.2		"	10.0		102	71.3-123		3.20	20.3	
Bromochloromethane	11.3		"	10.0		113	70.8-137		12.7	23.9	
Bromodichloromethane	10.5		"	10.0		105	79.7-134		1.88	21	
Bromoform	10.5		"	10.0		105	70.5-141		7.95	21.8	
Bromomethane	9.53		"	10.0		95.3	43.9-147		6.61	28.4	
Carbon tetrachloride	11.1		"	10.0		111	78.1-138		2.92	20.1	
Chlorobenzene	9.83		"	10.0		98.3	80.4-125		4.09	19.9	
Chloroethane	9.73		"	10.0		97.3	55.8-140		2.08	23.3	
Chloroform	10.8		"	10.0		108	76.6-133		6.83	20.3	
Chloromethane	8.12		"	10.0		81.2	48.8-115		4.57	24.5	
cis-1,2-Dichloroethylene	10.3		"	10.0		103	75.1-128		5.08	20.5	
cis-1,3-Dichloropropylene	11.2		"	10.0		112	74.5-128		2.73	19.9	
Dibromochloromethane	10.4		"	10.0		104	79.8-134		4.14	21.3	
Dibromomethane	10.6		"	10.0		106	79-130		2.38	22.4	
Dichlorodifluoromethane	5.02		"	10.0		50.2	47.1-101		5.61	23.9	
Ethyl Benzene	10.7		"	10.0		107	80.8-128		6.31	19.2	
Hexachlorobutadiene	10.7		"	10.0		107	64.8-128		2.03	20.6	
Isopropylbenzene	10.3		"	10.0		103	75.5-135		4.17	20	
Methyl tert-butyl ether (MTBE)	10.8		"	10.0		108	65.1-140		12.2	23.6	
Methylene chloride	9.77		"	10.0		97.7	61.3-120		10.6	20.4	
Naphthalene	11.4		"	10.0		114	62.3-148		10.8	27.1	
n-Butylbenzene	10.9		"	10.0		109	67.2-123		7.42	19.1	
n-Propylbenzene	10.3		"	10.0		103	70.5-127		5.56	23.4	
o-Xylene	9.69		"	10.0		96.9	75.9-122		4.24	19.3	



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG30195 - EPA 5030B

LCS Dup (BG30195-BSD1)


Prepared & Analyzed: 07/03/2013

p- & m- Xylenes	20.9		ug/L	20.0		104	77.7-127		3.85	18.6	
p-Isopropyltoluene	10.6		"	10.0		106	75.6-129		4.18	19.1	
sec-Butylbenzene	10.7		"	10.0		107	71.5-125		3.05	18.9	
Styrene	0.370		"	10.0		3.70	77.8-123	Low Bias	5.56	20.9	
tert-Butylbenzene	11.2		"	10.0		112	75.9-151		2.13	20.9	
Tetrachloroethylene	10.3		"	10.0		103	63.6-167		8.84	27.7	
Toluene	10.0		"	10.0		100	77-123		5.14	18.7	
trans-1,2-Dichloroethylene	10.2		"	10.0		102	76.3-139		3.37	19.5	
trans-1,3-Dichloropropylene	10.6		"	10.0		106	72.5-137		1.52	19.3	
Trichloroethylene	10.3		"	10.0		103	77.9-130		10.4	20.5	
Trichlorofluoromethane	9.81		"	10.0		98.1	57.4-133		2.02	21.4	
Vinyl Chloride	8.18		"	10.0		81.8	54.9-124		3.37	22.3	
<i>Surrogate: 1,2-Dichloroethane-d4</i>	<i>10.4</i>		<i>"</i>	<i>10.0</i>		<i>104</i>	<i>72.6-129</i>				
<i>Surrogate: p-Bromofluorobenzene</i>	<i>9.47</i>		<i>"</i>	<i>10.0</i>		<i>94.7</i>	<i>63.5-145</i>				
<i>Surrogate: Toluene-d8</i>	<i>9.72</i>		<i>"</i>	<i>10.0</i>		<i>97.2</i>	<i>81.2-127</i>				




Metals by EPA 6000 Series Methods - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG30326 - EPA 3010A											
Blank (BG30326-BLK1)										Prepared & Analyzed: 07/05/2013	
Iron - Dissolved	ND	0.0200	mg/L								
Duplicate (BG30326-DUP1)										*Source sample: 13G0089-01 (WQ070113:1110NP2-10) Prepared & Analyzed: 07/05/2013	
Iron - Dissolved	0.100	0.0200	mg/L		0.100				0.299	20	
Matrix Spike (BG30326-MS1)										*Source sample: 13G0089-01 (WQ070113:1110NP2-10) Prepared & Analyzed: 07/05/2013	
Iron - Dissolved	1.16	0.0200	mg/L	1.00	0.100	106	75-125				
Reference (BG30326-SRM1)										Prepared & Analyzed: 07/05/2013	
Iron - Dissolved	1.36	0.0200	mg/L	1.39		97.8	88.4-113				




Metals by EPA 200 Series Methods - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Flag	RPD	RPD	Flag	
		Limit		Level	Result	Limits	Limit					
Batch BG30327 - EPA 3010A												
Blank (BG30327-BLK1)										Prepared & Analyzed: 07/05/2013		
Iron	ND	0.0200	mg/L									
Duplicate (BG30327-DUP1)										*Source sample: 13G0089-01 (WQ070113:1110NP2-10)		Prepared & Analyzed: 07/05/2013
Iron	1.97	0.0200	mg/L		1.99				1.20	20		
Matrix Spike (BG30327-MS1)										*Source sample: 13G0089-01 (WQ070113:1110NP2-10)		Prepared & Analyzed: 07/05/2013
Iron	2.98	0.0200	mg/L	1.00	1.99	99.4	75-125					
Reference (BG30327-SRM1)										Prepared & Analyzed: 07/05/2013		
Iron	1.38	0.0200	mg/L	1.39		99.0	88.4-113					



Miscellaneous Physical/Conventional Chemistry Parameters - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG30324 - % Solids Prep											
Blank (BG30324-BLK1)										Prepared: 07/05/2013 Analyzed: 07/06/2013	
Total Dissolved Solids	ND	1.00	mg/L								
Duplicate (BG30324-DUP1)										Prepared: 07/05/2013 Analyzed: 07/06/2013	
*Source sample: 13G0089-01 (WQ070113:1110NP2-10)											
Total Dissolved Solids	117	1.00	mg/L		117				0.00	15	



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
13G0088-01	WQ070113:1100NP2-6	250mL Plastic Cool to 4° C
13G0088-02	WQ070113:1105NP2-7	250mL Plastic Cool to 4° C
13G0089-01	WQ070113:1110NP2-10	250mL Plastic Cool to 4° C

Notes and Definitions

- QL-02 This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
- M-LSRD Original sample conc <50 X reporting limit.
- J Detected below the Reporting Limit but greater than or equal to the Method Detection Limit (MDL); therefore, the result is an estimated concentration.
- B Analyte is found in the associated analysis batch blank. For volatiles, methylene chloride and acetone are common lab contaminants. Data users should consider anything <10x the blank value as artifact.

- ND Analyte NOT DETECTED at the stated Reporting Limit (RL) or above.
- RL REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
- MDL METHOD DETECTION LIMIT - the minimum concentration that can be measured and reported with a 99% confidence that the concentration is greater than zero. If requested or required, a value reported below the RL and above the MDL is considered estimated and is noted with a "J" flag.
- NR Not reported
- RPD Relative Percent Difference
- Wet The data has been reported on an as-received (wet weight) basis
- Low Bias Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- High Bias High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
- Non-Dir. Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the MDL, with values between the MDL and the RL being "J" flagged as estimated results.

YORK

ANALYTICAL LABORATORIES, INC.
120 RESEARCH DR. STRATFORD, CT 06615
(203) 325-1371 FAX (203) 357-0166

Field Chain-of-Custody Record

Page 1 of 1

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

Yorik Project No. 360080

YOUR Information

Company: LBG
Address: 4 Research Dr. Suite 301
Shelton, CT 06484
Phone No. 263-989-8555
Contact Person: Tonde Sander
E-Mail Address: TSander@lbgi.com

Report To:

Company: Same
Address: _____
Phone No. _____
Attention: _____
E-Mail Address: _____

Invoice To:

Company: Same
Address: _____
Phone No. _____
Attention: _____
E-Mail Address: _____

YOUR Project ID

Project Name: Rpwe Industries
Purchase Order No.: NAB5A6

Turn-Around Time

RUSH - Same Day
RUSH - Next Day
RUSH - Two Day
RUSH - Three Day
RUSH - Four Day
Standard (5-7 Days)

Report Type

Summary Report
Summary w/ QA Summary
CTRCP Package
CTRCP DQADUE Pkg
NY ASP A Package
NY ASP B Package
NIDEF Red. Deliv.
Electronic Data Deliverables (EDD)

Print Clearly and Legibly. All information must be completed. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.

Samples Collected/Authorized By (Signature)

STEPHEN HNAIT
Name (printed)

Volatiles

8260 Full TICs
624 Site Spec
STARS list Nassau Co.
BTX Suffolk Co.
MTBE Ketones
TCL list Oxygenates
TAGM list TCLP list
CT RCP list 524.2
Halog. only 502.2
App. IX NIDEF list
8021B list SLP/TCLP

Semi-Vols. Test/Controlled

3082 PCB
8081 Pest
8.15 Herb
CT RCP
App. IX
Site Spec.
TAGM list
CT RCP list
TCLP list
NIDEF list
App. IX
TCLP BNA
SLP/TCLP
608 Pest

Metals

RCRA8
PF19 list
TAL
CT15 list
TAGM list
NIDEF list
Air TO15A
Air TO15
Air STARS
SLP/TCLP
Air VPH
Air TICs
Methane
Hydro

Misc. Org.

TPH GRO
TPH DRO
CT ETPH
NY 310-13
TPH 1664
Air TO15A
Air TO15
Air STARS
SLP/TCLP
Air VPH
Air TICs
Methane
Hydro

Full Lists

Coarsely
TCL Ogens
TAL Meq
Full TCLP
Full App IX
Pet. 360-Residue
Pet. 360-Residue
Pet. 360-Residue
Pet. 360-Residue
NYCDEP
TAGM
Slices

Misc.

Corrosivity
Reactivity
Ignitability
Flash Point
Stev. Anal.
Heteroatoms
TOX
BTU/b.
Aromatic Tox
NYCDEP
TAGM
Slices

Choose Analyses Needed from the Menu Above and Enter Below

Sample Identification	Date Sampled	Sample Matrix	Preservation	Special Instructions	Field Filled	Lab to Filler	Comments	Temperature on Receipt
WQ070113:1100MP2-6	7/13 1100	GW	<input type="checkbox"/> 4°C <input type="checkbox"/> Frozen <input checked="" type="checkbox"/> HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> Ascorbic Acid	<input type="checkbox"/> Check those Applicable	<input type="checkbox"/> Field Filled	<input type="checkbox"/> Lab to Filler	<u>Fe by EPA 800.7 Fe, Dissolved by EPA 6010 (SW846-6010B) / VOCs, 8260 list (EPA SW846-8260B) plus Fean 113</u>	32.2°
WQ070113:1105MP2-7	7/13 1105	GW	<input type="checkbox"/> 4°C <input type="checkbox"/> Frozen <input checked="" type="checkbox"/> HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> Ascorbic Acid	<input type="checkbox"/> Check those Applicable	<input type="checkbox"/> Field Filled	<input type="checkbox"/> Lab to Filler	<u>Fe by EPA 800.7 Fe, Dissolved by EPA 6010 (SW846-6010B) / VOCs, 8260 list (EPA SW846-8260B) plus Fean 113 / TO5 (SH 2540.5)</u>	32.2°
WQ070113:1108MP2-10	7/13 1110	GW	<input type="checkbox"/> 4°C <input type="checkbox"/> Frozen <input checked="" type="checkbox"/> HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> Ascorbic Acid	<input type="checkbox"/> Check those Applicable	<input type="checkbox"/> Field Filled	<input type="checkbox"/> Lab to Filler		32.3°
			<input type="checkbox"/> 4°C <input type="checkbox"/> Frozen <input checked="" type="checkbox"/> HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> Ascorbic Acid	<input type="checkbox"/> Check those Applicable	<input type="checkbox"/> Field Filled	<input type="checkbox"/> Lab to Filler		
			<input type="checkbox"/> 4°C <input type="checkbox"/> Frozen <input checked="" type="checkbox"/> HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> Ascorbic Acid	<input type="checkbox"/> Check those Applicable	<input type="checkbox"/> Field Filled	<input type="checkbox"/> Lab to Filler		
			<input type="checkbox"/> 4°C <input type="checkbox"/> Frozen <input checked="" type="checkbox"/> HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> Ascorbic Acid	<input type="checkbox"/> Check those Applicable	<input type="checkbox"/> Field Filled	<input type="checkbox"/> Lab to Filler		
			<input type="checkbox"/> 4°C <input type="checkbox"/> Frozen <input checked="" type="checkbox"/> HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> Ascorbic Acid	<input type="checkbox"/> Check those Applicable	<input type="checkbox"/> Field Filled	<input type="checkbox"/> Lab to Filler		
			<input type="checkbox"/> 4°C <input type="checkbox"/> Frozen <input checked="" type="checkbox"/> HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> Ascorbic Acid	<input type="checkbox"/> Check those Applicable	<input type="checkbox"/> Field Filled	<input type="checkbox"/> Lab to Filler		
			<input type="checkbox"/> 4°C <input type="checkbox"/> Frozen <input checked="" type="checkbox"/> HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> Ascorbic Acid	<input type="checkbox"/> Check those Applicable	<input type="checkbox"/> Field Filled	<input type="checkbox"/> Lab to Filler		
			<input type="checkbox"/> 4°C <input type="checkbox"/> Frozen <input checked="" type="checkbox"/> HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> Ascorbic Acid	<input type="checkbox"/> Check those Applicable	<input type="checkbox"/> Field Filled	<input type="checkbox"/> Lab to Filler		

Samples Relinquished By LBG-Fudge Date/Time 7/21/13 9-
Samples Received In Lab By ES Schreck Date/Time 7/21/13 1220

Temperature on Receipt 43.0°C

Comments


Field Chain-of-Custody Record

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 1360089

YOUR Information Company: <u>LBG</u> Address: <u>4 Research Dr. Suite 301 Shelton, CT 06484</u> Phone No. <u>203-929-8555</u> Contact Person: <u>Jonde Sandoz</u> E-Mail Address: <u>TSandoz@LBGCT.com</u>		Report To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____		Invoice To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____		YOUR Project ID <u>Apex Industries.</u> Purchase Order No. <u>NAB5AG.</u> Samples from: CT ___ NY ___ X NJ ___		Turn-Around Time RUSH - Same Day <input type="checkbox"/> RUSH - Next Day <input type="checkbox"/> RUSH - Two Day <input type="checkbox"/> RUSH - Three Day <input type="checkbox"/> RUSH - Four Day <input type="checkbox"/> Standard (5-7 Days) <input checked="" type="checkbox"/>		Report Type Summary Report <input checked="" type="checkbox"/> <u>X</u> , pdf Summary w/ QA Summary <input checked="" type="checkbox"/> <u>X</u> , pdf CT RCP Package CT RCP DQADUE Pkg NY ASP A Package NY ASP B Package <u>№2-10 only</u> , pdf. NUDEP Red. Deliv. Electronic Data Deliverables (EDD)	
--	--	---	--	--	--	--	--	--	--	--	--


Please Clearly and Legibly. All Information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.

Samples Collected/Authorized By (Signature) 

Name (printed) STEPHEN HMAT

Matrix Codes	Volatiles	Semi-Volatiles	Metals	Misc. Org.	Fall Lists	Misc.
S - soil Other - specify (oil, etc.) WW - wastewater GW - groundwater DW - drinking water Air-A - ambient air Air-SV - soil vapor	8260 full 624 STARS list BTX MITBE TCL list TAGM list TCLP list Arom. only Halog. only App. IX list 8021B list	8270 or 625 STARS list BN Only Acids Only PAH list TAGM list Site Spec. SPLP or TCLP TCLP list TCLP list NUDEP list App. IX SPLP or TCLP 8021B list	RCRA 8 PP13 list TAL CT15 list TAGM list NUDEP list Total Dissolved SPLP or TCLP Ink/Metal LIST Below	TPH GLO TPH DRO CT ETPH NY 310-13 TPH 1664 Air TO14A Air TO15 Air STARS SPLP or TCLP Air TICs Methane Heptan	Per. Poll. TCL Organics TAL Full TCLP Full App. IX Per 360-Route Per 360-Route Per 360-Route Per 360-Route NYCDEP NYSDDEC TAGM	Cerrosivity Reactivity Igallability Flash Point Sieve Anal. Heterocyclics TOX BTU/b. Aquatic Tox. NYCDEP Asbestos Silken

Sample Identification	Date Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below	Container Description(s)	Temperature on Receipt
<u>WR070113-1100NP2-6</u>	<u>7/1/13 1100</u>	<u>GW</u>	<u>Fe by EPA 200.7 Fe, Dissolved by EPA 6010 (SW 846-6108) VOCs, 8260 list (EPA SW 845-8260B) plus f-con 113</u>	<u>3x 2P</u>	
<u>WR070113-1105NP2-7</u>	<u>1105</u>	<u>GW</u>		<u>3x 2P</u>	
<u>WR070113-1110NP2-10</u>	<u>1110</u>	<u>GW</u>	<u>Fe by EPA 200.7 Fe, Dissolved by EPA 6010 (SW 846-6108) VOCs, 8260 list (EPA SW 845-8260B) plus f-con 113 / TDS (9H 25-40C)</u>	<u>3x 3P</u>	
Preservation Check those Applicable Special Instructions Field Filtered <input type="checkbox"/> Lab to Filter <input type="checkbox"/>					Temperature on Receipt <u>4.3 °C</u>
Comments 4°C <u>✓</u> Frozen <u>✓</u> HCl <u>✓</u> MeOH <u>✓</u> HNO ₃ <u>✓</u> H ₂ SO ₄ <u>✓</u> NiOH _____ Other _____ Samples Relinquished By <u>J. Sandoz</u> Date/Time <u>7/2/13 9-</u> Samples Received By <u>J. Sandoz</u> Date/Time <u>7/2/13 9-</u> Samples Relinquished By <u>J. Sandoz</u> Date/Time <u>7/2/13 9-</u> Samples Received By <u>J. Sandoz</u> Date/Time <u>7/2/13 1720</u> Samples Relinquished By <u>J. Sandoz</u> Date/Time <u>7/2/13 9-</u> Samples Received By <u>J. Sandoz</u> Date/Time <u>7/2/13 1720</u>					



Technical Report

prepared for:

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301

Shelton CT, 06484

Attention: Tunde Komuves-Sandor

Report Date: 07/16/2013

Client Project ID: Rowe Industries

York Project (SDG) No.: 13G0344

CT Cert. No. PH-0723

New Jersey Cert. No. CT-005



New York Cert. No. 10854

PA Cert. No. 68-04440

Report Date: 07/16/2013
Client Project ID: Rowe Industries
York Project (SDG) No.: 13G0344

Leggette Brashears & Graham Shelton Office
4 Research Drive, Suite 301
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on July 10, 2013 and listed below. The project was identified as your project: **Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Notes section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the attachment to this report, and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
13G0344-01	WQ070913:1040NP2-6	Water	07/09/2013	07/10/2013
13G0344-02	WQ070913:1045NP2-7	Water	07/09/2013	07/10/2013
13G0347-01	WQ070913:1050NP2-10	Water	07/09/2013	07/10/2013

General Notes for York Project (SDG) No.: 13G0344

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All samples were received in proper condition for analysis with proper documentation, unless otherwise noted.
6. All analyses conducted met method or Laboratory SOP requirements. See the Qualifiers and/or Narrative sections for further information.
7. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
8. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 07/16/2013

YORK



Sample Information

Client Sample ID: WQ070913:1040NP2-6

York Sample ID: 13G0344-01

York Project (SDG) No.
13G0344

Client Project ID
Rowe Industries

Matrix
Water

Collection Date/Time
July 9, 2013 10:40 am

Date Received
07/10/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
71-55-6	1,1,1-Trichloroethane	0.61		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK



Sample Information

Client Sample ID: WQ070913:1040NP2-6

York Sample ID: 13G0344-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0344

Rowe Industries

Water

July 9, 2013 10:40 am

07/10/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
156-59-2	cis-1,2-Dichloroethylene	0.47	J	ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
127-18-4	Tetrachloroethylene	7.4		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
79-01-6	Trichloroethylene	0.50		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 20:40	BK



Sample Information

Client Sample ID: WQ070913:1040NP2-6

York Sample ID: 13G0344-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0344

Rowe Industries

Water

July 9, 2013 10:40 am

07/10/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
Surrogate Recoveries		Result			Acceptance Range						
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	95.7 %			72.6	129					
460-00-4	Surrogate: p-Bromofluorobenzene	119 %			63.5	145					
2037-26-5	Surrogate: Toluene-d8	104 %			81.2	127					

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	ND		mg/L	0.0200	0.0200	1	EPA SW846-6010B	07/15/2013 13:32	07/15/2013 16:05	MW

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	8.98		mg/L	0.0146	0.0200	1	EPA 200.7	07/15/2013 13:35	07/15/2013 17:17	MW

Sample Information

Client Sample ID: WQ070913:1045NP2-7

York Sample ID: 13G0344-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0344

Rowe Industries

Water

July 9, 2013 10:45 am

07/10/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK



Sample Information

Client Sample ID: WQ070913:1045NP2-7

York Sample ID: 13G0344-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0344

Rowe Industries

Water

July 9, 2013 10:45 am

07/10/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK



Sample Information

Client Sample ID: WQ070913:1045NP2-7

York Sample ID: 13G0344-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0344

Rowe Industries

Water

July 9, 2013 10:45 am

07/10/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
127-18-4	Tetrachloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:16	BK
Surrogate Recoveries		Result			Acceptance Range						
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	99.6 %			72.6-129						
460-00-4	Surrogate: p-Bromofluorobenzene	126 %			63.5-145						
2037-26-5	Surrogate: Toluene-d8	104 %			81.2-127						

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	ND		mg/L	0.0200	0.0200	1	EPA SW846-6010B	07/15/2013 13:32	07/15/2013 16:09	MW



Sample Information

Client Sample ID: WQ070913:1045NP2-7

York Sample ID: 13G0344-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0344

Rowe Industries

Water

July 9, 2013 10:45 am

07/10/2013

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	10.8		mg/L	0.0146	0.0200	1	EPA 200.7	07/15/2013 13:35	07/15/2013 17:22	MW

Sample Information

Client Sample ID: WQ070913:1050NP2-10

York Sample ID: 13G0347-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0347

Rowe Industries

Water

July 9, 2013 10:50 am

07/10/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK



Sample Information

Client Sample ID: WQ070913:1050NP2-10

York Sample ID: 13G0347-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0347

Rowe Industries

Water

July 9, 2013 10:50 am

07/10/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
67-64-1	Acetone	1.4	J	ug/L	1.0	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK



Sample Information

Client Sample ID: WQ070913:1050NP2-10

York Sample ID: 13G0347-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0347

Rowe Industries

Water

July 9, 2013 10:50 am

07/10/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
127-18-4	Tetrachloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/15/2013 13:30	07/15/2013 21:51	BK
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	97.0 %	72.6-129								
460-00-4	Surrogate: p-Bromofluorobenzene	121 %	63.5-145								
2037-26-5	Surrogate: Toluene-d8	105 %	81.2-127								

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	0.0437		mg/L	0.0200	0.0200	1	EPA SW846-6010B	07/15/2013 13:32	07/15/2013 16:14	MW

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	33.0		mg/L	0.0146	0.0200	1	EPA 200.7	07/15/2013 13:35	07/15/2013 17:27	MW

Total Dissolved Solids

Log-in Notes:

Sample Notes:

Sample Prepared by Method: % Solids Prep

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Total Dissolved Solids	118		mg/L	1.00	1.00	1	SM 2540C	07/15/2013 07:34	07/15/2013 08:45	ALD



Analytical Batch Summary

Batch ID: BG30598 **Preparation Method:** % Solids Prep **Prepared By:** AMC

YORK Sample ID	Client Sample ID	Preparation Date
13G0347-01	WQ070913:1050NP2-10	07/15/13
BG30598-BLK1	Blank	07/15/13
BG30598-DUP1	Duplicate	07/15/13

Batch ID: BG30659 **Preparation Method:** EPA 5030B **Prepared By:** BK

YORK Sample ID	Client Sample ID	Preparation Date
13G0344-01	WQ070913:1040NP2-6	07/15/13
13G0344-02	WQ070913:1045NP2-7	07/15/13
13G0347-01	WQ070913:1050NP2-10	07/15/13
BG30659-BLK1	Blank	07/15/13
BG30659-BS1	LCS	07/15/13
BG30659-BSD1	LCS Dup	07/15/13

Batch ID: BG30696 **Preparation Method:** EPA 3010A **Prepared By:** MW

YORK Sample ID	Client Sample ID	Preparation Date
13G0344-01	WQ070913:1040NP2-6	07/15/13
13G0344-02	WQ070913:1045NP2-7	07/15/13
13G0347-01	WQ070913:1050NP2-10	07/15/13
BG30696-BLK1	Blank	07/15/13
BG30696-DUP1	Duplicate	07/15/13
BG30696-MS1	Matrix Spike	07/15/13
BG30696-SRM1	Reference	07/15/13

Batch ID: BG30697 **Preparation Method:** EPA 3010A **Prepared By:** MW

YORK Sample ID	Client Sample ID	Preparation Date
13G0344-01	WQ070913:1040NP2-6	07/15/13
13G0344-02	WQ070913:1045NP2-7	07/15/13
13G0347-01	WQ070913:1050NP2-10	07/15/13
BG30697-BLK1	Blank	07/15/13
BG30697-DUP1	Duplicate	07/15/13
BG30697-MS1	Matrix Spike	07/15/13
BG30697-SRM1	Reference	07/15/13



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG30659 - EPA 5030B

Blank (BG30659-BLK1)

Prepared & Analyzed: 07/15/2013

1,1,1,2-Tetrachloroethane	ND	0.50	ug/L								
1,1,1-Trichloroethane	ND	0.50	"								
1,1,2,2-Tetrachloroethane	ND	0.50	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.50	"								
1,1,2-Trichloroethane	ND	0.50	"								
1,1-Dichloroethane	ND	0.50	"								
1,1-Dichloroethylene	ND	0.50	"								
1,1-Dichloropropylene	ND	0.50	"								
1,2,3-Trichlorobenzene	ND	2.0	"								
1,2,3-Trichloropropane	ND	0.50	"								
1,2,4-Trichlorobenzene	ND	2.0	"								
1,2,4-Trimethylbenzene	ND	0.50	"								
1,2-Dibromo-3-chloropropane	ND	2.0	"								
1,2-Dibromoethane	ND	0.50	"								
1,2-Dichlorobenzene	ND	0.50	"								
1,2-Dichloroethane	ND	0.50	"								
1,2-Dichloropropane	ND	0.50	"								
1,3,5-Trimethylbenzene	ND	0.50	"								
1,3-Dichlorobenzene	ND	0.50	"								
1,3-Dichloropropane	ND	0.50	"								
1,4-Dichlorobenzene	ND	0.50	"								
2,2-Dichloropropane	ND	0.50	"								
2-Chlorotoluene	ND	0.50	"								
2-Hexanone	ND	0.50	"								
4-Chlorotoluene	ND	0.50	"								
Acetone	ND	2.0	"								
Benzene	ND	0.50	"								
Bromobenzene	ND	0.50	"								
Bromochloromethane	ND	0.50	"								
Bromodichloromethane	ND	0.50	"								
Bromoform	ND	0.50	"								
Bromomethane	ND	0.50	"								
Carbon tetrachloride	ND	0.50	"								
Chlorobenzene	ND	0.50	"								
Chloroethane	ND	0.50	"								
Chloroform	ND	0.50	"								
Chloromethane	0.22	0.50	"								
cis-1,2-Dichloroethylene	ND	0.50	"								
cis-1,3-Dichloropropylene	ND	0.50	"								
Dibromochloromethane	ND	0.50	"								
Dibromomethane	ND	0.50	"								
Dichlorodifluoromethane	ND	0.50	"								
Ethyl Benzene	ND	0.50	"								
Hexachlorobutadiene	ND	0.50	"								
Isopropylbenzene	ND	0.50	"								
Methyl tert-butyl ether (MTBE)	ND	0.50	"								
Methylene chloride	ND	2.0	"								
Naphthalene	ND	2.0	"								
n-Butylbenzene	ND	0.50	"								
n-Propylbenzene	ND	0.50	"								
o-Xylene	ND	0.50	"								



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG30659 - EPA 5030B

Blank (BG30659-BLK1)

Prepared & Analyzed: 07/15/2013

p- & m- Xylenes	ND	1.0	ug/L								
p-Isopropyltoluene	ND	0.50	"								
sec-Butylbenzene	ND	0.50	"								
Styrene	ND	0.50	"								
tert-Butylbenzene	ND	0.50	"								
Tetrachloroethylene	ND	0.50	"								
Toluene	ND	0.50	"								
trans-1,2-Dichloroethylene	ND	0.50	"								
trans-1,3-Dichloropropylene	ND	0.50	"								
Trichloroethylene	ND	0.50	"								
Trichlorofluoromethane	ND	0.50	"								
Vinyl Chloride	ND	0.50	"								
Xylenes, Total	ND	1.5	"								
<i>Surrogate: 1,2-Dichloroethane-d4</i>	8.69		"	10.0		86.9	72.6-129				
<i>Surrogate: p-Bromofluorobenzene</i>	12.3		"	10.0		123	63.5-145				
<i>Surrogate: Toluene-d8</i>	10.2		"	10.0		102	81.2-127				

LCS (BG30659-BS1)

Prepared & Analyzed: 07/15/2013

1,1,1,2-Tetrachloroethane	10.8		ug/L	10.0		108	82.3-130				
1,1,1-Trichloroethane	9.44		"	10.0		94.4	75.6-137				
1,1,2,2-Tetrachloroethane	10.6		"	10.0		106	71.3-131				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.3		"	10.0		103	71.1-129				
1,1,2-Trichloroethane	9.69		"	10.0		96.9	74.5-129				
1,1-Dichloroethane	9.14		"	10.0		91.4	79.6-132				
1,1-Dichloroethylene	9.92		"	10.0		99.2	80.2-146				
1,1-Dichloropropylene	8.90		"	10.0		89.0	75-136				
1,2,3-Trichlorobenzene	11.7		"	10.0		117	66.1-136				
1,2,3-Trichloropropane	10.3		"	10.0		103	63-131				
1,2,4-Trichlorobenzene	10.6		"	10.0		106	70.6-136				
1,2,4-Trimethylbenzene	11.7		"	10.0		117	75.3-135				
1,2-Dibromo-3-chloropropane	10.2		"	10.0		102	58.9-140				
1,2-Dibromoethane	10.1		"	10.0		101	79-130				
1,2-Dichlorobenzene	9.70		"	10.0		97.0	76.1-122				
1,2-Dichloroethane	8.91		"	10.0		89.1	74.6-132				
1,2-Dichloropropane	9.84		"	10.0		98.4	76.9-129				
1,3,5-Trimethylbenzene	9.87		"	10.0		98.7	70.6-127				
1,3-Dichlorobenzene	10.2		"	10.0		102	77-124				
1,3-Dichloropropane	9.53		"	10.0		95.3	75.8-126				
1,4-Dichlorobenzene	9.92		"	10.0		99.2	76.6-125				
2,2-Dichloropropane	10.6		"	10.0		106	69-133				
2-Chlorotoluene	10.1		"	10.0		101	66.3-119				
2-Hexanone	8.83		"	10.0		88.3	70-130				
4-Chlorotoluene	10.3		"	10.0		103	69.2-127				
Acetone	5.86		"	10.0		58.6	70-130	Low Bias			
Benzene	8.63		"	10.0		86.3	76.2-129				
Bromobenzene	10.5		"	10.0		105	71.3-123				
Bromochloromethane	8.37		"	10.0		83.7	70.8-137				
Bromodichloromethane	10.5		"	10.0		105	79.7-134				
Bromoform	12.2		"	10.0		122	70.5-141				
Bromomethane	9.84		"	10.0		98.4	43.9-147				
Carbon tetrachloride	9.54		"	10.0		95.4	78.1-138				
Chlorobenzene	9.79		"	10.0		97.9	80.4-125				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	RPD	Limit	Flag
		Limit			Result					Limit			

Batch BG30659 - EPA 5030B

LCS (BG30659-BS1)

Prepared & Analyzed: 07/15/2013

Chloroethane	9.33		ug/L	10.0		93.3	55.8-140						
Chloroform	8.90		"	10.0		89.0	76.6-133						
Chloromethane	9.91		"	10.0		99.1	48.8-115						
cis-1,2-Dichloroethylene	8.66		"	10.0		86.6	75.1-128						
cis-1,3-Dichloropropylene	10.9		"	10.0		109	74.5-128						
Dibromochloromethane	11.1		"	10.0		111	79.8-134						
Dibromomethane	9.99		"	10.0		99.9	79-130						
Dichlorodifluoromethane	11.6		"	10.0		116	47.1-101	High Bias					
Ethyl Benzene	10.1		"	10.0		101	80.8-128						
Hexachlorobutadiene	12.0		"	10.0		120	64.8-128						
Isopropylbenzene	10.5		"	10.0		105	75.5-135						
Methyl tert-butyl ether (MTBE)	8.95		"	10.0		89.5	65.1-140						
Methylene chloride	1.89		"	10.0		18.9	61.3-120	Low Bias					
Naphthalene	11.4		"	10.0		114	62.3-148						
n-Butylbenzene	10.3		"	10.0		103	67.2-123						
n-Propylbenzene	10.5		"	10.0		105	70.5-127						
o-Xylene	9.84		"	10.0		98.4	75.9-122						
p- & m- Xylenes	20.2		"	20.0		101	77.7-127						
p-Isopropyltoluene	10.8		"	10.0		108	75.6-129						
sec-Butylbenzene	10.7		"	10.0		107	71.5-125						
Styrene	12.3		"	10.0		123	77.8-123						
tert-Butylbenzene	10.8		"	10.0		108	75.9-151						
Tetrachloroethylene	10.5		"	10.0		105	63.6-167						
Toluene	9.68		"	10.0		96.8	77-123						
trans-1,2-Dichloroethylene	9.05		"	10.0		90.5	76.3-139						
trans-1,3-Dichloropropylene	10.9		"	10.0		109	72.5-137						
Trichloroethylene	10.2		"	10.0		102	77.9-130						
Trichlorofluoromethane	9.44		"	10.0		94.4	57.4-133						
Vinyl Chloride	10.6		"	10.0		106	54.9-124						
Surrogate: 1,2-Dichloroethane-d4	8.75		"	10.0		87.5	72.6-129						
Surrogate: p-Bromofluorobenzene	10.2		"	10.0		102	63.5-145						
Surrogate: Toluene-d8	9.54		"	10.0		95.4	81.2-127						



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG30659 - EPA 5030B											
LCS Dup (BG30659-BSD1)											
Prepared & Analyzed: 07/15/2013											
1,1,1,2-Tetrachloroethane	10.6		ug/L	10.0		106	82.3-130		1.96	21.1	
1,1,1-Trichloroethane	9.10		"	10.0		91.0	75.6-137		3.67	19.7	
1,1,2,2-Tetrachloroethane	11.5		"	10.0		115	71.3-131		8.40	20.8	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.2		"	10.0		102	71.1-129		0.683	21.7	
1,1,2-Trichloroethane	10.8		"	10.0		108	74.5-129		10.9	20.3	
1,1-Dichloroethane	9.10		"	10.0		91.0	79.6-132		0.439	20.6	
1,1-Dichloroethylene	9.50		"	10.0		95.0	80.2-146		4.33	20	
1,1-Dichloropropylene	8.73		"	10.0		87.3	75-136		1.93	19.3	
1,2,3-Trichlorobenzene	11.2		"	10.0		112	66.1-136		4.37	21.6	
1,2,3-Trichloropropane	11.2		"	10.0		112	63-131		8.75	23.9	
1,2,4-Trichlorobenzene	9.97		"	10.0		99.7	70.6-136		5.94	21.7	
1,2,4-Trimethylbenzene	10.8		"	10.0		108	75.3-135		7.47	18.8	
1,2-Dibromo-3-chloropropane	11.3		"	10.0		113	58.9-140		10.3	27.7	
1,2-Dibromoethane	11.2		"	10.0		112	79-130		10.3	23	
1,2-Dichlorobenzene	9.75		"	10.0		97.5	76.1-122		0.514	19.8	
1,2-Dichloroethane	9.05		"	10.0		90.5	74.6-132		1.56	20.2	
1,2-Dichloropropane	10.4		"	10.0		104	76.9-129		5.24	20.7	
1,3,5-Trimethylbenzene	9.46		"	10.0		94.6	70.6-127		4.24	18.9	
1,3-Dichlorobenzene	9.92		"	10.0		99.2	77-124		2.49	19.2	
1,3-Dichloropropane	10.4		"	10.0		104	75.8-126		8.54	22.1	
1,4-Dichlorobenzene	9.96		"	10.0		99.6	76.6-125		0.402	18.6	
2,2-Dichloropropane	10.1		"	10.0		101	69-133		5.60	19.8	
2-Chlorotoluene	9.70		"	10.0		97.0	66.3-119		4.44	21.6	
2-Hexanone	11.1		"	10.0		111	70-130		22.7	30	
4-Chlorotoluene	10.1		"	10.0		101	69.2-127		1.66	19	
Acetone	7.90		"	10.0		79.0	70-130		29.7	30	
Benzene	8.59		"	10.0		85.9	76.2-129		0.465	19	
Bromobenzene	10.8		"	10.0		108	71.3-123		2.73	20.3	
Bromochloromethane	8.61		"	10.0		86.1	70.8-137		2.83	23.9	
Bromodichloromethane	10.9		"	10.0		109	79.7-134		3.73	21	
Bromoform	12.8		"	10.0		128	70.5-141		5.12	21.8	
Bromomethane	9.43		"	10.0		94.3	43.9-147		4.26	28.4	
Carbon tetrachloride	9.81		"	10.0		98.1	78.1-138		2.79	20.1	
Chlorobenzene	10.2		"	10.0		102	80.4-125		3.71	19.9	
Chloroethane	9.64		"	10.0		96.4	55.8-140		3.27	23.3	
Chloroform	8.81		"	10.0		88.1	76.6-133		1.02	20.3	
Chloromethane	9.90		"	10.0		99.0	48.8-115		0.101	24.5	
cis-1,2-Dichloroethylene	8.90		"	10.0		89.0	75.1-128		2.73	20.5	
cis-1,3-Dichloropropylene	11.4		"	10.0		114	74.5-128		4.03	19.9	
Dibromochloromethane	11.7		"	10.0		117	79.8-134		5.26	21.3	
Dibromomethane	11.1		"	10.0		111	79-130		10.3	22.4	
Dichlorodifluoromethane	11.5		"	10.0		115	47.1-101	High Bias	0.605	23.9	
Ethyl Benzene	10.2		"	10.0		102	80.8-128		0.891	19.2	
Hexachlorobutadiene	11.3		"	10.0		113	64.8-128		5.49	20.6	
Isopropylbenzene	10.1		"	10.0		101	75.5-135		4.18	20	
Methyl tert-butyl ether (MTBE)	9.58		"	10.0		95.8	65.1-140		6.80	23.6	
Methylene chloride	1.96		"	10.0		19.6	61.3-120	Low Bias	3.64	20.4	
Naphthalene	11.7		"	10.0		117	62.3-148		2.78	27.1	
n-Butylbenzene	9.74		"	10.0		97.4	67.2-123		5.59	19.1	
n-Propylbenzene	9.87		"	10.0		98.7	70.5-127		6.09	23.4	
o-Xylene	10.0		"	10.0		100	75.9-122		2.01	19.3	



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	RPD	Limit	Flag
		Limit								Limit			

Batch BG30659 - EPA 5030B

LCS Dup (BG30659-BSD1)

Prepared & Analyzed: 07/15/2013


p- & m- Xylenes	20.3		ug/L	20.0		102	77.7-127			0.443	18.6		
p-Isopropyltoluene	10.2		"	10.0		102	75.6-129			6.48	19.1		
sec-Butylbenzene	10.2		"	10.0		102	71.5-125			4.70	18.9		
Styrene	11.9		"	10.0		119	77.8-123			2.73	20.9		
tert-Butylbenzene	10.4		"	10.0		104	75.9-151			3.86	20.9		
Tetrachloroethylene	10.4		"	10.0		104	63.6-167			0.0957	27.7		
Toluene	9.81		"	10.0		98.1	77-123			1.33	18.7		
trans-1,2-Dichloroethylene	8.90		"	10.0		89.0	76.3-139			1.67	19.5		
trans-1,3-Dichloropropylene	12.0		"	10.0		120	72.5-137			9.52	19.3		
Trichloroethylene	10.8		"	10.0		108	77.9-130			6.01	20.5		
Trichlorofluoromethane	9.62		"	10.0		96.2	57.4-133			1.89	21.4		
Vinyl Chloride	10.5		"	10.0		105	54.9-124			1.14	22.3		
<i>Surrogate: 1,2-Dichloroethane-d4</i>	8.89		"	10.0		88.9	72.6-129						
<i>Surrogate: p-Bromofluorobenzene</i>	9.86		"	10.0		98.6	63.5-145						
<i>Surrogate: Toluene-d8</i>	9.84		"	10.0		98.4	81.2-127						



Metals by EPA 6000 Series Methods - Quality Control Data


York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Flag	RPD	RPD	Limit	Flag		
		Limit		Level	Result		Limits		Limit					
Batch BG30696 - EPA 3010A														
Blank (BG30696-BLK1)											Prepared & Analyzed: 07/15/2013			
Iron - Dissolved	ND	0.0200	mg/L											
Duplicate (BG30696-DUP1)											*Source sample: 13G0347-01 (WQ070913:1050NP2-10)		Prepared & Analyzed: 07/15/2013	
Iron - Dissolved	0.0595	0.0200	mg/L		0.0437					30.7	20	Non-dir.		
Matrix Spike (BG30696-MS1)											*Source sample: 13G0347-01 (WQ070913:1050NP2-10)		Prepared & Analyzed: 07/15/2013	
Iron - Dissolved	1.09	0.0200	mg/L	1.00	0.0437	105	75-125							
Reference (BG30696-SRM1)											Prepared & Analyzed: 07/15/2013			
Iron - Dissolved	1.36	0.0200	mg/L	1.39		97.9	88.4-113							



Metals by EPA 200 Series Methods - Quality Control Data
York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG30697 - EPA 3010A											
Blank (BG30697-BLK1)										Prepared & Analyzed: 07/15/2013	
Iron	ND	0.0200	mg/L								
Duplicate (BG30697-DUP1)										*Source sample: 13G0347-01 (WQ070913:1050NP2-10)	
Prepared & Analyzed: 07/15/2013											
Iron	32.7	0.0200	mg/L		33.0				0.958	20	
Matrix Spike (BG30697-MS1)										*Source sample: 13G0347-01 (WQ070913:1050NP2-10)	
Prepared & Analyzed: 07/15/2013											
Iron	34.2	0.0200	mg/L	1.00	33.0	113	75-125				
Reference (BG30697-SRM1)										Prepared & Analyzed: 07/15/2013	
Iron	1.35	0.0200	mg/L	1.39		97.4	88.4-113				



Miscellaneous Physical/Conventional Chemistry Parameters - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG30598 - % Solids Prep

Blank (BG30598-BLK1)

Prepared & Analyzed: 07/15/2013


Total Dissolved Solids ND 1.00 mg/L

Duplicate (BG30598-DUP1)

*Source sample: 13G0347-01 (WQ070913:1050NP2-10)

Prepared & Analyzed: 07/15/2013

Total Dissolved Solids 112 1.00 mg/L 118 5.22 15



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
13G0344-01	WQ070913:1040NP2-6	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
13G0344-02	WQ070913:1045NP2-7	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
13G0347-01	WQ070913:1050NP2-10	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C

Notes and Definitions

QL-02	This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
M-RPD	Sample conc. <5 X reporting limit.
J	Detected below the Reporting Limit but greater than or equal to the Method Detection Limit (MDL); therefore, the result is an estimated concentration.
B	Analyte is found in the associated analysis batch blank. For volatiles, methylene chloride and acetone are common lab contaminants. Data users should consider anything <10x the blank value as artifact.
ND	Analyte NOT DETECTED at the stated Reporting Limit (RL) or above.
RL	REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
MDL	METHOD DETECTION LIMIT - the minimum concentration that can be measured and reported with a 99% confidence that the concentration is greater than zero. If requested or required, a value reported below the RL and above the MDL is considered estimated and is noted with a "J" flag.
NR	Not reported
RPD	Relative Percent Difference
Wet	The data has been reported on an as-received (wet weight) basis
Low Bias	Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
High Bias	High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
Non-Dir.	Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the MDL, with values between the MDL and the RL being "J" flagged as estimated results.

YORK

ANALYTICAL LABORATORIES, INC.

120 RESEARCH DR. STRATFORD, CT 06615
(203) 325-1371 FAX (203) 357-0166

Field Chain-of-Custody Record

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 13G0344

YOUR INFORMATION Company: <u>LBG</u> Address: <u>4 Research Dr. Suite 301 Shelton, CT 06484</u> Phone No. <u>203-929-8555</u> Contact Person: <u>Tunde Sandoz</u> E-Mail Address: <u>TSandoz@lbgct.com</u>	Report To: Company: <u>Same</u> Address: Phone No. Attention: E-Mail Address:	Invoice To: Company: <u>Same</u> Address: Phone No. Attention: E-Mail Address:	YOUR PROJECT ID <u>Rowe Industries</u> Purchase Order No. <u>NAB5A6</u> Samples from: CT NY X NJ	Turn-Around Time RUSH - Same Day <input type="checkbox"/> RUSH - Next Day <input type="checkbox"/> RUSH - Two Day <input type="checkbox"/> RUSH - Three Day <input type="checkbox"/> RUSH - Four Day <input type="checkbox"/> Standard (5-7 Days) <input checked="" type="checkbox"/>	Report Type Summary Report <input checked="" type="checkbox"/> Summary w/ QA Summary <input checked="" type="checkbox"/> CT RCP Package <input checked="" type="checkbox"/> CT RCP QA/DUE Pkg <input type="checkbox"/> NY ASP A Package <input type="checkbox"/> NY ASP B Package <input checked="" type="checkbox"/> NI DEP Red. Deliv. <input type="checkbox"/> <i>Electronic Data Deliverables (EDD)</i> Simple Excel <input checked="" type="checkbox"/> NYSECE/QuIS <input type="checkbox"/> EQ/IS (Std) <input type="checkbox"/> EZ-EDD (EQ/IS) <input type="checkbox"/> NI DEP SRP HazSite EDD <input type="checkbox"/> GIS/KEY (Std) <input type="checkbox"/> Other <input type="checkbox"/> York Regulatory Comparison <input type="checkbox"/> Excel Spreadsheet <input type="checkbox"/> Compare to the following (Reg. (please fill in)):
--	---	--	--	--	--

Print Clearly and Legibly. All information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.

Matrix Codes
S - soil
Other - specify (oil, etc)
WW - wastewater
GW - groundwater
DW - drinking water
Air-A - ambient air
Air-SV - soil vapor

Samples Collected/Authorized By (Signature)
STEFAN HNAT
Name (printed)

Sample Identification	Date Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below	Container Description(s)	Temperature on Receipt
WR070513:1046N2-6	7/5/13 1040	GW	Fe by EPA 200.7 / Fe, Dissolved by EPA 8010 (SW 246-0010B) / VOCs, P260 list (EPA SW 245-8260b) plus from 113	3X 20	
WR070513:1045N2-7	1045	GW	Fe by EPA 200.7 / Fe, Dissolved by EPA 8010 (SW 246-0010B) / VOCs, P260 list (EPA SW 245-8260a) plus from 113 / TOS (SH 2540c)	3U 20	
WR070513:1052N2-10	1050	GW		3V 30	

YORK

ANALYTICAL LABORATORIES, INC.
120 RESEARCH DR. STRATFORD, CT 06615
12031 325-1371 FAX (203) 357-0166

Field Chain-of-Custody Record

Page 1 of 1

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 13G0347


YOUR Information		Report To:		Invoice To:		YOUR Project ID		Turn-Around Time		Report Type	
Company: <u>LBG</u>	Company: <u>Same</u>	Company: <u>Same</u>	Company: <u>APWE Industries</u>	8260 full	Volatiles	8270 or 625	Semi-Volts	RUSH - Same Day	Full Lists	Summary Report <u>X</u>	Summary w/ QA summary <u>X</u>
Address: <u>4 Research Dr. Suite 301</u>	Address: _____	Address: _____	Address: _____	624	Site Spec	808 IPest	RCRA8	RUSH - Next Day	Pr4 Poll.	CT RCP Package	CT RCP Package
Phone No. <u>203-929-8555</u>	Phone No. _____	Phone No. _____	Phone No. _____	STARS list	Nassau Co.	BN Only	PF13 list	RUSH - Two Day	TCL Opacts	CTRCP DQA/DUE Pkg.	CTRCP DQA/DUE Pkg.
Attention: _____	Attention: _____	Attention: _____	Attention: _____	BTEX	Suffolk Co.	Acids Only	TAL	RUSH - Three Day	TAL-MerCh	NY ASP A Package	NY ASP A Package
E-Mail Address: <u>Tsandor@LBGCT.com</u>	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	MTBE	Ketones	PAH list	CT RCP	RUSH - Four Day	Full TCLP	NY ASP B Package <u>NP2-10 only</u>	NY ASP B Package <u>NP2-10 only</u>
<p>Print Clearly and Legibly. All information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.</p>		<p>Matrix Codes</p> <p>S - soil</p> <p>Other - specify (oil, etc.)</p> <p>WW - wastewater</p> <p>GW - groundwater</p> <p>DW - drinking water</p> <p>Air-A - ambient air</p> <p>Air-SV - soil vapor</p>		<p>8021B list</p> <p>App. IX list</p> <p>SPLP or TCLP</p> <p>608 Pest</p> <p>LIST Below</p> <p>Methane</p> <p>Hexachl</p> <p>Air TICs</p> <p>Air VPH</p> <p>SPLP or TCLP</p> <p>Dissolved</p> <p>AF STARS</p> <p>BTU/b.</p> <p>Par 360-Residue</p> <p>TOX</p> <p>Par 360-Residue</p> <p>BTU/b.</p> <p>Par 360-Residue</p> <p>TOC</p> <p>NYDEP-Soil</p> <p>NYSDCCover</p> <p>Asbestos</p> <p>Silica</p>	<p>Standard(5-7 Days) <input checked="" type="checkbox"/></p> <p>Misc. Org.</p>	<p>Misc. Org.</p>	<p>Simple Excel <u>X</u></p> <p>NYSDC EQUIS</p> <p>EQUIS (std)</p> <p>EZ-EDD (EQUIS)</p> <p>NJDEP SRP HazSite EDD</p> <p>GIS/KEY (std)</p> <p>Other</p> <p>York Regulatory Comparison</p> <p>Excel Spreadsheet</p> <p>Compare to the following Reg. (please fill in)</p>				
<p>Samples Collected/Authorized By (Signature)</p> <p><u>STEVEN HNAT</u></p> <p>Name (printed)</p>		<p>Choose Analyses Needed from the Menu Above and Enter Below</p> <p>Fe by EPA 200.7/Fe, Dissolved by EPA 6010 (SWP46-6010) / VOCs, R260 list (EPA SWP45-R260b) plus fecal 113</p> <p>Fe by EPA 200.7/Fe, Dissolved by EPA 6010 (SWP46-6010) / VOCs R260 list (EPA SWP45-R260b) plus fecal 113 / TDS (SH 2540c)</p>		<p>Container Description(s)</p> <p><u>3V 2P</u></p> <p><u>3V 2P</u></p> <p><u>3V 3P</u></p>							
<p>Sample Identification</p> <p><u>WQ070513-104AN2-6</u></p> <p><u>WQ070913-104SNP2-7</u></p> <p><u>WQ070913-103SNP2-10</u></p>	<p>Date Sampled</p> <p><u>7/5/13 1040</u></p> <p><u>1045</u></p> <p><u>1030</u></p>	<p>Sample Matrix</p> <p><u>GW</u></p> <p><u>GW</u></p> <p><u>GW</u></p>	<p>Preservation</p> <p>Check those Applicable</p> <p>Special Instructions</p> <p>Field Filtered <input type="checkbox"/></p> <p>Lab to Filter <input type="checkbox"/></p>	<p>4°C <input checked="" type="checkbox"/></p> <p>Frozen <input type="checkbox"/></p> <p>ZnAc <input type="checkbox"/></p> <p>HCl <input checked="" type="checkbox"/></p> <p>MeOH <input checked="" type="checkbox"/></p> <p>Ascorbic Acid <input type="checkbox"/></p> <p>Other <input type="checkbox"/></p> <p>HNO3 <input type="checkbox"/></p> <p>H2SO4 <input type="checkbox"/></p> <p>NaOH <input type="checkbox"/></p>	<p>Comments</p> <p><u>TC Analytical 7/10/13 10:35</u></p> <p><u>Samples Relinquished By</u></p> <p><u>7/10/13 1035</u></p> <p><u>Date/Time</u></p> <p><u>7/10/13-1500</u></p> <p><u>Date/Time</u></p> <p><u>7/10/13-1500</u></p> <p><u>Date/Time</u></p> <p>Temperature on Receipt <u>4.4 °C</u></p>						

Field Chain-of-Custody Record

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

YOUR Information Company: <u>LBG</u> Address: <u>4 Research Dr. Suite 301</u> <u>Shelton, CT 06484</u> Phone No. <u>203-929-8555</u> Contact Person: <u>Junde Sandor</u> E-Mail Address: <u>JSandor@LBGI.com</u>		Report To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____		Invoice To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____		YOUR Project ID <u>Apwe Industries.</u> Purchase Order No. <u>NAB5A6.</u> Samples from: CT <u>NY</u> X NJ		Turn-Around Time RUSH - Same Day <input type="checkbox"/> RUSH - Next Day <input type="checkbox"/> RUSH - Two Day <input type="checkbox"/> RUSH - Three Day <input type="checkbox"/> RUSH - Four Day <input type="checkbox"/> Standard(5-7 Days) <input checked="" type="checkbox"/>		Report Type Summary Report <u>X</u> pdf Summary w/ QA summary <u>X</u> pdf CT RCP Package CTRCP DQA/DUE Pkg. NY ASP A Package NY ASP B Package <u>NP2-10 only</u> pdf. NJDEP Red. Deliv. Electronic Data Deliverables (EDD) Simple Excel <input checked="" type="checkbox"/> NYSDEC EQUIS EQUIS (std) EZ-EDD (EQUIS) NJDEP SRP HazSite EDD GIS/KEY (std) Other _____ York Regulatory Comparison Excel Spreadsheet Compare to the following Reg. (please fill in)	
---	--	---	--	--	--	---	--	---	--	---	--

Sample Identification	Date Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below	Container Description(s)	Temperature on Receipt
WQ070513-104NR2-6	7/5/13 1040	GW	Fe by EPA 200.7/Fe, Dissolved by EPA 6010 (SWP46-6100) / VOCs, R260 List (EPA SWP45-R260b) plus from 113	3V 2P	
WQ070913-104SNP2-7	1045	GW	↓	3V 2P	
WQ070913-104SNP2-10	1050	GW	Fe by EPA 200.7/Fe, Dissolved by EPA 6010 (SWP46-6100) / VOCs R260 List (EPA SWP45-R260b) plus from 113 / TDS (SH 2540C)	3V 3P	
Preservation: 4°C <input checked="" type="checkbox"/> Frozen <input type="checkbox"/> HCl <input checked="" type="checkbox"/> MeOH <input type="checkbox"/> H ₂ O <input type="checkbox"/> NaOH <input type="checkbox"/> Check those Applicable: ZnAc <input type="checkbox"/> Ascorbic Acid <input type="checkbox"/> Other <input type="checkbox"/>					
Special Instructions: _____ Field Filtered <input type="checkbox"/> Lab to Filter <input type="checkbox"/>					
Samples Relinquished By: <u>[Signature]</u> Date/Time: <u>7/10/13 1035</u> Samples Received By: <u>[Signature]</u> Date/Time: <u>7/10/13 10:35</u> Samples Relinquished By: _____ Date/Time: _____ Samples Received in LAB by: _____ Date/Time: _____					Temperature on Receipt: <u>4.4</u> °C



Technical Report

prepared for:

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301

Shelton CT, 06484

Attention: Tunde Komuves-Sandor

Report Date: 07/25/2013

Client Project ID: O&M Sag Harbor (Rowe Industries Site)

York Project (SDG) No.: 13G0662

CT Cert. No. PH-0723

New Jersey Cert. No. CT-005



New York Cert. No. 10854

PA Cert. No. 68-04440

Report Date: 07/25/2013
Client Project ID: O&M Sag Harbor (Rowe Industries Site)
York Project (SDG) No.: 13G0662

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on July 18, 2013 and listed below. The project was identified as your project: **O&M Sag Harbor (Rowe Industries Site)**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Notes section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the attachment to this report, and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
13G0662-01	WQ071613:1100NP2-6	Water	07/16/2013	07/18/2013
13G0662-02	WQ071613:1105NP2-7	Water	07/16/2013	07/18/2013
13G0664-01	WQ071613:1110NP2-10	Water	07/18/2013	07/18/2013

General Notes for York Project (SDG) No.: 13G0662

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All samples were received in proper condition for analysis with proper documentation, unless otherwise noted.
6. All analyses conducted met method or Laboratory SOP requirements. See the Qualifiers and/or Narrative sections for further information.
7. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
8. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 07/25/2013

YORK



Sample Information

Client Sample ID: WQ071613:1100NP2-6

York Sample ID: 13G0662-01

York Project (SDG) No.
13G0662

Client Project ID
O&M Sag Harbor (Rowe Industries Site)

Matrix
Water

Collection Date/Time
July 16, 2013 11:00 am

Date Received
07/18/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
71-55-6	1,1,1-Trichloroethane	0.80		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
75-34-3	1,1-Dichloroethane	0.25	J	ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS



Sample Information

Client Sample ID: WQ071613:1100NP2-6

York Sample ID: 13G0662-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0662

O&M Sag Harbor (Rowe Industries Site)

Water

July 16, 2013 11:00 am

07/18/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
127-18-4	Tetrachloroethylene	0.69		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
108-88-3	Toluene	0.22	J	ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 06:51	SS



Sample Information

Client Sample ID: WQ071613:1100NP2-6

York Sample ID: 13G0662-01

York Project (SDG) No. 13G0662 Client Project ID O&M Sag Harbor (Rowe Industries Site) Matrix Water Collection Date/Time July 16, 2013 11:00 am Date Received 07/18/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Surrogate Recoveries	Result									
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	108 %			72.6	129					
460-00-4	Surrogate: p-Bromofluorobenzene	98.5 %			63.5	145					
2037-26-5	Surrogate: Toluene-d8	86.5 %			81.2	127					

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	ND		mg/L	0.0200	0.0200	1	EPA SW846-6010B	07/23/2013 08:32	07/23/2013 11:05	AMC

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	1.23		mg/L	0.0146	0.0200	1	EPA 200.7	07/23/2013 08:34	07/23/2013 12:03	AMC

Sample Information

Client Sample ID: WQ071613:1105NP2-7

York Sample ID: 13G0662-02

York Project (SDG) No. 13G0662 Client Project ID O&M Sag Harbor (Rowe Industries Site) Matrix Water Collection Date/Time July 16, 2013 11:05 am Date Received 07/18/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS



Sample Information

Client Sample ID: WQ071613:1105NP2-7

York Sample ID: 13G0662-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0662

O&M Sag Harbor (Rowe Industries Site)

Water

July 16, 2013 11:05 am

07/18/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS



Sample Information

Client Sample ID: WQ071613:1105NP2-7

York Sample ID: 13G0662-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0662

O&M Sag Harbor (Rowe Industries Site)

Water

July 16, 2013 11:05 am

07/18/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
127-18-4	Tetrachloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/23/2013 10:15	07/24/2013 07:29	SS
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	107 %	72.6-129								
460-00-4	Surrogate: p-Bromofluorobenzene	97.5 %	63.5-145								
2037-26-5	Surrogate: Toluene-d8	87.9 %	81.2-127								

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	0.0477		mg/L	0.0200	0.0200	1	EPA SW846-6010B	07/23/2013 08:32	07/23/2013 11:09	AMC



Sample Information

Client Sample ID: WQ071613:1105NP2-7

York Sample ID: 13G0662-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0662

O&M Sag Harbor (Rowe Industries Site)

Water

July 16, 2013 11:05 am

07/18/2013

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	1.08		mg/L	0.0146	0.0200	1	EPA 200.7	07/23/2013 08:34	07/23/2013 12:08	AMC

Sample Information

Client Sample ID: WQ071613:1110NP2-10

York Sample ID: 13G0664-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0664

O&M Sag Harbor (Rowe Industries Site)

Water

July 18, 2013 11:10 am

07/18/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS



Sample Information

Client Sample ID: WQ071613:1110NP2-10

York Sample ID: 13G0664-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0664

O&M Sag Harbor (Rowe Industries Site)

Water

July 18, 2013 11:10 am

07/18/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS



Sample Information

Client Sample ID: WQ071613:1110NP2-10

York Sample ID: 13G0664-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0664

O&M Sag Harbor (Rowe Industries Site)

Water

July 18, 2013 11:10 am

07/18/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
127-18-4	Tetrachloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
108-88-3	Toluene	0.49	J	ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/24/2013 13:19	07/24/2013 16:14	SS
Surrogate Recoveries		Result			Acceptance Range						
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	100 %			72.6-129						
460-00-4	Surrogate: p-Bromofluorobenzene	98.3 %			63.5-145						
2037-26-5	Surrogate: Toluene-d8	93.9 %			81.2-127						

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	0.0613		mg/L	0.0200	0.0200	1	EPA SW846-6010B	07/23/2013 08:32	07/23/2013 11:14	AMC

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	2.23		mg/L	0.0146	0.0200	1	EPA 200.7	07/23/2013 08:34	07/23/2013 12:13	AMC

Total Dissolved Solids

Log-in Notes:

Sample Notes:

Sample Prepared by Method: % Solids Prep

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Total Dissolved Solids	122		mg/L	10.0	10.0	1	SM 2540C	07/22/2013 16:12	07/22/2013 16:12	BGS



Analytical Batch Summary

Batch ID: BG31010 **Preparation Method:** % Solids Prep **Prepared By:** BGS

YORK Sample ID	Client Sample ID	Preparation Date
13G0664-01	WQ071613:1110NP2-10	07/22/13
BG31010-BLK1	Blank	07/22/13

Batch ID: BG31022 **Preparation Method:** EPA 3010A **Prepared By:** AMC

YORK Sample ID	Client Sample ID	Preparation Date
13G0662-01	WQ071613:1100NP2-6	07/23/13
13G0662-02	WQ071613:1105NP2-7	07/23/13
13G0664-01	WQ071613:1110NP2-10	07/23/13
BG31022-BLK1	Blank	07/23/13
BG31022-DUP1	Duplicate	07/23/13
BG31022-MS1	Matrix Spike	07/23/13
BG31022-SRM1	Reference	07/23/13

Batch ID: BG31025 **Preparation Method:** EPA 3010A **Prepared By:** AMC

YORK Sample ID	Client Sample ID	Preparation Date
13G0662-01	WQ071613:1100NP2-6	07/23/13
13G0662-02	WQ071613:1105NP2-7	07/23/13
13G0664-01	WQ071613:1110NP2-10	07/23/13
BG31025-BLK1	Blank	07/23/13
BG31025-DUP1	Duplicate	07/23/13
BG31025-MS1	Matrix Spike	07/23/13
BG31025-SRM1	Reference	07/23/13

Batch ID: BG31069 **Preparation Method:** EPA 5030B **Prepared By:** EKM

YORK Sample ID	Client Sample ID	Preparation Date
13G0662-01	WQ071613:1100NP2-6	07/23/13
13G0662-02	WQ071613:1105NP2-7	07/23/13
BG31069-BLK1	Blank	07/23/13
BG31069-BS1	LCS	07/23/13
BG31069-BSD1	LCS Dup	07/23/13

Batch ID: BG31099 **Preparation Method:** EPA 5030B **Prepared By:** EKM

YORK Sample ID	Client Sample ID	Preparation Date
13G0664-01	WQ071613:1110NP2-10	07/24/13
BG31099-BLK1	Blank	07/24/13
BG31099-BS1	LCS	07/24/13
BG31099-BSD1	LCS Dup	07/24/13



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31069 - EPA 5030B

Blank (BG31069-BLK1)

Prepared & Analyzed: 07/23/2013

1,1,1,2-Tetrachloroethane	ND	0.50	ug/L								
1,1,1-Trichloroethane	ND	0.50	"								
1,1,2,2-Tetrachloroethane	ND	0.50	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.50	"								
1,1,2-Trichloroethane	ND	0.50	"								
1,1-Dichloroethane	ND	0.50	"								
1,1-Dichloroethylene	ND	0.50	"								
1,1-Dichloropropylene	ND	0.50	"								
1,2,3-Trichlorobenzene	ND	2.0	"								
1,2,3-Trichloropropane	ND	0.50	"								
1,2,4-Trichlorobenzene	ND	2.0	"								
1,2,4-Trimethylbenzene	ND	0.50	"								
1,2-Dibromo-3-chloropropane	ND	2.0	"								
1,2-Dibromoethane	ND	0.50	"								
1,2-Dichlorobenzene	ND	0.50	"								
1,2-Dichloroethane	ND	0.50	"								
1,2-Dichloropropane	ND	0.50	"								
1,3,5-Trimethylbenzene	ND	0.50	"								
1,3-Dichlorobenzene	ND	0.50	"								
1,3-Dichloropropane	ND	0.50	"								
1,4-Dichlorobenzene	ND	0.50	"								
2,2-Dichloropropane	ND	0.50	"								
2-Chlorotoluene	ND	0.50	"								
2-Hexanone	ND	0.50	"								
4-Chlorotoluene	ND	0.50	"								
Acetone	ND	2.0	"								
Benzene	ND	0.50	"								
Bromobenzene	ND	0.50	"								
Bromochloromethane	ND	0.50	"								
Bromodichloromethane	ND	0.50	"								
Bromoform	ND	0.50	"								
Bromomethane	ND	0.50	"								
Carbon tetrachloride	ND	0.50	"								
Chlorobenzene	ND	0.50	"								
Chloroethane	ND	0.50	"								
Chloroform	ND	0.50	"								
Chloromethane	ND	0.50	"								
cis-1,2-Dichloroethylene	ND	0.50	"								
cis-1,3-Dichloropropylene	ND	0.50	"								
Dibromochloromethane	ND	0.50	"								
Dibromomethane	ND	0.50	"								
Dichlorodifluoromethane	ND	0.50	"								
Ethyl Benzene	ND	0.50	"								
Hexachlorobutadiene	ND	0.50	"								
Isopropylbenzene	ND	0.50	"								
Methyl tert-butyl ether (MTBE)	ND	0.50	"								
Methylene chloride	ND	2.0	"								
Naphthalene	ND	2.0	"								
n-Butylbenzene	ND	0.50	"								
n-Propylbenzene	ND	0.50	"								
o-Xylene	ND	0.50	"								



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	Flag
		Limit			Result					RPD	

Batch BG31069 - EPA 5030B

Blank (BG31069-BLK1)

Prepared & Analyzed: 07/23/2013

p- & m- Xylenes	ND	1.0	ug/L								
p-Isopropyltoluene	ND	0.50	"								
sec-Butylbenzene	ND	0.50	"								
Styrene	ND	0.50	"								
tert-Butylbenzene	ND	0.50	"								
Tetrachloroethylene	ND	0.50	"								
Toluene	ND	0.50	"								
trans-1,2-Dichloroethylene	ND	0.50	"								
trans-1,3-Dichloropropylene	ND	0.50	"								
Trichloroethylene	ND	0.50	"								
Trichlorofluoromethane	ND	0.50	"								
Vinyl Chloride	ND	0.50	"								
Xylenes, Total	ND	1.5	"								
<i>Surrogate: 1,2-Dichloroethane-d4</i>	9.98		"	10.0		99.8		72.6-129			
<i>Surrogate: p-Bromofluorobenzene</i>	9.77		"	10.0		97.7		63.5-145			
<i>Surrogate: Toluene-d8</i>	9.92		"	10.0		99.2		81.2-127			

LCS (BG31069-BS1)

Prepared & Analyzed: 07/23/2013

1,1,1,2-Tetrachloroethane	10.8		ug/L	10.0		108		82.3-130			
1,1,1-Trichloroethane	11.2		"	10.0		112		75.6-137			
1,1,2,2-Tetrachloroethane	9.75		"	10.0		97.5		71.3-131			
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.5		"	10.0		105		71.1-129			
1,1,2-Trichloroethane	9.29		"	10.0		92.9		74.5-129			
1,1-Dichloroethane	10.3		"	10.0		103		79.6-132			
1,1-Dichloroethylene	10.1		"	10.0		101		80.2-146			
1,1-Dichloropropylene	9.80		"	10.0		98.0		75-136			
1,2,3-Trichlorobenzene	9.45		"	10.0		94.5		66.1-136			
1,2,3-Trichloropropane	8.47		"	10.0		84.7		63-131			
1,2,4-Trichlorobenzene	9.45		"	10.0		94.5		70.6-136			
1,2,4-Trimethylbenzene	11.5		"	10.0		115		75.3-135			
1,2-Dibromo-3-chloropropane	9.94		"	10.0		99.4		58.9-140			
1,2-Dibromoethane	11.5		"	10.0		115		79-130			
1,2-Dichlorobenzene	9.59		"	10.0		95.9		76.1-122			
1,2-Dichloroethane	9.51		"	10.0		95.1		74.6-132			
1,2-Dichloropropane	8.64		"	10.0		86.4		76.9-129			
1,3,5-Trimethylbenzene	10.8		"	10.0		108		70.6-127			
1,3-Dichlorobenzene	10.1		"	10.0		101		77-124			
1,3-Dichloropropane	9.52		"	10.0		95.2		75.8-126			
1,4-Dichlorobenzene	10.0		"	10.0		100		76.6-125			
2,2-Dichloropropane	9.40		"	10.0		94.0		69-133			
2-Chlorotoluene	10.0		"	10.0		100		66.3-119			
2-Hexanone	9.65		"	10.0		96.5		70-130			
4-Chlorotoluene	10.2		"	10.0		102		69.2-127			
Acetone	8.46		"	10.0		84.6		70-130			
Benzene	10.7		"	10.0		107		76.2-129			
Bromobenzene	9.59		"	10.0		95.9		71.3-123			
Bromochloromethane	9.39		"	10.0		93.9		70.8-137			
Bromodichloromethane	9.09		"	10.0		90.9		79.7-134			
Bromoform	10.7		"	10.0		107		70.5-141			
Bromomethane	9.33		"	10.0		93.3		43.9-147			
Carbon tetrachloride	12.8		"	10.0		128		78.1-138			
Chlorobenzene	10.2		"	10.0		102		80.4-125			



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31069 - EPA 5030B

LCS (BG31069-BS1)

Prepared & Analyzed: 07/23/2013

Chloroethane	8.72		ug/L	10.0		87.2	55.8-140				
Chloroform	10.1		"	10.0		101	76.6-133				
Chloromethane	8.22		"	10.0		82.2	48.8-115				
cis-1,2-Dichloroethylene	10.1		"	10.0		101	75.1-128				
cis-1,3-Dichloropropylene	9.79		"	10.0		97.9	74.5-128				
Dibromochloromethane	10.8		"	10.0		108	79.8-134				
Dibromomethane	8.77		"	10.0		87.7	79-130				
Dichlorodifluoromethane	8.14		"	10.0		81.4	47.1-101				
Ethyl Benzene	10.8		"	10.0		108	80.8-128				
Hexachlorobutadiene	9.93		"	10.0		99.3	64.8-128				
Isopropylbenzene	11.0		"	10.0		110	75.5-135				
Methyl tert-butyl ether (MTBE)	6.15		"	10.0		61.5	65.1-140	Low Bias			
Methylene chloride	9.54		"	10.0		95.4	61.3-120				
Naphthalene	10.3		"	10.0		103	62.3-148				
n-Butylbenzene	9.99		"	10.0		99.9	67.2-123				
n-Propylbenzene	10.8		"	10.0		108	70.5-127				
o-Xylene	10.2		"	10.0		102	75.9-122				
p- & m- Xylenes	21.2		"	20.0		106	77.7-127				
p-Isopropyltoluene	11.1		"	10.0		111	75.6-129				
sec-Butylbenzene	11.1		"	10.0		111	71.5-125				
Styrene	12.1		"	10.0		121	77.8-123				
tert-Butylbenzene	10.8		"	10.0		108	75.9-151				
Tetrachloroethylene	9.07		"	10.0		90.7	63.6-167				
Toluene	9.60		"	10.0		96.0	77-123				
trans-1,2-Dichloroethylene	9.94		"	10.0		99.4	76.3-139				
trans-1,3-Dichloropropylene	10.6		"	10.0		106	72.5-137				
Trichloroethylene	8.63		"	10.0		86.3	77.9-130				
Trichlorofluoromethane	9.64		"	10.0		96.4	57.4-133				
Vinyl Chloride	8.25		"	10.0		82.5	54.9-124				
Surrogate: 1,2-Dichloroethane-d4	9.79		"	10.0		97.9	72.6-129				
Surrogate: p-Bromofluorobenzene	10.7		"	10.0		107	63.5-145				
Surrogate: Toluene-d8	8.79		"	10.0		87.9	81.2-127				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG31069 - EPA 5030B											
LCS Dup (BG31069-BSD1)											
Prepared & Analyzed: 07/23/2013											
1,1,1,2-Tetrachloroethane	10.8		ug/L	10.0		108	82.3-130		0.740	21.1	
1,1,1-Trichloroethane	10.8		"	10.0		108	75.6-137		3.90	19.7	
1,1,2,2-Tetrachloroethane	10.8		"	10.0		108	71.3-131		10.2	20.8	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	9.79		"	10.0		97.9	71.1-129		7.19	21.7	
1,1,2-Trichloroethane	9.66		"	10.0		96.6	74.5-129		3.91	20.3	
1,1-Dichloroethane	10.0		"	10.0		100	79.6-132		3.15	20.6	
1,1-Dichloroethylene	9.28		"	10.0		92.8	80.2-146		8.07	20	
1,1-Dichloropropylene	9.20		"	10.0		92.0	75-136		6.32	19.3	
1,2,3-Trichlorobenzene	10.1		"	10.0		101	66.1-136		6.45	21.6	
1,2,3-Trichloropropane	9.75		"	10.0		97.5	63-131		14.1	23.9	
1,2,4-Trichlorobenzene	9.63		"	10.0		96.3	70.6-136		1.89	21.7	
1,2,4-Trimethylbenzene	11.0		"	10.0		110	75.3-135		4.89	18.8	
1,2-Dibromo-3-chloropropane	10.5		"	10.0		105	58.9-140		5.29	27.7	
1,2-Dibromoethane	12.2		"	10.0		122	79-130		5.74	23	
1,2-Dichlorobenzene	9.82		"	10.0		98.2	76.1-122		2.37	19.8	
1,2-Dichloroethane	9.96		"	10.0		99.6	74.6-132		4.62	20.2	
1,2-Dichloropropane	8.13		"	10.0		81.3	76.9-129		6.08	20.7	
1,3,5-Trimethylbenzene	10.2		"	10.0		102	70.6-127		5.79	18.9	
1,3-Dichlorobenzene	9.94		"	10.0		99.4	77-124		1.40	19.2	
1,3-Dichloropropane	9.88		"	10.0		98.8	75.8-126		3.71	22.1	
1,4-Dichlorobenzene	9.78		"	10.0		97.8	76.6-125		2.52	18.6	
2,2-Dichloropropane	9.73		"	10.0		97.3	69-133		3.45	19.8	
2-Chlorotoluene	9.52		"	10.0		95.2	66.3-119		5.32	21.6	
2-Hexanone	10.6		"	10.0		106	70-130		8.91	30	
4-Chlorotoluene	9.84		"	10.0		98.4	69.2-127		3.89	19	
Acetone	8.19		"	10.0		81.9	70-130		3.24	30	
Benzene	10.2		"	10.0		102	76.2-129		4.20	19	
Bromobenzene	9.61		"	10.0		96.1	71.3-123		0.208	20.3	
Bromochloromethane	9.36		"	10.0		93.6	70.8-137		0.320	23.9	
Bromodichloromethane	9.01		"	10.0		90.1	79.7-134		0.884	21	
Bromoform	11.8		"	10.0		118	70.5-141		10.3	21.8	
Bromomethane	8.85		"	10.0		88.5	43.9-147		5.28	28.4	
Carbon tetrachloride	12.0		"	10.0		120	78.1-138		6.62	20.1	
Chlorobenzene	9.95		"	10.0		99.5	80.4-125		2.29	19.9	
Chloroethane	8.31		"	10.0		83.1	55.8-140		4.82	23.3	
Chloroform	9.87		"	10.0		98.7	76.6-133		2.70	20.3	
Chloromethane	7.72		"	10.0		77.2	48.8-115		6.27	24.5	
cis-1,2-Dichloroethylene	9.76		"	10.0		97.6	75.1-128		3.52	20.5	
cis-1,3-Dichloropropylene	9.65		"	10.0		96.5	74.5-128		1.44	19.9	
Dibromochloromethane	11.2		"	10.0		112	79.8-134		3.00	21.3	
Dibromomethane	8.94		"	10.0		89.4	79-130		1.92	22.4	
Dichlorodifluoromethane	7.64		"	10.0		76.4	47.1-101		6.34	23.9	
Ethyl Benzene	10.4		"	10.0		104	80.8-128		3.76	19.2	
Hexachlorobutadiene	9.27		"	10.0		92.7	64.8-128		6.87	20.6	
Isopropylbenzene	10.2		"	10.0		102	75.5-135		7.62	20	
Methyl tert-butyl ether (MTBE)	6.54		"	10.0		65.4	65.1-140		6.15	23.6	
Methylene chloride	9.18		"	10.0		91.8	61.3-120		3.85	20.4	
Naphthalene	11.3		"	10.0		113	62.3-148		9.71	27.1	
n-Butylbenzene	9.25		"	10.0		92.5	67.2-123		7.69	19.1	
n-Propylbenzene	10.1		"	10.0		101	70.5-127		7.56	23.4	
o-Xylene	10.1		"	10.0		101	75.9-122		0.789	19.3	



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	RPD	Limit	Flag
		Limit			Result					Limit			

Batch BG31069 - EPA 5030B

LCS Dup (BG31069-BSD1)

Prepared & Analyzed: 07/23/2013

p- & m- Xylenes	20.4		ug/L	20.0		102	77.7-127			3.85	18.6		
p-Isopropyltoluene	10.4		"	10.0		104	75.6-129			6.54	19.1		
sec-Butylbenzene	10.3		"	10.0		103	71.5-125			7.55	18.9		
Styrene	12.2		"	10.0		122	77.8-123			1.15	20.9		
tert-Butylbenzene	10.4		"	10.0		104	75.9-151			4.07	20.9		
Tetrachloroethylene	8.57		"	10.0		85.7	63.6-167			5.67	27.7		
Toluene	9.96		"	10.0		99.6	77-123			3.68	18.7		
trans-1,2-Dichloroethylene	9.28		"	10.0		92.8	76.3-139			6.87	19.5		
trans-1,3-Dichloropropylene	11.1		"	10.0		111	72.5-137			5.08	19.3		
Trichloroethylene	8.01		"	10.0		80.1	77.9-130			7.45	20.5		
Trichlorofluoromethane	9.11		"	10.0		91.1	57.4-133			5.65	21.4		
Vinyl Chloride	7.68		"	10.0		76.8	54.9-124			7.16	22.3		
<i>Surrogate: 1,2-Dichloroethane-d4</i>	<i>10.1</i>		<i>"</i>	<i>10.0</i>		<i>101</i>	<i>72.6-129</i>						
<i>Surrogate: p-Bromofluorobenzene</i>	<i>10.2</i>		<i>"</i>	<i>10.0</i>		<i>102</i>	<i>63.5-145</i>						
<i>Surrogate: Toluene-d8</i>	<i>9.60</i>		<i>"</i>	<i>10.0</i>		<i>96.0</i>	<i>81.2-127</i>						

Batch BG31099 - EPA 5030B

Blank (BG31099-BLK1)

Prepared & Analyzed: 07/24/2013

1,1,1,2-Tetrachloroethane	ND	0.50	ug/L										
1,1,1-Trichloroethane	ND	0.50	"										
1,1,2,2-Tetrachloroethane	ND	0.50	"										
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.50	"										
1,1,2-Trichloroethane	ND	0.50	"										
1,1-Dichloroethane	ND	0.50	"										
1,1-Dichloroethylene	ND	0.50	"										
1,1-Dichloropropylene	ND	0.50	"										
1,2,3-Trichlorobenzene	ND	2.0	"										
1,2,3-Trichloropropane	ND	0.50	"										
1,2,4-Trichlorobenzene	ND	2.0	"										
1,2,4-Trimethylbenzene	ND	0.50	"										
1,2-Dibromo-3-chloropropane	ND	2.0	"										
1,2-Dibromoethane	ND	0.50	"										
1,2-Dichlorobenzene	ND	0.50	"										
1,2-Dichloroethane	ND	0.50	"										
1,2-Dichloropropane	ND	0.50	"										
1,3,5-Trimethylbenzene	ND	0.50	"										
1,3-Dichlorobenzene	ND	0.50	"										
1,3-Dichloropropane	ND	0.50	"										
1,4-Dichlorobenzene	ND	0.50	"										
2,2-Dichloropropane	ND	0.50	"										
2-Chlorotoluene	ND	0.50	"										
2-Hexanone	ND	0.50	"										
4-Chlorotoluene	ND	0.50	"										
Acetone	ND	2.0	"										
Benzene	ND	0.50	"										
Bromobenzene	ND	0.50	"										
Bromochloromethane	ND	0.50	"										
Bromodichloromethane	ND	0.50	"										
Bromoform	ND	0.50	"										
Bromomethane	ND	0.50	"										
Carbon tetrachloride	ND	0.50	"										



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	RPD	Limit	Flag
		Limit								Limit			

Batch BG31099 - EPA 5030B

Blank (BG31099-BLK1)

Prepared & Analyzed: 07/24/2013

Chlorobenzene	ND	0.50	ug/L										
Chloroethane	ND	0.50	"										
Chloroform	ND	0.50	"										
Chloromethane	ND	0.50	"										
cis-1,2-Dichloroethylene	ND	0.50	"										
cis-1,3-Dichloropropylene	ND	0.50	"										
Dibromochloromethane	ND	0.50	"										
Dibromomethane	ND	0.50	"										
Dichlorodifluoromethane	ND	0.50	"										
Ethyl Benzene	ND	0.50	"										
Hexachlorobutadiene	ND	0.50	"										
Isopropylbenzene	ND	0.50	"										
Methyl tert-butyl ether (MTBE)	ND	0.50	"										
Methylene chloride	ND	2.0	"										
Naphthalene	ND	2.0	"										
n-Butylbenzene	ND	0.50	"										
n-Propylbenzene	ND	0.50	"										
o-Xylene	ND	0.50	"										
p- & m- Xylenes	ND	1.0	"										
p-Isopropyltoluene	ND	0.50	"										
sec-Butylbenzene	ND	0.50	"										
Styrene	ND	0.50	"										
tert-Butylbenzene	ND	0.50	"										
Tetrachloroethylene	ND	0.50	"										
Toluene	ND	0.50	"										
trans-1,2-Dichloroethylene	ND	0.50	"										
trans-1,3-Dichloropropylene	ND	0.50	"										
Trichloroethylene	ND	0.50	"										
Trichlorofluoromethane	ND	0.50	"										
Vinyl Chloride	ND	0.50	"										
Xylenes, Total	ND	1.5	"										
<hr/>													
<i>Surrogate: 1,2-Dichloroethane-d4</i>	9.77		"	10.0		97.7	72.6-129						
<i>Surrogate: p-Bromofluorobenzene</i>	9.98		"	10.0		99.8	63.5-145						
<i>Surrogate: Toluene-d8</i>	9.33		"	10.0		93.3	81.2-127						



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Spike	Source*	%REC	%REC	Limits	Flag	RPD	RPD	
		Limit								Units	Level

Batch BG31099 - EPA 5030B

LCS (BG31099-BS1)

Prepared & Analyzed: 07/24/2013

1,1,1,2-Tetrachloroethane	11.1		ug/L	10.0	111	82.3-130					
1,1,1-Trichloroethane	11.1		"	10.0	111	75.6-137					
1,1,2,2-Tetrachloroethane	10.3		"	10.0	103	71.3-131					
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.2		"	10.0	102	71.1-129					
1,1,2-Trichloroethane	8.95		"	10.0	89.5	74.5-129					
1,1-Dichloroethane	10.6		"	10.0	106	79.6-132					
1,1-Dichloroethylene	10.0		"	10.0	100	80.2-146					
1,1-Dichloropropylene	9.50		"	10.0	95.0	75-136					
1,2,3-Trichlorobenzene	10.2		"	10.0	102	66.1-136					
1,2,3-Trichloropropane	9.18		"	10.0	91.8	63-131					
1,2,4-Trichlorobenzene	10.2		"	10.0	102	70.6-136					
1,2,4-Trimethylbenzene	11.3		"	10.0	113	75.3-135					
1,2-Dibromo-3-chloropropane	9.85		"	10.0	98.5	58.9-140					
1,2-Dibromoethane	11.5		"	10.0	115	79-130					
1,2-Dichlorobenzene	9.74		"	10.0	97.4	76.1-122					
1,2-Dichloroethane	10.4		"	10.0	104	74.6-132					
1,2-Dichloropropane	9.35		"	10.0	93.5	76.9-129					
1,3,5-Trimethylbenzene	10.7		"	10.0	107	70.6-127					
1,3-Dichlorobenzene	10.1		"	10.0	101	77-124					
1,3-Dichloropropane	9.99		"	10.0	99.9	75.8-126					
1,4-Dichlorobenzene	9.89		"	10.0	98.9	76.6-125					
2,2-Dichloropropane	9.49		"	10.0	94.9	69-133					
2-Chlorotoluene	10.0		"	10.0	100	66.3-119					
2-Hexanone	9.27		"	10.0	92.7	70-130					
4-Chlorotoluene	10.3		"	10.0	103	69.2-127					
Acetone	9.36		"	10.0	93.6	70-130					
Benzene	10.8		"	10.0	108	76.2-129					
Bromobenzene	9.77		"	10.0	97.7	71.3-123					
Bromochloromethane	10.1		"	10.0	101	70.8-137					
Bromodichloromethane	9.97		"	10.0	99.7	79.7-134					
Bromoform	10.6		"	10.0	106	70.5-141					
Bromomethane	9.80		"	10.0	98.0	43.9-147					
Carbon tetrachloride	12.3		"	10.0	123	78.1-138					
Chlorobenzene	10.6		"	10.0	106	80.4-125					
Chloroethane	8.73		"	10.0	87.3	55.8-140					
Chloroform	10.4		"	10.0	104	76.6-133					
Chloromethane	7.77		"	10.0	77.7	48.8-115					
cis-1,2-Dichloroethylene	10.3		"	10.0	103	75.1-128					
cis-1,3-Dichloropropylene	11.0		"	10.0	110	74.5-128					
Dibromochloromethane	11.1		"	10.0	111	79.8-134					
Dibromomethane	9.58		"	10.0	95.8	79-130					
Dichlorodifluoromethane	6.07		"	10.0	60.7	47.1-101					
Ethyl Benzene	11.2		"	10.0	112	80.8-128					
Hexachlorobutadiene	9.98		"	10.0	99.8	64.8-128					
Isopropylbenzene	11.0		"	10.0	110	75.5-135					
Methyl tert-butyl ether (MTBE)	6.84		"	10.0	68.4	65.1-140					
Methylene chloride	10.1		"	10.0	101	61.3-120					
Naphthalene	10.9		"	10.0	109	62.3-148					
n-Butylbenzene	10.2		"	10.0	102	67.2-123					
n-Propylbenzene	10.9		"	10.0	109	70.5-127					
o-Xylene	10.7		"	10.0	107	75.9-122					



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31099 - EPA 5030B

LCS (BG31099-BS1)

Prepared & Analyzed: 07/24/2013

p- & m- Xylenes	22.4		ug/L	20.0		112	77.7-127				
p-Isopropyltoluene	10.9		"	10.0		109	75.6-129				
sec-Butylbenzene	11.0		"	10.0		110	71.5-125				
Styrene	12.4		"	10.0		124	77.8-123	High Bias			
tert-Butylbenzene	10.5		"	10.0		105	75.9-151				
Tetrachloroethylene	8.75		"	10.0		87.5	63.6-167				
Toluene	9.72		"	10.0		97.2	77-123				
trans-1,2-Dichloroethylene	9.96		"	10.0		99.6	76.3-139				
trans-1,3-Dichloropropylene	10.7		"	10.0		107	72.5-137				
Trichloroethylene	9.28		"	10.0		92.8	77.9-130				
Trichlorofluoromethane	9.42		"	10.0		94.2	57.4-133				
Vinyl Chloride	7.99		"	10.0		79.9	54.9-124				
Surrogate: 1,2-Dichloroethane-d4	9.97		"	10.0		99.7	72.6-129				
Surrogate: p-Bromofluorobenzene	10.2		"	10.0		102	63.5-145				
Surrogate: Toluene-d8	9.10		"	10.0		91.0	81.2-127				

LCS Dup (BG31099-BS1)

Prepared & Analyzed: 07/24/2013

1,1,1,2-Tetrachloroethane	10.2		ug/L	10.0		102	82.3-130		8.19	21.1	
1,1,1-Trichloroethane	10.6		"	10.0		106	75.6-137		4.41	19.7	
1,1,2,2-Tetrachloroethane	9.19		"	10.0		91.9	71.3-131		11.6	20.8	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.2		"	10.0		102	71.1-129		0.293	21.7	
1,1,2-Trichloroethane	7.99		"	10.0		79.9	74.5-129		11.3	20.3	
1,1-Dichloroethane	9.96		"	10.0		99.6	79.6-132		5.94	20.6	
1,1-Dichloroethylene	9.72		"	10.0		97.2	80.2-146		3.34	20	
1,1-Dichloropropylene	9.34		"	10.0		93.4	75-136		1.70	19.3	
1,2,3-Trichlorobenzene	9.51		"	10.0		95.1	66.1-136		6.51	21.6	
1,2,3-Trichloropropane	8.60		"	10.0		86.0	63-131		6.52	23.9	
1,2,4-Trichlorobenzene	9.59		"	10.0		95.9	70.6-136		6.26	21.7	
1,2,4-Trimethylbenzene	11.4		"	10.0		114	75.3-135		0.441	18.8	
1,2-Dibromo-3-chloropropane	9.55		"	10.0		95.5	58.9-140		3.09	27.7	
1,2-Dibromoethane	10.2		"	10.0		102	79-130		12.5	23	
1,2-Dichlorobenzene	9.59		"	10.0		95.9	76.1-122		1.55	19.8	
1,2-Dichloroethane	9.28		"	10.0		92.8	74.6-132		11.4	20.2	
1,2-Dichloropropane	8.85		"	10.0		88.5	76.9-129		5.49	20.7	
1,3,5-Trimethylbenzene	10.9		"	10.0		109	70.6-127		2.22	18.9	
1,3-Dichlorobenzene	10.0		"	10.0		100	77-124		0.893	19.2	
1,3-Dichloropropane	9.14		"	10.0		91.4	75.8-126		8.89	22.1	
1,4-Dichlorobenzene	9.85		"	10.0		98.5	76.6-125		0.405	18.6	
2,2-Dichloropropane	8.78		"	10.0		87.8	69-133		7.77	19.8	
2-Chlorotoluene	10.1		"	10.0		101	66.3-119		0.498	21.6	
2-Hexanone	8.11		"	10.0		81.1	70-130		13.3	30	
4-Chlorotoluene	10.4		"	10.0		104	69.2-127		0.581	19	
Acetone	8.75		"	10.0		87.5	70-130		6.74	30	
Benzene	10.3		"	10.0		103	76.2-129		4.27	19	
Bromobenzene	9.41		"	10.0		94.1	71.3-123		3.75	20.3	
Bromochloromethane	9.08		"	10.0		90.8	70.8-137		10.5	23.9	
Bromodichloromethane	9.47		"	10.0		94.7	79.7-134		5.14	21	
Bromoform	9.70		"	10.0		97.0	70.5-141		8.49	21.8	
Bromomethane	9.84		"	10.0		98.4	43.9-147		0.407	28.4	
Carbon tetrachloride	11.7		"	10.0		117	78.1-138		4.83	20.1	
Chlorobenzene	10.1		"	10.0		101	80.4-125		5.32	19.9	
Chloroethane	8.41		"	10.0		84.1	55.8-140		3.73	23.3	



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31099 - EPA 5030B

LCS Dup (BG31099-BSD1)

Prepared & Analyzed: 07/24/2013

Chloroform	9.90		ug/L	10.0		99.0	76.6-133		5.02	20.3	
Chloromethane	7.52		"	10.0		75.2	48.8-115		3.27	24.5	
cis-1,2-Dichloroethylene	9.77		"	10.0		97.7	75.1-128		5.48	20.5	
cis-1,3-Dichloropropylene	10.3		"	10.0		103	74.5-128		6.57	19.9	
Dibromochloromethane	9.91		"	10.0		99.1	79.8-134		11.6	21.3	
Dibromomethane	8.76		"	10.0		87.6	79-130		8.94	22.4	
Dichlorodifluoromethane	5.93		"	10.0		59.3	47.1-101		2.33	23.9	
Ethyl Benzene	11.1		"	10.0		111	80.8-128		1.53	19.2	
Hexachlorobutadiene	10.1		"	10.0		101	64.8-128		1.39	20.6	
Isopropylbenzene	11.2		"	10.0		112	75.5-135		2.07	20	
Methyl tert-butyl ether (MTBE)	6.50		"	10.0		65.0	65.1-140	Low Bias	5.10	23.6	
Methylene chloride	9.13		"	10.0		91.3	61.3-120		9.69	20.4	
Naphthalene	10.1		"	10.0		101	62.3-148		7.65	27.1	
n-Butylbenzene	10.4		"	10.0		104	67.2-123		1.95	19.1	
n-Propylbenzene	11.1		"	10.0		111	70.5-127		1.82	23.4	
o-Xylene	10.2		"	10.0		102	75.9-122		4.02	19.3	
p- & m- Xylenes	21.8		"	20.0		109	77.7-127		3.03	18.6	
p-Isopropyltoluene	11.2		"	10.0		112	75.6-129		2.80	19.1	
sec-Butylbenzene	11.3		"	10.0		113	71.5-125		2.96	18.9	
Styrene	11.7		"	10.0		117	77.8-123		6.04	20.9	
tert-Butylbenzene	10.8		"	10.0		108	75.9-151		2.62	20.9	
Tetrachloroethylene	8.65		"	10.0		86.5	63.6-167		1.15	27.7	
Toluene	9.56		"	10.0		95.6	77-123		1.66	18.7	
trans-1,2-Dichloroethylene	9.69		"	10.0		96.9	76.3-139		2.75	19.5	
trans-1,3-Dichloropropylene	9.40		"	10.0		94.0	72.5-137		13.2	19.3	
Trichloroethylene	9.01		"	10.0		90.1	77.9-130		2.95	20.5	
Trichlorofluoromethane	9.04		"	10.0		90.4	57.4-133		4.12	21.4	
Vinyl Chloride	7.77		"	10.0		77.7	54.9-124		2.79	22.3	
<i>Surrogate: 1,2-Dichloroethane-d4</i>	<i>9.43</i>		<i>"</i>	<i>10.0</i>		<i>94.3</i>	<i>72.6-129</i>				
<i>Surrogate: p-Bromofluorobenzene</i>	<i>10.3</i>		<i>"</i>	<i>10.0</i>		<i>103</i>	<i>63.5-145</i>				
<i>Surrogate: Toluene-d8</i>	<i>9.21</i>		<i>"</i>	<i>10.0</i>		<i>92.1</i>	<i>81.2-127</i>				



Metals by EPA 6000 Series Methods - Quality Control Data
York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG31022 - EPA 3010A											
Blank (BG31022-BLK1)											
Iron - Dissolved	ND	0.0200	mg/L						Prepared & Analyzed: 07/23/2013		
Duplicate (BG31022-DUP1)											
*Source sample: 13G0664-01 (WQ071613:1110NP2-10)											
Iron - Dissolved	0.0621	0.0200	mg/L		0.0613				1.30	20	
Matrix Spike (BG31022-MS1)											
*Source sample: 13G0664-01 (WQ071613:1110NP2-10)											
Iron - Dissolved	1.07	0.0200	mg/L	1.00	0.0613	101	75-125				
Reference (BG31022-SRM1)											
Iron - Dissolved	1.33	0.0200	mg/L	1.39		95.7	88.4-113				



Metals by EPA 200 Series Methods - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG31025 - EPA 3010A											
Blank (BG31025-BLK1)								Prepared & Analyzed: 07/23/2013			
Iron	ND	0.0200	mg/L								
Duplicate (BG31025-DUP1)								*Source sample: 13G0664-01 (WQ071613:1110NP2-10) Prepared & Analyzed: 07/23/2013			
Iron	2.16	0.0200	mg/L		2.23				2.83	20	
Matrix Spike (BG31025-MS1)								*Source sample: 13G0664-01 (WQ071613:1110NP2-10) Prepared & Analyzed: 07/23/2013			
Iron	3.19	0.0200	mg/L	1.00	2.23	96.3	75-125				
Reference (BG31025-SRM1)								Prepared & Analyzed: 07/23/2013			
Iron	1.30	0.0200	mg/L	1.39		93.2	88.4-113				



Miscellaneous Physical/Conventional Chemistry Parameters - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31010 - % Solids Prep

Blank (BG31010-BLK1)

Prepared & Analyzed: 07/22/2013

Total Dissolved Solids	ND	10.0	mg/L								
------------------------	----	------	------	--	--	--	--	--	--	--	--



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
13G0662-01	WQ071613:1100NP2-6	250mL Plastic Cool to 4° C
13G0662-02	WQ071613:1105NP2-7	250mL Plastic Cool to 4° C
13G0664-01	WQ071613:1110NP2-10	250mL Plastic Cool to 4° C

Notes and Definitions

QL-02	This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
M-LSRD	Original sample conc <50 X reporting limit.
J	Detected below the Reporting Limit but greater than or equal to the Method Detection Limit (MDL/LOD) or in the case of a TIC, the result is an estimated concentration.
ND	Analyte NOT DETECTED at the stated Reporting Limit (RL) or above.
RL	REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
MDL	METHOD DETECTION LIMIT - the minimum concentration that can be measured and reported with a 99% confidence that the concentration is greater than zero. If requested or required, a value reported below the RL and above the MDL is considered estimated and is noted with a "J" flag.
NR	Not reported
RPD	Relative Percent Difference
Wet	The data has been reported on an as-received (wet weight) basis
Low Bias	Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
High Bias	High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
Non-Dir.	Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the MDL, with values between the MDL and the RL being "J" flagged as estimated results.

Field Chain-of-Custody Record

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 135062

YOUR Information Company: <u>LB6</u> Address: <u>4 Research Dr. Suite 301</u> <u>Shelton, CT 06484</u> Phone No. <u>203-929-8555</u> Contact Person: <u>Tunde Sandor</u> E-Mail Address: <u>TSandor@LB6T.com</u>		Report To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____		Invoice To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____		YOUR Project ID Purchase Order No. <u>NAB5A6</u> Samples from: CT <input type="checkbox"/> NY <input checked="" type="checkbox"/> NJ <input type="checkbox"/>		Turn-Around Time RUSH - Same Day <input type="checkbox"/> RUSH - Next Day <input type="checkbox"/> RUSH - Two Day <input type="checkbox"/> RUSH - Three Day <input type="checkbox"/> RUSH - Four Day <input type="checkbox"/> Standard (5-7 Days) <input checked="" type="checkbox"/>		Report Type Summary Report <input checked="" type="checkbox"/> <u>pdf</u> Summary w/ QA summary <input checked="" type="checkbox"/> <u>pdf</u> CT RCP Package _____ CIRCP DQADUE Pkg _____ NY ASP A Package _____ NY ASP B Package <u>NY 2 TO ONLY</u> <u>pdf</u> NJDEP Red. Deliv. _____ Electronic Data Deliverables (EDD) _____	
---	--	---	--	--	--	--	--	--	--	---	--

Print Clearly and Legibly. All Information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.

Matrix Codes	Volatiles	Semi-Vols. Perfluorinated	Metals	Misc. Org.	Full Lists	Misc.
S - soil Other - specify (oil, etc.) WW - wastewater GW - groundwater DW - drinking water Air-A - ambient air Air-SV - soil vapor	R260 fill 624 Site Spec Nassau Co. Suffolk Co. Ketones Oxygenates TCL list TAGM list TCLP list Arom. only 502.2 Halog. only NIDEP list App. IX list SELP or TCLP 8021B list	8270 & 625 STARS list BN Only Acids Only PAH list TAGM list Site Spec. SELP or TCLP TCL list TCLP list TCLP Herb Chlordane TCLP BNA 608 PCB SELP or TCLP	RCKA8 PP13 list TAL CT15 list TAGM list NIDEP list Total Dissolved SELP or TCLP As TICs LIST Below Halogen	TPH GRO TPH DRO CT ETPH NY 310-13 TPH 1664 Air TO14A Air TO15 AE STARS AE VPH As TICs Methane Heptan	Phl. Poll. TCL Organics TAL MeCP Full TCLP Full App IX Pat. 300-Residue Pat. 300-Residue Pat. 300-Residue Pat. 300-Residue NYDEP Sewer NYSDCE Sewer TAGM	Corrosivity Reactivity Ignitability Flash Point Sieve Anal. Hexachlorobiphenyls TOX BTU/0.0 Aromatic Tox ITOC Asbestos Silica

Sample Identification	Date Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below	Container Description(s)
W2021613-1105NP2-6	7/16/13 1105	GW	Fe by EPA 200.7/Fe, Dissolved by EPA 6010 (SW 846-6108) / VOCs, P260 List (EPA SW 845-8260b) plus Fecon 113	3v 2P
W2021613-1105NP2-7	7/16/13 1105	GW	Fe by EPA 200.7/Fe, Dissolved by EPA 6010 (SW 846-6108) / VOCs, P260 List (EPA SW 845-8260b) plus Fecon 113	3v 2P
W2021613-1105NP2-10	7/16/13 1105	GW	Fe by EPA 200.7/Fe, Dissolved by EPA 6010 (SW 846-6108) / VOCs, P260 List (EPA SW 845-8260b) plus Fecon 113	3v 3P

Comments

Preservation Check those Applicable
 Frozen HCl MeOH H₂O NaOH
 In Ac Ascorbic Acid Other

Special Instructions
 Field Filtered
 Lab to Filter

Samples Relinquished By [Signature] Date/Time 7/18/13 1424
 Samples Received By Trace Date/Time 7-18-13 1700

Samples Relinquished By _____ Date/Time _____
 Samples Received in L.A.B. by _____ Date/Time _____

Temperature on Receipt 3-8 °C

YORK

ANALYTICAL LABORATORIES, INC.
120 RESEARCH DR. STRATFORD, CT 06615
(203) 325-1371 FAX (203) 357-0166

Field Chain-of-Custody Record

Page 1 of 1

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 1360664


YOUR Information Company: <u>LBG</u> Address: <u>4 Research Dr. Suite 301 Shelton, CT 06484</u> Phone No. <u>203-329-8555</u> Contact Person: <u>Tunde Sandoz</u> E-Mail Address: <u>TSandoz@LABCT.com</u>		Report To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____		Invoice To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____		YOUR Project ID <u>Apwe Industries.</u> Purchase Order No. <u>HA05A6.</u>		Turn-Around Time RUSH - Same Day <input type="checkbox"/> RUSH - Next Day <input type="checkbox"/> RUSH - Two Day <input type="checkbox"/> RUSH - Three Day <input type="checkbox"/> RUSH - Four Day <input type="checkbox"/> Standard (5-7 Days) <input checked="" type="checkbox"/>		Report Type Summary Report <u>X</u> pdf Summary w/ QA Summary <u>X</u> pdf CT RCP Package CTRCP DQADUUE Pkg NY ASP A Package NY ASP B Package <u>NP2-10 only</u> pdf. NUDEP Red. Deliv. Electronic Data Deliverables (EDD)	
--	--	---	--	--	--	--	--	--	--	---	--

Volatiles: 8260 full TICs
 Semi-Vols: 8082 PCB
 Metals: TPH GRO, TPH DRO, CT EPH, NY 310-13, TAGM list, NYDEP list, Air TO15, Air TO15, Air STARS, Air VPH, Air TICs, Methane, Helium
 Other: 8270 or 625, STARS list, BN Only, Acids Only, PAH list, App. IX, Site Spec, CT RCP list, TCLP list, TCLP Herb, Chloroform, 608 Pest, STP or TCLP, 608 PCB
 Matrix Codes: S - soil, Other - specify (oil, etc), WW - wastewater, GW - groundwater, DW - drinking water, Air-A - ambient air, Air-SV - soil vapor

Samples Collected/Authorized By (Signature) _____
 Name (printed) STEPHEN HAWAT

Sample Identification	Date Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below	Container Description(s)
WR071613: 1100NP2-6	7/16/13: 1100	GW	Fe by EPA 800.71 Fe, Dissolved by EPA 8010 (SW-846-8010B) VOCs, P-100 list (EPA SW-846-8010B) plus from 113	3V 2P
WR071613: 1105NP2-7	7/16/13: 1105	GW	Fe by EPA 800.71 Fe, Dissolved by EPA 8010 (SW-846-8010B) VOCs, P-100 list (EPA SW-846-8010B) plus from 113 / 105 (9H 25405)	3V 2P
WR071613: 1106NP2-10	7/16/13: 1106	GW		3V 3P

Preservation: MeOH, HCl, H₂SO₄, HNO₃, Other
 Check those Applicable: Fibrin, Ascorbic Acid
 Instructions: Field Filtered, Lab to Filter
 Comments: TC Note 7/18/13 1424
 Samples Relinquished By: Grace Date/Time: 7-18-13 1700
 Samples Relinquished By: _____ Date/Time: _____
 Temperature on Receipt: 3.8 °C



Technical Report

prepared for:

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301

Shelton CT, 06484

Attention: Tunde Komuves-Sandor

Report Date: 08/02/2013

Client Project ID: O&M Sag Harbor (Rowe Industries Site)

York Project (SDG) No.: 13G0916

CT Cert. No. PH-0723

New Jersey Cert. No. CT-005



New York Cert. No. 10854

PA Cert. No. 68-04440

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on July 26, 2013 and listed below. The project was identified as your project: **O&M Sag Harbor (Rowe Industries Site)**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Notes section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the attachment to this report, and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
13G0916-01	WQ072513:1120NP2-10	Water	07/25/2013	07/26/2013
13G0919-01	WQ072513:1100NP2-6	Water	07/25/2013	07/26/2013
13G0919-02	WQ072513:1110NP2-7	Water	07/25/2013	07/26/2013

General Notes for York Project (SDG) No.: 13G0916

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All samples were received in proper condition for analysis with proper documentation, unless otherwise noted.
6. All analyses conducted met method or Laboratory SOP requirements. See the Qualifiers and/or Narrative sections for further information.
7. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
8. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 08/02/2013

YORK



Sample Information

Client Sample ID: WQ072513:1120NP2-10

York Sample ID: 13G0916-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0916

O&M Sag Harbor (Rowe Industries Site)

Water

July 25, 2013 3:00 pm

07/26/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
67-64-1	Acetone	20		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS



Sample Information

Client Sample ID: WQ072513:1120NP2-10

York Sample ID: 13G0916-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0916

O&M Sag Harbor (Rowe Industries Site)

Water

July 25, 2013 3:00 pm

07/26/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
127-18-4	Tetrachloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 01:22	SS



Sample Information

Client Sample ID: WQ072513:1120NP2-10

York Sample ID: 13G0916-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0916

O&M Sag Harbor (Rowe Industries Site)

Water

July 25, 2013 3:00 pm

07/26/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
Surrogate Recoveries		Result			Acceptance Range						
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	101 %			72.6	129					
460-00-4	Surrogate: p-Bromofluorobenzene	94.3 %			63.5	145					
2037-26-5	Surrogate: Toluene-d8	110 %			81.2	127					

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	ND		mg/L	0.0200	0.0200	1	EPA SW846-6010B	07/31/2013 15:02	07/31/2013 17:45	MW

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	42.8		mg/L	0.0146	0.0200	1	EPA 200.7	07/31/2013 15:07	07/31/2013 19:35	MW

Total Dissolved Solids

Log-in Notes:

Sample Notes:

Sample Prepared by Method: % Solids Prep

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Total Dissolved Solids	125		mg/L	10.0	10.0	1	SM 2540C	08/01/2013 09:22	08/01/2013 15:28	BGS

Sample Information

Client Sample ID: WQ072513:1100NP2-6

York Sample ID: 13G0919-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0919

O&M Sag Harbor (Rowe Industries Site)

Water

July 25, 2013 3:00 pm

07/26/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
71-55-6	1,1,1-Trichloroethane	0.38	J	ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS



Sample Information

Client Sample ID: WQ072513:1100NP2-6

York Sample ID: 13G0919-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0919

O&M Sag Harbor (Rowe Industries Site)

Water

July 25, 2013 3:00 pm

07/26/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
67-64-1	Acetone	16		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
156-59-2	cis-1,2-Dichloroethylene	0.25	J	ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS



Sample Information

Client Sample ID: WQ072513:1100NP2-6

York Sample ID: 13G0919-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0919

O&M Sag Harbor (Rowe Industries Site)

Water

July 25, 2013 3:00 pm

07/26/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
127-18-4	Tetrachloroethylene	0.98		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 02:41	SS
	Surrogate Recoveries	Result			Acceptance Range						
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	114 %			72.6-129						
460-00-4	Surrogate: p-Bromofluorobenzene	96.6 %			63.5-145						
2037-26-5	Surrogate: Toluene-d8	108 %			81.2-127						



Sample Information

Client Sample ID: WQ072513:1100NP2-6

York Sample ID: 13G0919-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0919

O&M Sag Harbor (Rowe Industries Site)

Water

July 25, 2013 3:00 pm

07/26/2013

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	ND		mg/L	0.0200	0.0200	1	EPA SW846-6010B	07/31/2013 15:02	07/31/2013 18:02	MW

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	25.3		mg/L	0.0146	0.0200	1	EPA 200.7	07/31/2013 15:07	07/31/2013 19:40	MW

Sample Information

Client Sample ID: WQ072513:1110NP2-7

York Sample ID: 13G0919-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0919

O&M Sag Harbor (Rowe Industries Site)

Water

July 25, 2013 3:00 pm

07/26/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS



Sample Information

Client Sample ID: WQ072513:1110NP2-7

York Sample ID: 13G0919-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0919

O&M Sag Harbor (Rowe Industries Site)

Water

July 25, 2013 3:00 pm

07/26/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
67-64-1	Acetone	5.2		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS



Sample Information

Client Sample ID: WQ072513:1110NP2-7

York Sample ID: 13G0919-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0919

O&M Sag Harbor (Rowe Industries Site)

Water

July 25, 2013 3:00 pm

07/26/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
127-18-4	Tetrachloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 03:20	SS
Surrogate Recoveries		Result			Acceptance Range						
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	110 %			72.6-129						
460-00-4	Surrogate: p-Bromofluorobenzene	93.5 %			63.5-145						
2037-26-5	Surrogate: Toluene-d8	108 %			81.2-127						

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	0.0238		mg/L	0.0200	0.0200	1	EPA SW846-6010B	07/31/2013 15:02	07/31/2013 18:07	MW

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	36.2		mg/L	0.0146	0.0200	1	EPA 200.7	07/31/2013 15:07	07/31/2013 19:45	MW



Analytical Batch Summary

Batch ID: BG31324

Preparation Method: EPA 5030B

Prepared By: KH

YORK Sample ID	Client Sample ID	Preparation Date
13G0916-01	WQ072513:1120NP2-10	07/29/13
13G0919-01	WQ072513:1100NP2-6	07/29/13
13G0919-02	WQ072513:1110NP2-7	07/29/13
BG31324-BLK1	Blank	07/29/13
BG31324-BS1	LCS	07/29/13
BG31324-BSD1	LCS Dup	07/29/13

Batch ID: BG31486

Preparation Method: EPA 3010A

Prepared By: MW

YORK Sample ID	Client Sample ID	Preparation Date
13G0916-01	WQ072513:1120NP2-10	07/31/13
13G0919-01	WQ072513:1100NP2-6	07/31/13
13G0919-02	WQ072513:1110NP2-7	07/31/13
BG31486-BLK1	Blank	07/31/13
BG31486-DUP1	Duplicate	07/31/13
BG31486-MS1	Matrix Spike	07/31/13
BG31486-SRM1	Reference	07/31/13

Batch ID: BG31487

Preparation Method: EPA 3010A

Prepared By: MW

YORK Sample ID	Client Sample ID	Preparation Date
13G0916-01	WQ072513:1120NP2-10	07/31/13
13G0919-01	WQ072513:1100NP2-6	07/31/13
13G0919-02	WQ072513:1110NP2-7	07/31/13
BG31487-BLK1	Blank	07/31/13
BG31487-SRM1	Reference	07/31/13

Batch ID: BH30022

Preparation Method: % Solids Prep

Prepared By: BGS

YORK Sample ID	Client Sample ID	Preparation Date
13G0916-01	WQ072513:1120NP2-10	08/01/13
BH30022-BLK1	Blank	08/01/13



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31324 - EPA 5030B

Blank (BG31324-BLK1)

Prepared & Analyzed: 07/29/2013

1,1,1,2-Tetrachloroethane	ND	0.50	ug/L								
1,1,1-Trichloroethane	ND	0.50	"								
1,1,2,2-Tetrachloroethane	ND	0.50	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.50	"								
1,1,2-Trichloroethane	ND	0.50	"								
1,1-Dichloroethane	ND	0.50	"								
1,1-Dichloroethylene	ND	0.50	"								
1,1-Dichloropropylene	ND	0.50	"								
1,2,3-Trichlorobenzene	ND	2.0	"								
1,2,3-Trichloropropane	ND	0.50	"								
1,2,4-Trichlorobenzene	ND	2.0	"								
1,2,4-Trimethylbenzene	ND	0.50	"								
1,2-Dibromo-3-chloropropane	ND	2.0	"								
1,2-Dibromoethane	ND	0.50	"								
1,2-Dichlorobenzene	ND	0.50	"								
1,2-Dichloroethane	ND	0.50	"								
1,2-Dichloropropane	ND	0.50	"								
1,3,5-Trimethylbenzene	ND	0.50	"								
1,3-Dichlorobenzene	ND	0.50	"								
1,3-Dichloropropane	ND	0.50	"								
1,4-Dichlorobenzene	ND	0.50	"								
2,2-Dichloropropane	ND	0.50	"								
2-Chlorotoluene	ND	0.50	"								
2-Hexanone	ND	0.50	"								
4-Chlorotoluene	ND	0.50	"								
Acetone	ND	2.0	"								
Benzene	ND	0.50	"								
Bromobenzene	ND	0.50	"								
Bromochloromethane	ND	0.50	"								
Bromodichloromethane	ND	0.50	"								
Bromoform	ND	0.50	"								
Bromomethane	ND	0.50	"								
Carbon tetrachloride	ND	0.50	"								
Chlorobenzene	ND	0.50	"								
Chloroethane	ND	0.50	"								
Chloroform	ND	0.50	"								
Chloromethane	ND	0.50	"								
cis-1,2-Dichloroethylene	ND	0.50	"								
cis-1,3-Dichloropropylene	ND	0.50	"								
Dibromochloromethane	ND	0.50	"								
Dibromomethane	ND	0.50	"								
Dichlorodifluoromethane	ND	0.50	"								
Ethyl Benzene	ND	0.50	"								
Hexachlorobutadiene	ND	0.50	"								
Isopropylbenzene	ND	0.50	"								
Methyl tert-butyl ether (MTBE)	ND	0.50	"								
Methylene chloride	ND	2.0	"								
Naphthalene	ND	2.0	"								
n-Butylbenzene	ND	0.50	"								
n-Propylbenzene	ND	0.50	"								
o-Xylene	ND	0.50	"								



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31324 - EPA 5030B

Blank (BG31324-BLK1)

Prepared & Analyzed: 07/29/2013

p- & m- Xylenes	ND	1.0	ug/L								
p-Isopropyltoluene	ND	0.50	"								
sec-Butylbenzene	ND	0.50	"								
Styrene	ND	0.50	"								
tert-Butylbenzene	ND	0.50	"								
Tetrachloroethylene	ND	0.50	"								
Toluene	ND	0.50	"								
trans-1,2-Dichloroethylene	ND	0.50	"								
trans-1,3-Dichloropropylene	ND	0.50	"								
Trichloroethylene	ND	0.50	"								
Trichlorofluoromethane	ND	0.50	"								
Vinyl Chloride	ND	0.50	"								
Xylenes, Total	ND	1.5	"								

Surrogate: 1,2-Dichloroethane-d4

10.9 " 10.0 109 72.6-129

Surrogate: p-Bromofluorobenzene

9.32 " 10.0 93.2 63.5-145

Surrogate: Toluene-d8

10.6 " 10.0 106 81.2-127

LCS (BG31324-BS1)

Prepared & Analyzed: 07/29/2013

1,1,1,2-Tetrachloroethane	10.8		ug/L	10.0		108	82.3-130				
1,1,1-Trichloroethane	10.8		"	10.0		108	75.6-137				
1,1,2,2-Tetrachloroethane	10.2		"	10.0		102	71.3-131				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.0		"	10.0		100	71.1-129				
1,1,2-Trichloroethane	10.5		"	10.0		105	74.5-129				
1,1-Dichloroethane	9.93		"	10.0		99.3	79.6-132				
1,1-Dichloroethylene	9.27		"	10.0		92.7	80.2-146				
1,1-Dichloropropylene	9.50		"	10.0		95.0	75-136				
1,2,3-Trichlorobenzene	9.58		"	10.0		95.8	66.1-136				
1,2,3-Trichloropropane	10.1		"	10.0		101	63-131				
1,2,4-Trichlorobenzene	9.66		"	10.0		96.6	70.6-136				
1,2,4-Trimethylbenzene	10.0		"	10.0		100	75.3-135				
1,2-Dibromo-3-chloropropane	10.5		"	10.0		105	58.9-140				
1,2-Dibromoethane	11.4		"	10.0		114	79-130				
1,2-Dichlorobenzene	9.62		"	10.0		96.2	76.1-122				
1,2-Dichloroethane	9.88		"	10.0		98.8	74.6-132				
1,2-Dichloropropane	9.17		"	10.0		91.7	76.9-129				
1,3,5-Trimethylbenzene	9.97		"	10.0		99.7	70.6-127				
1,3-Dichlorobenzene	9.87		"	10.0		98.7	77-124				
1,3-Dichloropropane	10.5		"	10.0		105	75.8-126				
1,4-Dichlorobenzene	9.89		"	10.0		98.9	76.6-125				
2,2-Dichloropropane	11.0		"	10.0		110	69-133				
2-Chlorotoluene	9.60		"	10.0		96.0	66.3-119				
2-Hexanone	10.7		"	10.0		107	70-130				
4-Chlorotoluene	9.90		"	10.0		99.0	69.2-127				
Acetone	9.04		"	10.0		90.4	70-130				
Benzene	9.64		"	10.0		96.4	76.2-129				
Bromobenzene	9.88		"	10.0		98.8	71.3-123				
Bromochloromethane	9.80		"	10.0		98.0	70.8-137				
Bromodichloromethane	10.1		"	10.0		101	79.7-134				
Bromoform	11.8		"	10.0		118	70.5-141				
Bromomethane	7.90		"	10.0		79.0	43.9-147				
Carbon tetrachloride	12.0		"	10.0		120	78.1-138				
Chlorobenzene	9.73		"	10.0		97.3	80.4-125				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike Level	Source*	%REC	%REC Limits	Flag	RPD	RPD	Flag
		Limit			Result					Limit	

Batch BG31324 - EPA 5030B

LCS (BG31324-BS1)

Prepared & Analyzed: 07/29/2013

Chloroethane	9.00		ug/L	10.0		90.0	55.8-140				
Chloroform	10.1		"	10.0		101	76.6-133				
Chloromethane	7.86		"	10.0		78.6	48.8-115				
cis-1,2-Dichloroethylene	9.69		"	10.0		96.9	75.1-128				
cis-1,3-Dichloropropylene	10.5		"	10.0		105	74.5-128				
Dibromochloromethane	12.5		"	10.0		125	79.8-134				
Dibromomethane	9.76		"	10.0		97.6	79-130				
Dichlorodifluoromethane	7.83		"	10.0		78.3	47.1-101				
Ethyl Benzene	10.2		"	10.0		102	80.8-128				
Hexachlorobutadiene	10.1		"	10.0		101	64.8-128				
Isopropylbenzene	10.0		"	10.0		100	75.5-135				
Methyl tert-butyl ether (MTBE)	9.76		"	10.0		97.6	65.1-140				
Methylene chloride	9.30		"	10.0		93.0	61.3-120				
Naphthalene	9.89		"	10.0		98.9	62.3-148				
n-Butylbenzene	9.58		"	10.0		95.8	67.2-123				
n-Propylbenzene	9.84		"	10.0		98.4	70.5-127				
o-Xylene	9.58		"	10.0		95.8	75.9-122				
p- & m- Xylenes	19.8		"	20.0		99.2	77.7-127				
p-Isopropyltoluene	10.2		"	10.0		102	75.6-129				
sec-Butylbenzene	10.2		"	10.0		102	71.5-125				
Styrene	10.2		"	10.0		102	77.8-123				
tert-Butylbenzene	10.4		"	10.0		104	75.9-151				
Tetrachloroethylene	9.67		"	10.0		96.7	63.6-167				
Toluene	10.4		"	10.0		104	77-123				
trans-1,2-Dichloroethylene	9.45		"	10.0		94.5	76.3-139				
trans-1,3-Dichloropropylene	12.1		"	10.0		121	72.5-137				
Trichloroethylene	9.36		"	10.0		93.6	77.9-130				
Trichlorofluoromethane	10.0		"	10.0		100	57.4-133				
Vinyl Chloride	8.66		"	10.0		86.6	54.9-124				
Surrogate: 1,2-Dichloroethane-d4	10.0		"	10.0		100	72.6-129				
Surrogate: p-Bromofluorobenzene	10.3		"	10.0		103	63.5-145				
Surrogate: Toluene-d8	9.95		"	10.0		99.5	81.2-127				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG31324 - EPA 5030B											
LCS Dup (BG31324-BS1)											
Prepared & Analyzed: 07/29/2013											
1,1,1,2-Tetrachloroethane	10.8		ug/L	10.0		108	82.3-130		0.647	21.1	
1,1,1-Trichloroethane	11.0		"	10.0		110	75.6-137		2.20	19.7	
1,1,2,2-Tetrachloroethane	9.97		"	10.0		99.7	71.3-131		1.79	20.8	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	9.82		"	10.0		98.2	71.1-129		2.02	21.7	
1,1,2-Trichloroethane	10.7		"	10.0		107	74.5-129		1.51	20.3	
1,1-Dichloroethane	9.83		"	10.0		98.3	79.6-132		1.01	20.6	
1,1-Dichloroethylene	9.29		"	10.0		92.9	80.2-146		0.216	20	
1,1-Dichloropropylene	9.43		"	10.0		94.3	75-136		0.740	19.3	
1,2,3-Trichlorobenzene	9.95		"	10.0		99.5	66.1-136		3.79	21.6	
1,2,3-Trichloropropane	10.3		"	10.0		103	63-131		2.07	23.9	
1,2,4-Trichlorobenzene	9.85		"	10.0		98.5	70.6-136		1.95	21.7	
1,2,4-Trimethylbenzene	9.65		"	10.0		96.5	75.3-135		3.76	18.8	
1,2-Dibromo-3-chloropropane	9.96		"	10.0		99.6	58.9-140		5.09	27.7	
1,2-Dibromoethane	11.5		"	10.0		115	79-130		0.523	23	
1,2-Dichlorobenzene	9.43		"	10.0		94.3	76.1-122		1.99	19.8	
1,2-Dichloroethane	10.2		"	10.0		102	74.6-132		3.19	20.2	
1,2-Dichloropropane	10.8		"	10.0		108	76.9-129		16.3	20.7	
1,3,5-Trimethylbenzene	9.62		"	10.0		96.2	70.6-127		3.57	18.9	
1,3-Dichlorobenzene	9.75		"	10.0		97.5	77-124		1.22	19.2	
1,3-Dichloropropane	10.5		"	10.0		105	75.8-126		0.285	22.1	
1,4-Dichlorobenzene	9.73		"	10.0		97.3	76.6-125		1.63	18.6	
2,2-Dichloropropane	10.7		"	10.0		107	69-133		2.30	19.8	
2-Chlorotoluene	9.24		"	10.0		92.4	66.3-119		3.82	21.6	
2-Hexanone	10.9		"	10.0		109	70-130		2.59	30	
4-Chlorotoluene	9.51		"	10.0		95.1	69.2-127		4.02	19	
Acetone	9.42		"	10.0		94.2	70-130		4.12	30	
Benzene	9.70		"	10.0		97.0	76.2-129		0.620	19	
Bromobenzene	9.62		"	10.0		96.2	71.3-123		2.67	20.3	
Bromochloromethane	9.94		"	10.0		99.4	70.8-137		1.42	23.9	
Bromodichloromethane	11.3		"	10.0		113	79.7-134		10.6	21	
Bromoform	11.9		"	10.0		119	70.5-141		1.35	21.8	
Bromomethane	8.12		"	10.0		81.2	43.9-147		2.75	28.4	
Carbon tetrachloride	12.2		"	10.0		122	78.1-138		1.74	20.1	
Chlorobenzene	9.59		"	10.0		95.9	80.4-125		1.45	19.9	
Chloroethane	8.42		"	10.0		84.2	55.8-140		6.66	23.3	
Chloroform	10.2		"	10.0		102	76.6-133		0.985	20.3	
Chloromethane	7.66		"	10.0		76.6	48.8-115		2.58	24.5	
cis-1,2-Dichloroethylene	9.57		"	10.0		95.7	75.1-128		1.25	20.5	
cis-1,3-Dichloropropylene	12.4		"	10.0		124	74.5-128		16.2	19.9	
Dibromochloromethane	13.5		"	10.0		135	79.8-134	High Bias	7.40	21.3	
Dibromomethane	11.2		"	10.0		112	79-130		13.8	22.4	
Dichlorodifluoromethane	7.97		"	10.0		79.7	47.1-101		1.77	23.9	
Ethyl Benzene	9.94		"	10.0		99.4	80.8-128		2.78	19.2	
Hexachlorobutadiene	9.94		"	10.0		99.4	64.8-128		1.70	20.6	
Isopropylbenzene	9.58		"	10.0		95.8	75.5-135		4.39	20	
Methyl tert-butyl ether (MTBE)	11.0		"	10.0		110	65.1-140		11.9	23.6	
Methylene chloride	9.37		"	10.0		93.7	61.3-120		0.750	20.4	
Naphthalene	10.5		"	10.0		105	62.3-148		6.08	27.1	
n-Butylbenzene	9.27		"	10.0		92.7	67.2-123		3.29	19.1	
n-Propylbenzene	9.41		"	10.0		94.1	70.5-127		4.47	23.4	
o-Xylene	9.47		"	10.0		94.7	75.9-122		1.15	19.3	



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31324 - EPA 5030B

LCS Dup (BG31324-BSD1)

Prepared & Analyzed: 07/29/2013


p- & m- Xylenes	19.4		ug/L	20.0		97.0	77.7-127		2.34	18.6	
p-Isopropyltoluene	9.85		"	10.0		98.5	75.6-129		3.59	19.1	
sec-Butylbenzene	9.86		"	10.0		98.6	71.5-125		3.78	18.9	
Styrene	10.1		"	10.0		101	77.8-123		1.58	20.9	
tert-Butylbenzene	9.90		"	10.0		99.0	75.9-151		5.12	20.9	
Tetrachloroethylene	9.32		"	10.0		93.2	63.6-167		3.69	27.7	
Toluene	10.5		"	10.0		105	77-123		0.954	18.7	
trans-1,2-Dichloroethylene	9.33		"	10.0		93.3	76.3-139		1.28	19.5	
trans-1,3-Dichloropropylene	12.5		"	10.0		125	72.5-137		3.42	19.3	
Trichloroethylene	8.82		"	10.0		88.2	77.9-130		5.94	20.5	
Trichlorofluoromethane	10.2		"	10.0		102	57.4-133		1.58	21.4	
Vinyl Chloride	8.45		"	10.0		84.5	54.9-124		2.45	22.3	
<i>Surrogate: 1,2-Dichloroethane-d4</i>	<i>10.4</i>		<i>"</i>	<i>10.0</i>		<i>104</i>	<i>72.6-129</i>				
<i>Surrogate: p-Bromofluorobenzene</i>	<i>10.0</i>		<i>"</i>	<i>10.0</i>		<i>100</i>	<i>63.5-145</i>				
<i>Surrogate: Toluene-d8</i>	<i>11.0</i>		<i>"</i>	<i>10.0</i>		<i>110</i>	<i>81.2-127</i>				



Metals by EPA 6000 Series Methods - Quality Control Data

York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG31486 - EPA 3010A											
Blank (BG31486-BLK1)										Prepared & Analyzed: 07/31/2013	
Iron - Dissolved	ND	0.0200	mg/L								
Duplicate (BG31486-DUP1)										*Source sample: 13G0916-01 (WQ072513:1120NP2-10) Prepared & Analyzed: 07/31/2013	
Iron - Dissolved	ND	0.0200	mg/L		ND						20
Matrix Spike (BG31486-MS1)										*Source sample: 13G0916-01 (WQ072513:1120NP2-10) Prepared & Analyzed: 07/31/2013	
Iron - Dissolved	1.07	0.0200	mg/L	1.00	ND	107	75-125				
Reference (BG31486-SRM1)										Prepared & Analyzed: 07/31/2013	
Iron - Dissolved	1.36	0.0200	mg/L	1.39		98.1	88.4-113				



Metals by EPA 200 Series Methods - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG31487 - EPA 3010A											
Blank (BG31487-BLK1)											
Iron	ND	0.0200	mg/L								Prepared & Analyzed: 07/31/2013
Reference (BG31487-SRM1)											
Iron	1.35	0.0200	mg/L	1.39		97.2	88.4-113				



Miscellaneous Physical/Conventional Chemistry Parameters - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30022 - % Solids Prep

Blank (BH30022-BLK1)

Prepared: 08/01/2013 Analyzed: 08/02/2013

Total Dissolved Solids	ND	10.0	mg/L								
------------------------	----	------	------	--	--	--	--	--	--	--	--



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
13G0916-01	WQ072513:1120NP2-10	250mL Plastic Cool to 4° C
13G0919-01	WQ072513:1100NP2-6	250mL Plastic Cool to 4° C
13G0919-02	WQ072513:1110NP2-7	250mL Plastic Cool to 4° C

Notes and Definitions

QL-02	This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
J	Detected below the Reporting Limit but greater than or equal to the Method Detection Limit (MDL/LOD) or in the case of a TIC, the result is an estimated concentration.
ND	Analyte NOT DETECTED at the stated Reporting Limit (RL) or above.
RL	REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
MDL	METHOD DETECTION LIMIT - the minimum concentration that can be measured and reported with a 99% confidence that the concentration is greater than zero. If requested or required, a value reported below the RL and above the MDL is considered estimated and is noted with a "J" flag.
NR	Not reported
RPD	Relative Percent Difference
Wet	The data has been reported on an as-received (wet weight) basis
Low Bias	Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
High Bias	High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
Non-Dir.	Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the MDL, with values between the MDL and the RL being "J" flagged as estimated results.

Field Chain-of-Custody Record

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions unless superseded by written contract.

York Project No. B60116

YOUR Information Company: <u>LBG Inc.</u> Address: <u>4 Research Dr. Suite 50</u> <u>Sheridan, CT. 06484</u> Phone No. <u>203-929-8555</u> Contact Person: <u>Tunde Sandor</u> E-Mail Address: <u>tsandore@bgrct.com</u>	Report To: Company: <u>same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____	YOUR Project ID <u>Rowe Industries</u> ##### Purchase Order No. <u>NABSA6</u> Samples from: CT <u>NY</u> NJ	Invoice To: Company: <u>same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____	Turn-Around Time RUSH - Same Day <input type="checkbox"/> RUSH - Next Day <input type="checkbox"/> RUSH - Two Day <input type="checkbox"/> RUSH - Three Day <input type="checkbox"/> RUSH - Four Day <input type="checkbox"/> Standard (5-7 Days) <input checked="" type="checkbox"/>	Report Type Summary Report <u>X</u> , pdf Summary w/ QA Summary <u>X</u> , pdf CT RCP Package CTRCP DQA/DUE Pkg NY ASP A Package NY ASP B Package <u>NP2-10 one</u> NUDEP Red. Deliv. _____ Electronic Data Deliverables (EDD) Simple Excel <u>X</u> NYSDEC EQUIS EQUIS (std) EZ-EDD (EQUIS) NUDEP SRP HazSite EDD GIS/KEY (std) Other _____ York Regulatory Comparison Excel Spreadsheet Compare to the following Regs. (please fill in): _____
---	---	---	--	--	---

Print Clearly and Legibly. All Information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.

[Signature]
 Samples Collected/Authorized By (Signature)
Evan Foster
 Name (printed)

Sample Identification	Date Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below					Container Description(s)	Temperature on Receipt	
WA072513:1100 NP2-6	7/25/13	GW	Volatiles: 8260 full TICs Site Spec. Nassau Co. STARS list Nassau Co. BTEX MTBE TCL list TAGM list CT RCP list Arom. only Halog. only App. IX list 8021B list	Semi-Vols. 8270 or 625 8082PCB 8081Pest 8151Herb CT RCP App. IX Site Spec. SPLP or TCLP TCLP list NUDEP list App. IX TCLP BNA SPLP or TCLP	Metals: RCRA8 PP13 list TAL CTI15 list TAGM list NUDEP list Total Dissolved SPLP or TCLP Ink/Meat LIST Below	Misc. Org. TPB GRO TPH DRO CT ETHP NY 310-13 TPH 1664 Air TO14A Air TO15 Air STARS Air VPH Air TICs Methane Helium	Full Lists: Pri. Poll. TCL Organics TAL MetCN Full TCLP Full App. IX Part. 360-Routine Part. 360-Residue Part. 360-Approval Part. 360-Approval NYCDEP-Sever NYSEDEC TAGM	Misc. Concoivity Reactivity Ignitability Flash Point Sieve Anal. Heterotrophs TOX BTU/lb. Aquatic Tox. TOC Silica	240ml VOC, 125 ml PLAS 1440ml 250 ml PLAS 11	3.0 °C
WA072513:1110 NP2-7	7/25/13	GW								
WA072513:1120 NP2-10	7/25/13	GW								
Comments: _____ Preservation: _____ Check those Applicable: _____ Special Instructions: _____ Field Filtered <input type="checkbox"/> Lab to Filter <input type="checkbox"/>										
Samples Relinquished By <u>[Signature]</u> Date/Time <u>7/26/13/1234</u>								Samples Received By <u>[Signature]</u> Date/Time <u>7-26-13 1235</u>		
Samples Relinquished By _____ Date/Time _____								Samples Received in LAB by _____ Date/Time _____		

Field Chain-of-Custody Record


NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions unless superseded by written contract.

York Project No. 1360919

<p>YOUR Information</p> <p>Company: <u>LBG Inc.</u> Address: <u>4 Research Dr. Suite 30 Shelton, CT. 06484</u> Phone No. <u>203-929-8555</u> Contact Person: <u>Tunde Sandor</u> E-Mail Address: <u>tsandor@lbgt.com</u></p>	<p>Report To: <u>same</u></p> <p>Company: _____ Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____</p>	<p>Invoice To: <u>same</u></p> <p>Company: <u>same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____</p>	<p>YOUR Project ID <u>Rowe Industries</u> ###883### Purchase Order No. <u>NABSA6</u></p>	<p>Turn-Around Time</p> <p>RUSH - Same Day <input type="checkbox"/> RUSH - Next Day <input type="checkbox"/> RUSH - Two Day <input type="checkbox"/> RUSH - Three Day <input type="checkbox"/> RUSH - Four Day <input type="checkbox"/></p> <p>Standard (5-7 Days) <input checked="" type="checkbox"/></p>	<p>Report Type</p> <p>Summary Report <u>X</u>, pdf Summary w/ QA Summary <u>X</u>, pdf CT RCP Package CTRCP DQA/DUE Pkg NY ASP A Package NY ASP B Package <u>NP2-10 only pit</u> NUDEP Red. Deliv. <u>Electronic Data Deliverables (EDD)</u> Simple Excel <u>X</u> NYSDEC EQulS EQulS (std) EZ-EDD (EQulS) NUDEP SRP HazSite EDD GIS/KEY (std) Other _____ York Regulatory Comparison Excel Spreadsheet Compare to the following Regs. (please fill in):</p>
<p>Samples from: CT <input checked="" type="checkbox"/> NY <input checked="" type="checkbox"/> NJ</p>					


Print Clearly and Legibly. All Information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.

Matrix Codes
S - soil
Other - specify (oil, etc.)
WW - wastewater
GW - groundwater
DW - drinking water
Air-A - ambient air
Air-SV - soil vapor

Samples Collected/Authorized By (Signature)

Name (printed)
Evan Foster

Sample Identification	Date Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below	Container Description(s)
WQ072513:1100 NP2-6	7/25/13	GW	FE BY EPA 2007/FE, DISSOLVED BY EPA 6010 (SW 846-6010B) / VOCs, 8260 List (EPA SW 845-8260B), PUS FROEN ILS	240ml vial, 1.25 ml plastic 140x3 250 ml plastic
WQ072513:1110 NP2-7	7/25/13	GW	FE BY EPA 2007/FE, DISSOLVED BY EPA 6010 (SW 846-6010B) / VOCs, 8260 List (EPA SW 845-8260B), PUS FROEN ILS	11
WQ072513:1120 NP2-10	7/25/13	GW	FE BY EPA 2007/FE, DISSOLVED BY EPA 6010 (SW 846-6010B) / VOCs, 8260 List (EPA SW 845-8260B), PUS FROEN ILS	240ml vial, 1.25 ml plastic 140x3, 2x250 ml plastic

<p>Comments</p> <p> 7/26/13/234</p>	<p>4°C <input type="checkbox"/> Frozen <input type="checkbox"/></p> <p>HCl <input type="checkbox"/> MeOH <input type="checkbox"/> HNO₃ <input type="checkbox"/> H₂SO₄ <input type="checkbox"/> NaOH <input type="checkbox"/></p> <p>ZnAc₂ <input type="checkbox"/> Ascorbic Acid <input type="checkbox"/> Other <input type="checkbox"/></p>	<p>Preservation Check those Applicable</p> <p>Special Instructions</p> <p>Field Filtered <input type="checkbox"/> Lab to Filter <input type="checkbox"/></p>
<p>Samples Relinquished By <u>Evan Foster</u> Date/Time <u>7-26-13 1235</u></p>	<p>Samples Relinquished By _____ Date/Time _____</p>	<p>Samples Received By _____ Date/Time _____</p> <p>Samples Received in LAB by _____ Date/Time _____</p> <p>Temperature on Receipt <u>3.0</u> °C</p>



Technical Report

prepared for:

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301

Shelton CT, 06484

Attention: Tunde Komuves-Sandor

Report Date: 08/05/2013

Client Project ID: Rowe Industries

York Project (SDG) No.: 13G1042

CT Cert. No. PH-0723

New Jersey Cert. No. CT-005



New York Cert. No. 10854

PA Cert. No. 68-04440

Report Date: 08/05/2013
Client Project ID: Rowe Industries
York Project (SDG) No.: 13G1042

Leggette Brashears & Graham Shelton Office
4 Research Drive, Suite 301
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on July 30, 2013 and listed below. The project was identified as your project: **Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Notes section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the attachment to this report, and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
13G1042-01	WQ072913:1230NP2-6	Water	07/29/2013	07/30/2013
13G1042-02	WQ072913:1235NP2-7	Water	07/29/2013	07/30/2013
13G1043-01	WQ072913:1240NP2-10	Water	07/29/2013	07/30/2013

General Notes for York Project (SDG) No.: 13G1042

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All samples were received in proper condition for analysis with proper documentation, unless otherwise noted.
6. All analyses conducted met method or Laboratory SOP requirements. See the Qualifiers and/or Narrative sections for further information.
7. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
8. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 08/05/2013

YORK



Sample Information

Client Sample ID: WQ072913:1230NP2-6

York Sample ID: 13G1042-01

York Project (SDG) No.
13G1042

Client Project ID
Rowe Industries

Matrix
Water

Collection Date/Time
July 29, 2013 12:30 pm

Date Received
07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
71-55-6	1,1,1-Trichloroethane	0.42	J	ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS



Sample Information

Client Sample ID: WQ072913:1230NP2-6

York Sample ID: 13G1042-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1042

Rowe Industries

Water

July 29, 2013 12:30 pm

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
156-59-2	cis-1,2-Dichloroethylene	0.33	J	ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
127-18-4	Tetrachloroethylene	1.9		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
79-01-6	Trichloroethylene	0.27	J	ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 15:33	SS



Sample Information

Client Sample ID: WQ072913:1230NP2-6

York Sample ID: 13G1042-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1042

Rowe Industries

Water

July 29, 2013 12:30 pm

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Surrogate Recoveries	Result									
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	102 %			72.6	129					
460-00-4	Surrogate: p-Bromofluorobenzene	93.8 %			63.5	145					
2037-26-5	Surrogate: Toluene-d8	96.2 %			81.2	127					

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	0.0571		mg/L	0.0200	0.0200	1	EPA SW846-6010B	07/31/2013 15:02	07/31/2013 18:44	MW

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	1.73		mg/L	0.0146	0.0200	1	EPA 200.7	07/31/2013 15:07	07/31/2013 20:20	MW

Sample Information

Client Sample ID: WQ072913:1235NP2-7

York Sample ID: 13G1042-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1042

Rowe Industries

Water

July 29, 2013 12:35 pm

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS



Sample Information

Client Sample ID: WQ072913:1235NP2-7

York Sample ID: 13G1042-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1042

Rowe Industries

Water

July 29, 2013 12:35 pm

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS



Sample Information

Client Sample ID: WQ072913:1235NP2-7

York Sample ID: 13G1042-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1042

Rowe Industries

Water

July 29, 2013 12:35 pm

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
127-18-4	Tetrachloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:10	SS
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	104 %	72.6-129								
460-00-4	Surrogate: p-Bromofluorobenzene	91.5 %	63.5-145								
2037-26-5	Surrogate: Toluene-d8	98.7 %	81.2-127								

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	0.0922		mg/L	0.0200	0.0200	1	EPA SW846-6010B	07/31/2013 15:02	07/31/2013 18:48	MW



Sample Information

Client Sample ID: WQ072913:1235NP2-7

York Sample ID: 13G1042-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1042

Rowe Industries

Water

July 29, 2013 12:35 pm

07/30/2013

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	0.428		mg/L	0.0146	0.0200	1	EPA 200.7	07/31/2013 15:07	07/31/2013 20:37	MW

Sample Information

Client Sample ID: WQ072913:1240NP2-10

York Sample ID: 13G1043-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1043

Rowe Industries

Water

July 29, 2013 12:40 pm

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS



Sample Information

Client Sample ID: WQ072913:1240NP2-10

York Sample ID: 13G1043-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1043

Rowe Industries

Water

July 29, 2013 12:40 pm

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS



Sample Information

Client Sample ID: WQ072913:1240NP2-10

York Sample ID: 13G1043-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1043

Rowe Industries

Water

July 29, 2013 12:40 pm

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
127-18-4	Tetrachloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	08/01/2013 13:10	08/02/2013 08:11	SS
Surrogate Recoveries		Result			Acceptance Range						
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	107 %			72.6-129						
460-00-4	Surrogate: p-Bromofluorobenzene	88.7 %			63.5-145						
2037-26-5	Surrogate: Toluene-d8	100 %			81.2-127						

Iron, Dissolved by EPA 6010

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	0.130		mg/L	0.0200	0.0200	1	EPA SW846-6010B	07/31/2013 15:02	07/31/2013 18:53	MW

Iron by EPA 200.7

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 3010A

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-89-6	Iron	0.736		mg/L	0.0146	0.0200	1	EPA 200.7	07/31/2013 15:07	07/31/2013 20:42	MW

Total Dissolved Solids

Log-in Notes:

Sample Notes:

Sample Prepared by Method: % Solids Prep

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Total Dissolved Solids	93.0		mg/L	10.0	10.0	1	SM 2540C	08/01/2013 09:22	08/02/2013 15:28	BGS



Analytical Batch Summary

Batch ID: BG31486 **Preparation Method:** EPA 3010A **Prepared By:** MW

YORK Sample ID	Client Sample ID	Preparation Date
13G1042-01	WQ072913:1230NP2-6	07/31/13
13G1042-02	WQ072913:1235NP2-7	07/31/13
13G1043-01	WQ072913:1240NP2-10	07/31/13
BG31486-BLK1	Blank	07/31/13
BG31486-SRM1	Reference	07/31/13

Batch ID: BG31487 **Preparation Method:** EPA 3010A **Prepared By:** MW

YORK Sample ID	Client Sample ID	Preparation Date
13G1042-01	WQ072913:1230NP2-6	07/31/13
13G1042-02	WQ072913:1235NP2-7	07/31/13
13G1043-01	WQ072913:1240NP2-10	07/31/13
BG31487-BLK1	Blank	07/31/13
BG31487-DUP1	Duplicate	07/31/13
BG31487-MS1	Matrix Spike	07/31/13
BG31487-SRM1	Reference	07/31/13

Batch ID: BH30022 **Preparation Method:** % Solids Prep **Prepared By:** BGS

YORK Sample ID	Client Sample ID	Preparation Date
13G1043-01	WQ072913:1240NP2-10	08/01/13
BH30022-BLK1	Blank	08/01/13

Batch ID: BH30023 **Preparation Method:** EPA 5030B **Prepared By:** EKM

YORK Sample ID	Client Sample ID	Preparation Date
13G1042-01	WQ072913:1230NP2-6	08/01/13
13G1042-02	WQ072913:1235NP2-7	08/01/13
BH30023-BLK1	Blank	08/01/13
BH30023-BS1	LCS	08/01/13
BH30023-BSD1	LCS Dup	08/01/13

Batch ID: BH30065 **Preparation Method:** EPA 5030B **Prepared By:** EKM

YORK Sample ID	Client Sample ID	Preparation Date
13G1043-01	WQ072913:1240NP2-10	08/01/13
BH30065-BLK1	Blank	08/01/13
BH30065-BS1	LCS	08/01/13
BH30065-BSD1	LCS Dup	08/01/13



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30023 - EPA 5030B

Blank (BH30023-BLK1)

Prepared & Analyzed: 08/01/2013

1,1,1,2-Tetrachloroethane	ND	0.50	ug/L								
1,1,1-Trichloroethane	ND	0.50	"								
1,1,2,2-Tetrachloroethane	ND	0.50	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.50	"								
1,1,2-Trichloroethane	ND	0.50	"								
1,1-Dichloroethane	ND	0.50	"								
1,1-Dichloroethylene	ND	0.50	"								
1,1-Dichloropropylene	ND	0.50	"								
1,2,3-Trichlorobenzene	ND	2.0	"								
1,2,3-Trichloropropane	ND	0.50	"								
1,2,4-Trichlorobenzene	ND	2.0	"								
1,2,4-Trimethylbenzene	ND	0.50	"								
1,2-Dibromo-3-chloropropane	ND	2.0	"								
1,2-Dibromoethane	ND	0.50	"								
1,2-Dichlorobenzene	ND	0.50	"								
1,2-Dichloroethane	ND	0.50	"								
1,2-Dichloropropane	ND	0.50	"								
1,3,5-Trimethylbenzene	ND	0.50	"								
1,3-Dichlorobenzene	ND	0.50	"								
1,3-Dichloropropane	ND	0.50	"								
1,4-Dichlorobenzene	ND	0.50	"								
2,2-Dichloropropane	ND	0.50	"								
2-Chlorotoluene	ND	0.50	"								
2-Hexanone	ND	0.50	"								
4-Chlorotoluene	ND	0.50	"								
Acetone	ND	2.0	"								
Benzene	ND	0.50	"								
Bromobenzene	ND	0.50	"								
Bromochloromethane	ND	0.50	"								
Bromodichloromethane	ND	0.50	"								
Bromoform	ND	0.50	"								
Bromomethane	ND	0.50	"								
Carbon tetrachloride	ND	0.50	"								
Chlorobenzene	ND	0.50	"								
Chloroethane	ND	0.50	"								
Chloroform	ND	0.50	"								
Chloromethane	ND	0.50	"								
cis-1,2-Dichloroethylene	ND	0.50	"								
cis-1,3-Dichloropropylene	ND	0.50	"								
Dibromochloromethane	ND	0.50	"								
Dibromomethane	ND	0.50	"								
Dichlorodifluoromethane	ND	0.50	"								
Ethyl Benzene	ND	0.50	"								
Hexachlorobutadiene	ND	0.50	"								
Isopropylbenzene	ND	0.50	"								
Methyl tert-butyl ether (MTBE)	ND	0.50	"								
Methylene chloride	ND	2.0	"								
Naphthalene	ND	2.0	"								
n-Butylbenzene	ND	0.50	"								
n-Propylbenzene	ND	0.50	"								
o-Xylene	ND	0.50	"								



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30023 - EPA 5030B

Blank (BH30023-BLK1)

Prepared & Analyzed: 08/01/2013

p- & m- Xylenes	ND	1.0	ug/L								
p-Isopropyltoluene	ND	0.50	"								
sec-Butylbenzene	ND	0.50	"								
Styrene	ND	0.50	"								
tert-Butylbenzene	ND	0.50	"								
Tetrachloroethylene	ND	0.50	"								
Toluene	ND	0.50	"								
trans-1,2-Dichloroethylene	ND	0.50	"								
trans-1,3-Dichloropropylene	ND	0.50	"								
Trichloroethylene	ND	0.50	"								
Trichlorofluoromethane	ND	0.50	"								
Vinyl Chloride	ND	0.50	"								
Xylenes, Total	ND	1.5	"								

Surrogate: 1,2-Dichloroethane-d4

10.7

"

10.0

107

72.6-129

Surrogate: p-Bromofluorobenzene

9.29

"

10.0

92.9

63.5-145

Surrogate: Toluene-d8

9.27

"

10.0

92.7

81.2-127

LCS (BH30023-BS1)

Prepared & Analyzed: 08/01/2013

1,1,1,2-Tetrachloroethane	10.6		ug/L	10.0		106	82.3-130				
1,1,1-Trichloroethane	10.4		"	10.0		104	75.6-137				
1,1,2,2-Tetrachloroethane	10.4		"	10.0		104	71.3-131				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.1		"	10.0		101	71.1-129				
1,1,2-Trichloroethane	10.8		"	10.0		108	74.5-129				
1,1-Dichloroethane	9.99		"	10.0		99.9	79.6-132				
1,1-Dichloroethylene	9.75		"	10.0		97.5	80.2-146				
1,1-Dichloropropylene	9.19		"	10.0		91.9	75-136				
1,2,3-Trichlorobenzene	9.32		"	10.0		93.2	66.1-136				
1,2,3-Trichloropropane	10.5		"	10.0		105	63-131				
1,2,4-Trichlorobenzene	9.72		"	10.0		97.2	70.6-136				
1,2,4-Trimethylbenzene	9.72		"	10.0		97.2	75.3-135				
1,2-Dibromo-3-chloropropane	10.8		"	10.0		108	58.9-140				
1,2-Dibromoethane	11.7		"	10.0		117	79-130				
1,2-Dichlorobenzene	9.66		"	10.0		96.6	76.1-122				
1,2-Dichloroethane	10.1		"	10.0		101	74.6-132				
1,2-Dichloropropane	9.70		"	10.0		97.0	76.9-129				
1,3,5-Trimethylbenzene	9.76		"	10.0		97.6	70.6-127				
1,3-Dichlorobenzene	9.81		"	10.0		98.1	77-124				
1,3-Dichloropropane	10.6		"	10.0		106	75.8-126				
1,4-Dichlorobenzene	9.80		"	10.0		98.0	76.6-125				
2,2-Dichloropropane	11.8		"	10.0		118	69-133				
2-Chlorotoluene	9.43		"	10.0		94.3	66.3-119				
2-Hexanone	11.1		"	10.0		111	70-130				
4-Chlorotoluene	9.81		"	10.0		98.1	69.2-127				
Acetone	9.98		"	10.0		99.8	70-130				
Benzene	9.77		"	10.0		97.7	76.2-129				
Bromobenzene	9.68		"	10.0		96.8	71.3-123				
Bromochloromethane	10.5		"	10.0		105	70.8-137				
Bromodichloromethane	10.6		"	10.0		106	79.7-134				
Bromoform	11.7		"	10.0		117	70.5-141				
Bromomethane	8.37		"	10.0		83.7	43.9-147				
Carbon tetrachloride	11.3		"	10.0		113	78.1-138				
Chlorobenzene	9.73		"	10.0		97.3	80.4-125				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Spike	Source*	%REC	%REC	Limits	Flag	RPD	RPD	
		Limit								Units	Level

Batch BH30023 - EPA 5030B

LCS (BH30023-BS1)

Prepared & Analyzed: 08/01/2013

Chloroethane	9.83		ug/L	10.0		98.3	55.8-140				
Chloroform	10.2		"	10.0		102	76.6-133				
Chloromethane	8.24		"	10.0		82.4	48.8-115				
cis-1,2-Dichloroethylene	9.83		"	10.0		98.3	75.1-128				
cis-1,3-Dichloropropylene	11.4		"	10.0		114	74.5-128				
Dibromochloromethane	12.8		"	10.0		128	79.8-134				
Dibromomethane	10.2		"	10.0		102	79-130				
Dichlorodifluoromethane	9.80		"	10.0		98.0	47.1-101				
Ethyl Benzene	9.90		"	10.0		99.0	80.8-128				
Hexachlorobutadiene	9.47		"	10.0		94.7	64.8-128				
Isopropylbenzene	9.70		"	10.0		97.0	75.5-135				
Methyl tert-butyl ether (MTBE)	11.6		"	10.0		116	65.1-140				
Methylene chloride	9.85		"	10.0		98.5	61.3-120				
Naphthalene	9.78		"	10.0		97.8	62.3-148				
n-Butylbenzene	9.22		"	10.0		92.2	67.2-123				
n-Propylbenzene	9.75		"	10.0		97.5	70.5-127				
o-Xylene	9.63		"	10.0		96.3	75.9-122				
p- & m- Xylenes	19.5		"	20.0		97.6	77.7-127				
p-Isopropyltoluene	9.83		"	10.0		98.3	75.6-129				
sec-Butylbenzene	9.81		"	10.0		98.1	71.5-125				
Styrene	10.5		"	10.0		105	77.8-123				
tert-Butylbenzene	9.87		"	10.0		98.7	75.9-151				
Tetrachloroethylene	9.14		"	10.0		91.4	63.6-167				
Toluene	9.08		"	10.0		90.8	77-123				
trans-1,2-Dichloroethylene	9.74		"	10.0		97.4	76.3-139				
trans-1,3-Dichloropropylene	11.6		"	10.0		116	72.5-137				
Trichloroethylene	9.19		"	10.0		91.9	77.9-130				
Trichlorofluoromethane	10.0		"	10.0		100	57.4-133				
Vinyl Chloride	9.18		"	10.0		91.8	54.9-124				
<i>Surrogate: 1,2-Dichloroethane-d4</i>	<i>10.0</i>		<i>"</i>	<i>10.0</i>		<i>100</i>	<i>72.6-129</i>				
<i>Surrogate: p-Bromofluorobenzene</i>	<i>10.2</i>		<i>"</i>	<i>10.0</i>		<i>102</i>	<i>63.5-145</i>				
<i>Surrogate: Toluene-d8</i>	<i>9.42</i>		<i>"</i>	<i>10.0</i>		<i>94.2</i>	<i>81.2-127</i>				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30023 - EPA 5030B

LCS Dup (BH30023-BSD1)

Prepared & Analyzed: 08/01/2013

1,1,1,2-Tetrachloroethane	11.0		ug/L	10.0		110	82.3-130		3.42	21.1	
1,1,1-Trichloroethane	10.6		"	10.0		106	75.6-137		1.62	19.7	
1,1,2,2-Tetrachloroethane	10.2		"	10.0		102	71.3-131		1.36	20.8	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.7		"	10.0		107	71.1-129		5.48	21.7	
1,1,2-Trichloroethane	9.86		"	10.0		98.6	74.5-129		8.82	20.3	
1,1-Dichloroethane	10.5		"	10.0		105	79.6-132		4.79	20.6	
1,1-Dichloroethylene	10.0		"	10.0		100	80.2-146		3.03	20	
1,1-Dichloropropylene	9.62		"	10.0		96.2	75-136		4.57	19.3	
1,2,3-Trichlorobenzene	9.43		"	10.0		94.3	66.1-136		1.17	21.6	
1,2,3-Trichloropropane	10.4		"	10.0		104	63-131		1.72	23.9	
1,2,4-Trichlorobenzene	9.49		"	10.0		94.9	70.6-136		2.39	21.7	
1,2,4-Trimethylbenzene	9.65		"	10.0		96.5	75.3-135		0.723	18.8	
1,2-Dibromo-3-chloropropane	10.8		"	10.0		108	58.9-140		0.464	27.7	
1,2-Dibromoethane	11.8		"	10.0		118	79-130		1.45	23	
1,2-Dichlorobenzene	9.70		"	10.0		97.0	76.1-122		0.413	19.8	
1,2-Dichloroethane	10.4		"	10.0		104	74.6-132		3.61	20.2	
1,2-Dichloropropane	10.2		"	10.0		102	76.9-129		4.73	20.7	
1,3,5-Trimethylbenzene	9.71		"	10.0		97.1	70.6-127		0.514	18.9	
1,3-Dichlorobenzene	9.71		"	10.0		97.1	77-124		1.02	19.2	
1,3-Dichloropropane	10.9		"	10.0		109	75.8-126		2.70	22.1	
1,4-Dichlorobenzene	9.58		"	10.0		95.8	76.6-125		2.27	18.6	
2,2-Dichloropropane	10.9		"	10.0		109	69-133		7.48	19.8	
2-Chlorotoluene	9.35		"	10.0		93.5	66.3-119		0.852	21.6	
2-Hexanone	11.0		"	10.0		110	70-130		0.453	30	
4-Chlorotoluene	9.77		"	10.0		97.7	69.2-127		0.409	19	
Acetone	10.6		"	10.0		106	70-130		6.03	30	
Benzene	10.3		"	10.0		103	76.2-129		5.09	19	
Bromobenzene	9.91		"	10.0		99.1	71.3-123		2.35	20.3	
Bromochloromethane	10.8		"	10.0		108	70.8-137		3.19	23.9	
Bromodichloromethane	10.8		"	10.0		108	79.7-134		1.78	21	
Bromoform	11.3		"	10.0		113	70.5-141		3.57	21.8	
Bromomethane	9.09		"	10.0		90.9	43.9-147		8.25	28.4	
Carbon tetrachloride	11.6		"	10.0		116	78.1-138		2.80	20.1	
Chlorobenzene	9.97		"	10.0		99.7	80.4-125		2.44	19.9	
Chloroethane	10.3		"	10.0		103	55.8-140		4.67	23.3	
Chloroform	10.5		"	10.0		105	76.6-133		2.70	20.3	
Chloromethane	8.70		"	10.0		87.0	48.8-115		5.43	24.5	
cis-1,2-Dichloroethylene	10.3		"	10.0		103	75.1-128		4.77	20.5	
cis-1,3-Dichloropropylene	11.8		"	10.0		118	74.5-128		2.76	19.9	
Dibromochloromethane	12.6		"	10.0		126	79.8-134		0.866	21.3	
Dibromomethane	10.6		"	10.0		106	79-130		4.52	22.4	
Dichlorodifluoromethane	10.1		"	10.0		101	47.1-101		3.21	23.9	
Ethyl Benzene	10.2		"	10.0		102	80.8-128		2.59	19.2	
Hexachlorobutadiene	9.09		"	10.0		90.9	64.8-128		4.09	20.6	
Isopropylbenzene	9.72		"	10.0		97.2	75.5-135		0.206	20	
Methyl tert-butyl ether (MTBE)	12.1		"	10.0		121	65.1-140		3.80	23.6	
Methylene chloride	10.2		"	10.0		102	61.3-120		3.88	20.4	
Naphthalene	9.82		"	10.0		98.2	62.3-148		0.408	27.1	
n-Butylbenzene	9.31		"	10.0		93.1	67.2-123		0.971	19.1	
n-Propylbenzene	9.72		"	10.0		97.2	70.5-127		0.308	23.4	
o-Xylene	9.82		"	10.0		98.2	75.9-122		1.95	19.3	



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	Flag
		Limit			Result					RPD	

Batch BH30023 - EPA 5030B

LCS Dup (BH30023-BSD1)

Prepared & Analyzed: 08/01/2013

p- & m- Xylenes	19.9		ug/L	20.0		99.3	77.7-127			1.78	18.6
p-Isopropyltoluene	9.64		"	10.0		96.4	75.6-129			1.95	19.1
sec-Butylbenzene	9.78		"	10.0		97.8	71.5-125			0.306	18.9
Styrene	10.7		"	10.0		107	77.8-123			2.17	20.9
tert-Butylbenzene	9.85		"	10.0		98.5	75.9-151			0.203	20.9
Tetrachloroethylene	9.09		"	10.0		90.9	63.6-167			0.549	27.7
Toluene	9.38		"	10.0		93.8	77-123			3.25	18.7
trans-1,2-Dichloroethylene	10.1		"	10.0		101	76.3-139			3.43	19.5
trans-1,3-Dichloropropylene	11.6		"	10.0		116	72.5-137			0.259	19.3
Trichloroethylene	9.53		"	10.0		95.3	77.9-130			3.63	20.5
Trichlorofluoromethane	10.4		"	10.0		104	57.4-133			3.24	21.4
Vinyl Chloride	9.75		"	10.0		97.5	54.9-124			6.02	22.3
<i>Surrogate: 1,2-Dichloroethane-d4</i>	<i>10.1</i>		<i>"</i>	<i>10.0</i>		<i>101</i>	<i>72.6-129</i>				
<i>Surrogate: p-Bromofluorobenzene</i>	<i>9.82</i>		<i>"</i>	<i>10.0</i>		<i>98.2</i>	<i>63.5-145</i>				
<i>Surrogate: Toluene-d8</i>	<i>9.34</i>		<i>"</i>	<i>10.0</i>		<i>93.4</i>	<i>81.2-127</i>				

Batch BH30065 - EPA 5030B

Blank (BH30065-BLK1)

Prepared & Analyzed: 08/01/2013

1,1,1,2-Tetrachloroethane	ND	0.50	ug/L								
1,1,1-Trichloroethane	ND	0.50	"								
1,1,2,2-Tetrachloroethane	ND	0.50	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.50	"								
1,1,2-Trichloroethane	ND	0.50	"								
1,1-Dichloroethane	ND	0.50	"								
1,1-Dichloroethylene	ND	0.50	"								
1,1-Dichloropropylene	ND	0.50	"								
1,2,3-Trichlorobenzene	ND	2.0	"								
1,2,3-Trichloropropane	ND	0.50	"								
1,2,4-Trichlorobenzene	ND	2.0	"								
1,2,4-Trimethylbenzene	ND	0.50	"								
1,2-Dibromo-3-chloropropane	ND	2.0	"								
1,2-Dibromoethane	ND	0.50	"								
1,2-Dichlorobenzene	ND	0.50	"								
1,2-Dichloroethane	ND	0.50	"								
1,2-Dichloropropane	ND	0.50	"								
1,3,5-Trimethylbenzene	ND	0.50	"								
1,3-Dichlorobenzene	ND	0.50	"								
1,3-Dichloropropane	ND	0.50	"								
1,4-Dichlorobenzene	ND	0.50	"								
2,2-Dichloropropane	ND	0.50	"								
2-Chlorotoluene	ND	0.50	"								
2-Hexanone	ND	0.50	"								
4-Chlorotoluene	ND	0.50	"								
Acetone	ND	2.0	"								
Benzene	ND	0.50	"								
Bromobenzene	ND	0.50	"								
Bromochloromethane	ND	0.50	"								
Bromodichloromethane	ND	0.50	"								
Bromoform	ND	0.50	"								
Bromomethane	ND	0.50	"								
Carbon tetrachloride	ND	0.50	"								



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	RPD	Limit	Flag
		Limit								Limit			

Batch BH30065 - EPA 5030B

Blank (BH30065-BLK1)

Prepared & Analyzed: 08/01/2013

Chlorobenzene	ND	0.50	ug/L										
Chloroethane	ND	0.50	"										
Chloroform	ND	0.50	"										
Chloromethane	ND	0.50	"										
cis-1,2-Dichloroethylene	ND	0.50	"										
cis-1,3-Dichloropropylene	ND	0.50	"										
Dibromochloromethane	ND	0.50	"										
Dibromomethane	ND	0.50	"										
Dichlorodifluoromethane	ND	0.50	"										
Ethyl Benzene	ND	0.50	"										
Hexachlorobutadiene	ND	0.50	"										
Isopropylbenzene	ND	0.50	"										
Methyl tert-butyl ether (MTBE)	ND	0.50	"										
Methylene chloride	ND	2.0	"										
Naphthalene	ND	2.0	"										
n-Butylbenzene	ND	0.50	"										
n-Propylbenzene	ND	0.50	"										
o-Xylene	ND	0.50	"										
p- & m- Xylenes	ND	1.0	"										
p-Isopropyltoluene	ND	0.50	"										
sec-Butylbenzene	ND	0.50	"										
Styrene	ND	0.50	"										
tert-Butylbenzene	ND	0.50	"										
Tetrachloroethylene	ND	0.50	"										
Toluene	ND	0.50	"										
trans-1,2-Dichloroethylene	ND	0.50	"										
trans-1,3-Dichloropropylene	ND	0.50	"										
Trichloroethylene	ND	0.50	"										
Trichlorofluoromethane	ND	0.50	"										
Vinyl Chloride	ND	0.50	"										
Xylenes, Total	ND	1.5	"										
<hr/>													
<i>Surrogate: 1,2-Dichloroethane-d4</i>	<i>10.9</i>		<i>"</i>	<i>10.0</i>		<i>109</i>	<i>72.6-129</i>						
<i>Surrogate: p-Bromofluorobenzene</i>	<i>9.17</i>		<i>"</i>	<i>10.0</i>		<i>91.7</i>	<i>63.5-145</i>						
<i>Surrogate: Toluene-d8</i>	<i>10.6</i>		<i>"</i>	<i>10.0</i>		<i>106</i>	<i>81.2-127</i>						



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Spike	Source*	%REC	%REC	Limits	Flag	RPD	
		Limit							Units	Level

Batch BH30065 - EPA 5030B

LCS (BH30065-BS1)

Prepared & Analyzed: 08/01/2013

1,1,1,2-Tetrachloroethane	10.9		ug/L	10.0	109	82.3-130				
1,1,1-Trichloroethane	11.0		"	10.0	110	75.6-137				
1,1,2,2-Tetrachloroethane	10.6		"	10.0	106	71.3-131				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	11.0		"	10.0	110	71.1-129				
1,1,2-Trichloroethane	10.9		"	10.0	109	74.5-129				
1,1-Dichloroethane	10.9		"	10.0	109	79.6-132				
1,1-Dichloroethylene	10.8		"	10.0	108	80.2-146				
1,1-Dichloropropylene	10.1		"	10.0	101	75-136				
1,2,3-Trichlorobenzene	9.61		"	10.0	96.1	66.1-136				
1,2,3-Trichloropropane	9.98		"	10.0	99.8	63-131				
1,2,4-Trichlorobenzene	9.60		"	10.0	96.0	70.6-136				
1,2,4-Trimethylbenzene	9.62		"	10.0	96.2	75.3-135				
1,2-Dibromo-3-chloropropane	11.2		"	10.0	112	58.9-140				
1,2-Dibromoethane	11.1		"	10.0	111	79-130				
1,2-Dichlorobenzene	9.86		"	10.0	98.6	76.1-122				
1,2-Dichloroethane	11.0		"	10.0	110	74.6-132				
1,2-Dichloropropane	10.1		"	10.0	101	76.9-129				
1,3,5-Trimethylbenzene	9.54		"	10.0	95.4	70.6-127				
1,3-Dichlorobenzene	9.84		"	10.0	98.4	77-124				
1,3-Dichloropropane	11.1		"	10.0	111	75.8-126				
1,4-Dichlorobenzene	9.81		"	10.0	98.1	76.6-125				
2,2-Dichloropropane	9.09		"	10.0	90.9	69-133				
2-Chlorotoluene	9.30		"	10.0	93.0	66.3-119				
2-Hexanone	11.1		"	10.0	111	70-130				
4-Chlorotoluene	9.65		"	10.0	96.5	69.2-127				
Acetone	9.61		"	10.0	96.1	70-130				
Benzene	10.4		"	10.0	104	76.2-129				
Bromobenzene	9.57		"	10.0	95.7	71.3-123				
Bromochloromethane	11.0		"	10.0	110	70.8-137				
Bromodichloromethane	10.6		"	10.0	106	79.7-134				
Bromoform	11.5		"	10.0	115	70.5-141				
Bromomethane	8.56		"	10.0	85.6	43.9-147				
Carbon tetrachloride	11.4		"	10.0	114	78.1-138				
Chlorobenzene	10.1		"	10.0	101	80.4-125				
Chloroethane	10.1		"	10.0	101	55.8-140				
Chloroform	10.7		"	10.0	107	76.6-133				
Chloromethane	9.89		"	10.0	98.9	48.8-115				
cis-1,2-Dichloroethylene	10.4		"	10.0	104	75.1-128				
cis-1,3-Dichloropropylene	10.9		"	10.0	109	74.5-128				
Dibromochloromethane	12.5		"	10.0	125	79.8-134				
Dibromomethane	10.4		"	10.0	104	79-130				
Dichlorodifluoromethane	10.2		"	10.0	102	47.1-101	High Bias			
Ethyl Benzene	10.5		"	10.0	105	80.8-128				
Hexachlorobutadiene	9.32		"	10.0	93.2	64.8-128				
Isopropylbenzene	9.45		"	10.0	94.5	75.5-135				
Methyl tert-butyl ether (MTBE)	9.28		"	10.0	92.8	65.1-140				
Methylene chloride	10.8		"	10.0	108	61.3-120				
Naphthalene	10.1		"	10.0	101	62.3-148				
n-Butylbenzene	9.44		"	10.0	94.4	67.2-123				
n-Propylbenzene	9.56		"	10.0	95.6	70.5-127				
o-Xylene	10.2		"	10.0	102	75.9-122				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30065 - EPA 5030B

LCS (BH30065-BS1)

Prepared & Analyzed: 08/01/2013

p- & m- Xylenes	20.9		ug/L	20.0		104	77.7-127				
p-Isopropyltoluene	9.80		"	10.0		98.0	75.6-129				
sec-Butylbenzene	9.95		"	10.0		99.5	71.5-125				
Styrene	11.0		"	10.0		110	77.8-123				
tert-Butylbenzene	9.87		"	10.0		98.7	75.9-151				
Tetrachloroethylene	9.10		"	10.0		91.0	63.6-167				
Toluene	9.44		"	10.0		94.4	77-123				
trans-1,2-Dichloroethylene	10.5		"	10.0		105	76.3-139				
trans-1,3-Dichloropropylene	10.8		"	10.0		108	72.5-137				
Trichloroethylene	9.63		"	10.0		96.3	77.9-130				
Trichlorofluoromethane	11.0		"	10.0		110	57.4-133				
Vinyl Chloride	10.5		"	10.0		105	54.9-124				
Surrogate: 1,2-Dichloroethane-d4	11.0		"	10.0		110	72.6-129				
Surrogate: p-Bromofluorobenzene	9.70		"	10.0		97.0	63.5-145				
Surrogate: Toluene-d8	9.26		"	10.0		92.6	81.2-127				

LCS Dup (BH30065-BSD1)

Prepared & Analyzed: 08/01/2013

1,1,1,2-Tetrachloroethane	10.6		ug/L	10.0		106	82.3-130		2.89	21.1	
1,1,1-Trichloroethane	10.7		"	10.0		107	75.6-137		2.40	19.7	
1,1,2,2-Tetrachloroethane	9.75		"	10.0		97.5	71.3-131		8.54	20.8	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.4		"	10.0		104	71.1-129		5.52	21.7	
1,1,2-Trichloroethane	10.9		"	10.0		109	74.5-129		0.00	20.3	
1,1-Dichloroethane	10.2		"	10.0		102	79.6-132		6.74	20.6	
1,1-Dichloroethylene	10.4		"	10.0		104	80.2-146		3.96	20	
1,1-Dichloropropylene	9.64		"	10.0		96.4	75-136		4.56	19.3	
1,2,3-Trichlorobenzene	9.20		"	10.0		92.0	66.1-136		4.36	21.6	
1,2,3-Trichloropropane	9.27		"	10.0		92.7	63-131		7.38	23.9	
1,2,4-Trichlorobenzene	9.20		"	10.0		92.0	70.6-136		4.26	21.7	
1,2,4-Trimethylbenzene	8.99		"	10.0		89.9	75.3-135		6.77	18.8	
1,2-Dibromo-3-chloropropane	10.4		"	10.0		104	58.9-140		7.67	27.7	
1,2-Dibromoethane	10.5		"	10.0		105	79-130		5.66	23	
1,2-Dichlorobenzene	9.34		"	10.0		93.4	76.1-122		5.42	19.8	
1,2-Dichloroethane	10.8		"	10.0		108	74.6-132		2.20	20.2	
1,2-Dichloropropane	9.55		"	10.0		95.5	76.9-129		5.80	20.7	
1,3,5-Trimethylbenzene	9.06		"	10.0		90.6	70.6-127		5.16	18.9	
1,3-Dichlorobenzene	9.24		"	10.0		92.4	77-124		6.29	19.2	
1,3-Dichloropropane	10.7		"	10.0		107	75.8-126		3.57	22.1	
1,4-Dichlorobenzene	9.32		"	10.0		93.2	76.6-125		5.12	18.6	
2,2-Dichloropropane	8.19		"	10.0		81.9	69-133		10.4	19.8	
2-Chlorotoluene	8.79		"	10.0		87.9	66.3-119		5.64	21.6	
2-Hexanone	10.8		"	10.0		108	70-130		3.02	30	
4-Chlorotoluene	9.14		"	10.0		91.4	69.2-127		5.43	19	
Acetone	9.87		"	10.0		98.7	70-130		2.67	30	
Benzene	9.95		"	10.0		99.5	76.2-129		4.42	19	
Bromobenzene	9.17		"	10.0		91.7	71.3-123		4.27	20.3	
Bromochloromethane	10.5		"	10.0		105	70.8-137		4.10	23.9	
Bromodichloromethane	10.7		"	10.0		107	79.7-134		0.935	21	
Bromoform	10.6		"	10.0		106	70.5-141		7.98	21.8	
Bromomethane	8.40		"	10.0		84.0	43.9-147		1.89	28.4	
Carbon tetrachloride	11.0		"	10.0		110	78.1-138		4.29	20.1	
Chlorobenzene	9.75		"	10.0		97.5	80.4-125		3.13	19.9	
Chloroethane	9.50		"	10.0		95.0	55.8-140		6.22	23.3	



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30065 - EPA 5030B

LCS Dup (BH30065-BSD1)

Prepared & Analyzed: 08/01/2013

Chloroform	10.6		ug/L	10.0		106	76.6-133		0.943	20.3	
Chloromethane	9.41		"	10.0		94.1	48.8-115		4.97	24.5	
cis-1,2-Dichloroethylene	9.92		"	10.0		99.2	75.1-128		5.11	20.5	
cis-1,3-Dichloropropylene	11.9		"	10.0		119	74.5-128		9.29	19.9	
Dibromochloromethane	12.7		"	10.0		127	79.8-134		1.75	21.3	
Dibromomethane	9.69		"	10.0		96.9	79-130		6.68	22.4	
Dichlorodifluoromethane	10.1		"	10.0		101	47.1-101		1.18	23.9	
Ethyl Benzene	10.0		"	10.0		100	80.8-128		4.28	19.2	
Hexachlorobutadiene	8.92		"	10.0		89.2	64.8-128		4.39	20.6	
Isopropylbenzene	9.01		"	10.0		90.1	75.5-135		4.77	20	
Methyl tert-butyl ether (MTBE)	8.35		"	10.0		83.5	65.1-140		10.6	23.6	
Methylene chloride	10.2		"	10.0		102	61.3-120		5.73	20.4	
Naphthalene	9.57		"	10.0		95.7	62.3-148		5.09	27.1	
n-Butylbenzene	8.80		"	10.0		88.0	67.2-123		7.02	19.1	
n-Propylbenzene	8.95		"	10.0		89.5	70.5-127		6.59	23.4	
o-Xylene	9.64		"	10.0		96.4	75.9-122		5.25	19.3	
p- & m- Xylenes	19.8		"	20.0		99.0	77.7-127		5.26	18.6	
p-Isopropyltoluene	9.23		"	10.0		92.3	75.6-129		5.99	19.1	
sec-Butylbenzene	9.45		"	10.0		94.5	71.5-125		5.15	18.9	
Styrene	10.4		"	10.0		104	77.8-123		5.97	20.9	
tert-Butylbenzene	9.31		"	10.0		93.1	75.9-151		5.84	20.9	
Tetrachloroethylene	8.98		"	10.0		89.8	63.6-167		1.33	27.7	
Toluene	10.6		"	10.0		106	77-123		11.9	18.7	
trans-1,2-Dichloroethylene	10.0		"	10.0		100	76.3-139		4.38	19.5	
trans-1,3-Dichloropropylene	11.5		"	10.0		115	72.5-137		6.17	19.3	
Trichloroethylene	9.22		"	10.0		92.2	77.9-130		4.35	20.5	
Trichlorofluoromethane	10.7		"	10.0		107	57.4-133		2.21	21.4	
Vinyl Chloride	9.75		"	10.0		97.5	54.9-124		7.03	22.3	
<i>Surrogate: 1,2-Dichloroethane-d4</i>	<i>10.9</i>		<i>"</i>	<i>10.0</i>		<i>109</i>	<i>72.6-129</i>				
<i>Surrogate: p-Bromofluorobenzene</i>	<i>9.58</i>		<i>"</i>	<i>10.0</i>		<i>95.8</i>	<i>63.5-145</i>				
<i>Surrogate: Toluene-d8</i>	<i>10.8</i>		<i>"</i>	<i>10.0</i>		<i>108</i>	<i>81.2-127</i>				



Metals by EPA 6000 Series Methods - Quality Control Data

York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG31486 - EPA 3010A											
Blank (BG31486-BLK1)											
								Prepared & Analyzed: 07/31/2013			
Iron - Dissolved	ND	0.0200	mg/L								
Reference (BG31486-SRM1)											
								Prepared & Analyzed: 07/31/2013			
Iron - Dissolved	1.36	0.0200	mg/L	1.39		98.1	88.4-113				



Metals by EPA 200 Series Methods - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG31487 - EPA 3010A											
Blank (BG31487-BLK1)								Prepared & Analyzed: 07/31/2013			
Iron	ND	0.0200	mg/L								
Duplicate (BG31487-DUP1)								*Source sample: 13G1043-01 (WQ072913:1240NP2-10) Prepared & Analyzed: 07/31/2013			
Iron	0.733	0.0200	mg/L		0.736				0.371	20	
Matrix Spike (BG31487-MS1)								*Source sample: 13G1043-01 (WQ072913:1240NP2-10) Prepared & Analyzed: 07/31/2013			
Iron	1.76	0.0200	mg/L	1.00	0.736	102	75-125				
Reference (BG31487-SRM1)								Prepared & Analyzed: 07/31/2013			
Iron	1.35	0.0200	mg/L	1.39		97.2	88.4-113				



Miscellaneous Physical/Conventional Chemistry Parameters - Quality Control Data

York Analytical Laboratories, Inc.


Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	--------------------	-------	----------------	-------------------	------	----------------	------	-----	--------------	------

Batch BH30022 - % Solids Prep

Blank (BH30022-BLK1)

Prepared: 08/01/2013 Analyzed: 08/02/2013

Total Dissolved Solids	ND	10.0	mg/L								
------------------------	----	------	------	--	--	--	--	--	--	--	--



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
13G1042-01	WQ072913:1230NP2-6	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
13G1042-02	WQ072913:1235NP2-7	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
13G1043-01	WQ072913:1240NP2-10	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C

Notes and Definitions

QL-02	This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.
J	Detected below the Reporting Limit but greater than or equal to the Method Detection Limit (MDL/LOD) or in the case of a TIC, the result is an estimated concentration.
ND	Analyte NOT DETECTED at the stated Reporting Limit (RL) or above.
RL	REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
MDL	METHOD DETECTION LIMIT - the minimum concentration that can be measured and reported with a 99% confidence that the concentration is greater than zero. If requested or required, a value reported below the RL and above the MDL is considered estimated and is noted with a "J" flag.
NR	Not reported
RPD	Relative Percent Difference
Wet	The data has been reported on an as-received (wet weight) basis
Low Bias	Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
High Bias	High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
Non-Dir.	Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the MDL, with values between the MDL and the RL being "J" flagged as estimated results.

YORK

ANALYTICAL LABORATORIES, INC.
120 RESEARCH DR. STRATFORD, CT 06515
(203) 325-1371 FAX (203) 357-0166

Field Chain-of-Custody Record

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 13G1042

Page 1 of 1

YOUR Information Company: <u>LBG</u> Address: <u>4 Research Dr Suite 301 Shelton, CT 06484</u> Phone No. <u>263-989-8555</u> Contact Person: <u>Joske Sandor</u> E-Mail Address: <u>Tsandor@lbgct.com</u>	Report To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____	Invoice To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____
YOUR Project ID APWC Industries Purchase Order No. <u>NAB5A6</u>		
Turn-Around Time <input type="checkbox"/> RUSH - Same Day <input type="checkbox"/> RUSH - Next Day <input type="checkbox"/> RUSH - Two Day <input type="checkbox"/> RUSH - Three Day <input type="checkbox"/> RUSH - Four Day <input checked="" type="checkbox"/> Standard (5-7 Days)		
Report Type Summary Report <u>X</u> pdf Summary w/ QA Summary <u>X</u> pdf CT RCP Package CT RCP DO/ADUE Pkg. NY ASP A Package NY ASP B Package <u>NE2-10-01ly</u> pdf NIJEP Red. Deliv. Electronic Data Deliverables (EDD)		

Matrix Codes: S - soil; Other - specify (oil, etc); WW - wastewater; GW - groundwater; DW - drinking water; Air-A - ambient air; Air-SV - soil vapor.

Volatiles 8260 full 624 STARS list BTEX MTBE TCL list TAGM list CT RCP list Arom. only Halog. only App. IX list 8021B list	Semi-Volils 3082PCB 8081Pest 8151Herb CT RCP App. IX Site Spec. SEL Per TCLP TCLP Pest TCLP Herb Chloroane 608 PCB SEL Per TCLP	Metals RCRAR PP13 list TAL CT15 list TAGM list NIJEP list Total Dissolved SEL Per TCLP Herb Inert/Meth LIST Below Heavy	Misc. Org. TPH GRO TPH DRO CT ETPH NY 310-13 TPH 1664 Air TO14A Air TO15 A6 STARS SEL Per TCLP Air VPH A6 TICs Methane Heptan	Full Lists Prt Poll. TCL Opains TAL MatCN Full TCLP Full App. IX Part 350-Resin Heterocyclics Part 350-Resin TOX Part 350-Resin BTU/Wh. Part 350-Resin Aromatic Tox NYJEP NYSDOC Asbestos Silica	Carcinovity Reactivity Ignitability Flash Point Sieve Anal. Heterocyclics
--	---	--	--	---	--

Examples from: CT, NY, X, NJ

Sample Identification	Date Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below	Container Description(s)
M2072913:1230NF2-6	7/29/13 1230	GW	Fe by EPA 800.71Fe, Dissolved by EPA 8070 (SW746-6018) / TOCs, P260 list (EPA SW 845-8260B) plus from 113	3V 2C
M2072913:1235NF2-7	7/29/13 1235	GW	Fe by EPA 800.71Fe, Dissolved by EPA 8070 (SW746-6018) / TOCs, P260 list (EPA SW 845-8260A) plus from 113 / TOCs (SH 2540c)	3V 2C
M2072913:1240NF2-10	7/29/13 1240	GW		3V 3C

Preservation <input checked="" type="checkbox"/> Frozen <input type="checkbox"/> HCl <input type="checkbox"/> ZnAc <input type="checkbox"/> HNO ₃ <input type="checkbox"/> NaOH <input type="checkbox"/> Other	Ascorbic Acid Microb	H ₂ O ₂ NaOH	Temperature on Receipt <u>4.3</u> °C
Comments Samples Relinquished By <u>Dolores Diaz</u> Date/Time <u>7/30/13 2:35</u> Samples Received By <u>[Signature]</u> Date/Time <u>7/30/13</u> Samples Relinquished By _____ Date/Time _____ Samples Received By _____ Date/Time _____			

YORK

ANALYTICAL LABORATORIES, INC.

120 RESEARCH DR. STRATFORD, CT 06615
(203) 325-1371 FAX (203) 357-0166

Field Chain-of-Custody Record


Page 1 of 1

NOTE: York's Std. Terms & Conditions are listed on the back side of this document.
This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 13G1043

YOUR Information Company: <u>L B G</u> Address: <u>4 Research Dr Suite 301</u> <u>Shelton, CT 06484</u> Phone No. <u>203-929-8555</u> Contact Person: <u>Tonde Sandor</u> E-Mail Address: <u>TSandor@LBGI.com</u>		Report To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____		Invoice To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____		YOUR Project ID <u>Rowe Industries.</u> Purchase Order No. <u>NABSA6.</u>		Turn-Around Time RUSH - Same Day <input type="checkbox"/> RUSH - Next Day <input type="checkbox"/> RUSH - Two Day <input type="checkbox"/> RUSH - Three Day <input type="checkbox"/> RUSH - Four Day <input type="checkbox"/> Standard (5-7 Days) <input checked="" type="checkbox"/>		Report Type Summary Report <input checked="" type="checkbox"/> <u>pdf</u> Summary w/ QA Summary <input checked="" type="checkbox"/> <u>pdf</u> CT RCP Package <input type="checkbox"/> CT RCP DOA/DUE Pkg <input type="checkbox"/> NY ASP A Package <input type="checkbox"/> NY ASP B Package <input checked="" type="checkbox"/> <u>to only</u> , <u>pdf.</u> NIDEP Red. Deliv. <input type="checkbox"/>			
Matrix Codes S - soil Other - specify (oil, etc) WW - wastewater GW - groundwater DW - drinking water Air-A - ambient air Air-SV - soil vapor		Volatiles 8260 full 624 STARS list BTEX MTBE TCL list TAGM list CT RCP list Acrom. only 502.2 Halog. only App. IX list 8021B list		Sem. Vols., Pesticides 8270 & 625 STARS list BN Only Acids Only PAH list TAGM list CT RCP list TCL list NIDEP list Acrom. only Halog. only App. IX list 8021B list		Metals RCRA8 PP 13 list TAL CT 15 list TAGM list NIDEP list Total SFP Per TCLP Herb Chloridane 608 Pest TCLP BNA SFP Per TCLP		Misc. Org. TPH GRO TPH DRO CT EPH NY 310-13 TPH 1664 Air TO14A Air TO15 Air STARS Dissolved SFP Per TCLP Inert Metals LIST Below		Full Lists PH Poll. TCL Ogases TAL MecCN Full TCLP Full App. IX Part 360 Residue Air TO14A Part 360 Residue TOX BTU/b. Part 360 Residue Part 360 Residue NY CDEP TOC NYSDOC Clear Asbestos TAGM Silica		Container Description(s) <u>3v 2p</u> <u>3v 2p</u> <u>3v 3p</u>	
Choose Analyses Needed from the Menu Above and Enter Below													
Sample Identification <u>WQ072913:1230NP2-6</u> <u>WQ072913:1235NP2-7</u> <u>WQ072913:1240NP2-10</u>		Date Sampled <u>7/29/13 1230</u> <u>1235</u> <u>1240</u>		Sample Matrix GW GW GW		Comments Fe by EPA 800-71 Fe, Dissolved by EPA 6010 (SW 846-0100) / VOCs P260 List (EPA SW 846-8260b) plus from 113 Fe by EPA 800-71 Fe, Dissolved by EPA 6010 (SW 846-0100) / VOCs P260 List (EPA SW 846-8260b) plus from 113 / TD.S (SH 2540C)		Preservation Check those Applicable Special Instructions Field Filtered <input type="checkbox"/> Lab to Filter <input type="checkbox"/>		Temperature on Receipt <u>4.3 °C</u>			

APPENDIX II
JULY 2013 LABORATORY ANALYTICAL REPORTS
FOR FSP&T AND FP&T RECOVERY WELLS



Technical Report

prepared for:

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301

Shelton CT, 06484

Attention: Tunde Komuves-Sandor

Report Date: 08/01/2013

Client Project ID: O&M Sag Harbor (Rowe Industries Site)

York Project (SDG) No.: 13G0913

CT Cert. No. PH-0723

New Jersey Cert. No. CT-005



New York Cert. No. 10854

PA Cert. No. 68-04440

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on July 25, 2013 and listed below. The project was identified as your project: **O&M Sag Harbor (Rowe Industries Site)**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Notes section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the attachment to this report, and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
13G0913-01	WQ072313:1130 FRW1	Water	07/23/2013	07/25/2013
13G0913-02	WQ072313:1135 FRW2	Water	07/23/2013	07/25/2013
13G0913-03	WQ072313:1140 FRW3	Water	07/23/2013	07/25/2013
13G0913-04	WQ072313:1145 FRW4	Water	07/23/2013	07/25/2013

General Notes for York Project (SDG) No.: 13G0913

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All samples were received in proper condition for analysis with proper documentation, unless otherwise noted.
6. All analyses conducted met method or Laboratory SOP requirements. See the Qualifiers and/or Narrative sections for further information.
7. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
8. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 08/01/2013

YORK



Sample Information

Client Sample ID: WQ072313:1130 FRW1

York Sample ID: 13G0913-01

York Project (SDG) No.
13G0913

Client Project ID
O&M Sag Harbor (Rowe Industries Site)

Matrix
Water

Collection Date/Time
July 23, 2013 11:30 am

Date Received
07/25/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
71-55-6	1,1,1-Trichloroethane	0.52		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
75-34-3	1,1-Dichloroethane	0.22	J	ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS



Sample Information

Client Sample ID: WQ072313:1130 FRW1

York Sample ID: 13G0913-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0913

O&M Sag Harbor (Rowe Industries Site)

Water

July 23, 2013 11:30 am

07/25/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
156-59-2	cis-1,2-Dichloroethylene	27		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
127-18-4	Tetrachloroethylene	77		ug/L	1.0	2.5	5	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 13:52	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
79-01-6	Trichloroethylene	6.2		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 22:45	SS



Sample Information

Client Sample ID: WQ072313:1130 FRW1

York Sample ID: 13G0913-01

York Project (SDG) No. 13G0913 **Client Project ID** O&M Sag Harbor (Rowe Industries Site) **Matrix** Water **Collection Date/Time** July 23, 2013 11:30 am **Date Received** 07/25/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Surrogate Recoveries	Result									
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	106 %			72.6-129						
460-00-4	Surrogate: p-Bromofluorobenzene	95.1 %			63.5-145						
2037-26-5	Surrogate: Toluene-d8	110 %			81.2-127						

Sample Information

Client Sample ID: WQ072313:1135 FRW2

York Sample ID: 13G0913-02

York Project (SDG) No. 13G0913 **Client Project ID** O&M Sag Harbor (Rowe Industries Site) **Matrix** Water **Collection Date/Time** July 23, 2013 11:35 am **Date Received** 07/25/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
76-13-1	1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS



Sample Information

Client Sample ID: WQ072313:1135 FRW2

York Sample ID: 13G0913-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0913

O&M Sag Harbor (Rowe Industries Site)

Water

July 23, 2013 11:35 am

07/25/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
67-64-1	Acetone	3.8		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
156-59-2	cis-1,2-Dichloroethylene	17		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS



Sample Information

Client Sample ID: WQ072313:1135 FRW2

York Sample ID: 13G0913-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0913

O&M Sag Harbor (Rowe Industries Site)

Water

July 23, 2013 11:35 am

07/25/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
127-18-4	Tetrachloroethylene	28		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
79-01-6	Trichloroethylene	3.1		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
75-01-4	Vinyl Chloride	2.2		ug/L	0.50	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/29/2013 10:45	07/29/2013 23:24	SS
	Surrogate Recoveries	Result			Acceptance Range						
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	105 %			72.6-129						
460-00-4	Surrogate: p-Bromofluorobenzene	96.6 %			63.5-145						
2037-26-5	Surrogate: Toluene-d8	109 %			81.2-127						

Sample Information

Client Sample ID: WQ072313:1140 FRW3

York Sample ID: 13G0913-03

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0913

O&M Sag Harbor (Rowe Industries Site)

Water

July 23, 2013 11:40 am

07/25/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
71-55-6	1,1,1-Trichloroethane	0.42	J	ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
75-34-3	1,1-Dichloroethane	0.28	J	ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS



Sample Information

Client Sample ID: WQ072313:1140 FRW3

York Sample ID: 13G0913-03

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0913

O&M Sag Harbor (Rowe Industries Site)

Water

July 23, 2013 11:40 am

07/25/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
156-59-2	cis-1,2-Dichloroethylene	35		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS



Sample Information

Client Sample ID: WQ072313:1140 FRW3

York Sample ID: 13G0913-03

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0913

O&M Sag Harbor (Rowe Industries Site)

Water

July 23, 2013 11:40 am

07/25/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
98-82-8	Isopropylbenzene	0.95		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
103-65-1	n-Propylbenzene	0.62		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
127-18-4	Tetrachloroethylene	52		ug/L	1.0	2.5	5	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 14:30	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
79-01-6	Trichloroethylene	9.6		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
75-01-4	Vinyl Chloride	2.4		ug/L	0.50	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:03	SS
	Surrogate Recoveries	Result			Acceptance Range						
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	108 %			72.6-129						
460-00-4	Surrogate: p-Bromofluorobenzene	97.2 %			63.5-145						
2037-26-5	Surrogate: Toluene-d8	113 %			81.2-127						

Sample Information

Client Sample ID: WQ072313:1145 FRW4

York Sample ID: 13G0913-04

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0913

O&M Sag Harbor (Rowe Industries Site)

Water

July 23, 2013 11:45 am

07/25/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:



Sample Information

Client Sample ID: WQ072313:1145 FRW4

York Sample ID: 13G0913-04

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0913

O&M Sag Harbor (Rowe Industries Site)

Water

July 23, 2013 11:45 am

07/25/2013

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
71-55-6	1,1,1-Trichloroethane	0.69		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
67-64-1	Acetone	2.7		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS



Sample Information

Client Sample ID: WQ072313:1145 FRW4

York Sample ID: 13G0913-04

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0913

O&M Sag Harbor (Rowe Industries Site)

Water

July 23, 2013 11:45 am

07/25/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
156-59-2	cis-1,2-Dichloroethylene	4.9		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
127-18-4	Tetrachloroethylene	27		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
79-01-6	Trichloroethylene	4.9		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 00:43	SS

Surrogate Recoveries

Result

Acceptance Range

17060-07-0 *Surrogate: 1,2-Dichloroethane-d4*


104 %

72.6-129

460-00-4 *Surrogate: p-Bromofluorobenzene*

95.9 %

63.5-145



Sample Information

Client Sample ID: WQ072313:1145 FRW4

York Sample ID: 13G0913-04

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0913

O&M Sag Harbor (Rowe Industries Site)

Water

July 23, 2013 11:45 am

07/25/2013


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
2037-26-5	Surrogate: Toluene-d8	123 %			81.2-127						



Analytical Batch Summary

Batch ID: BG31324

Preparation Method: EPA 5030B

Prepared By: KH

YORK Sample ID	Client Sample ID	Preparation Date
13G0913-01	WQ072313:1130 FRW1	07/29/13
13G0913-02	WQ072313:1135 FRW2	07/29/13
13G0913-03	WQ072313:1140 FRW3	07/29/13
13G0913-04	WQ072313:1145 FRW4	07/29/13
BG31324-BLK1	Blank	07/29/13
BG31324-BS1	LCS	07/29/13
BG31324-BSD1	LCS Dup	07/29/13

Batch ID: BG31376

Preparation Method: EPA 5030B

Prepared By: EKM

YORK Sample ID	Client Sample ID	Preparation Date
13G0913-01RE1	WQ072313:1130 FRW1	07/30/13
13G0913-03RE1	WQ072313:1140 FRW3	07/30/13
BG31376-BLK1	Blank	07/30/13
BG31376-BS1	LCS	07/30/13
BG31376-BSD1	LCS Dup	07/30/13



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31324 - EPA 5030B

Blank (BG31324-BLK1)

Prepared & Analyzed: 07/29/2013

1,1,1,2-Tetrachloroethane	ND	0.50	ug/L								
1,1,1-Trichloroethane	ND	0.50	"								
1,1,2,2-Tetrachloroethane	ND	0.50	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.50	"								
1,1,2-Trichloroethane	ND	0.50	"								
1,1-Dichloroethane	ND	0.50	"								
1,1-Dichloroethylene	ND	0.50	"								
1,1-Dichloropropylene	ND	0.50	"								
1,2,3-Trichlorobenzene	ND	2.0	"								
1,2,3-Trichloropropane	ND	0.50	"								
1,2,4-Trichlorobenzene	ND	2.0	"								
1,2,4-Trimethylbenzene	ND	0.50	"								
1,2-Dibromo-3-chloropropane	ND	2.0	"								
1,2-Dibromoethane	ND	0.50	"								
1,2-Dichlorobenzene	ND	0.50	"								
1,2-Dichloroethane	ND	0.50	"								
1,2-Dichloropropane	ND	0.50	"								
1,3,5-Trimethylbenzene	ND	0.50	"								
1,3-Dichlorobenzene	ND	0.50	"								
1,3-Dichloropropane	ND	0.50	"								
1,4-Dichlorobenzene	ND	0.50	"								
2,2-Dichloropropane	ND	0.50	"								
2-Chlorotoluene	ND	0.50	"								
2-Hexanone	ND	0.50	"								
4-Chlorotoluene	ND	0.50	"								
Acetone	ND	2.0	"								
Benzene	ND	0.50	"								
Bromobenzene	ND	0.50	"								
Bromochloromethane	ND	0.50	"								
Bromodichloromethane	ND	0.50	"								
Bromoform	ND	0.50	"								
Bromomethane	ND	0.50	"								
Carbon tetrachloride	ND	0.50	"								
Chlorobenzene	ND	0.50	"								
Chloroethane	ND	0.50	"								
Chloroform	ND	0.50	"								
Chloromethane	ND	0.50	"								
cis-1,2-Dichloroethylene	ND	0.50	"								
cis-1,3-Dichloropropylene	ND	0.50	"								
Dibromochloromethane	ND	0.50	"								
Dibromomethane	ND	0.50	"								
Dichlorodifluoromethane	ND	0.50	"								
Ethyl Benzene	ND	0.50	"								
Hexachlorobutadiene	ND	0.50	"								
Isopropylbenzene	ND	0.50	"								
Methyl tert-butyl ether (MTBE)	ND	0.50	"								
Methylene chloride	ND	2.0	"								
Naphthalene	ND	2.0	"								
n-Butylbenzene	ND	0.50	"								
n-Propylbenzene	ND	0.50	"								
o-Xylene	ND	0.50	"								



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	Flag
		Limit			Result					RPD	

Batch BG31324 - EPA 5030B

Blank (BG31324-BLK1)

Prepared & Analyzed: 07/29/2013

p- & m- Xylenes	ND	1.0	ug/L								
p-Isopropyltoluene	ND	0.50	"								
sec-Butylbenzene	ND	0.50	"								
Styrene	ND	0.50	"								
tert-Butylbenzene	ND	0.50	"								
Tetrachloroethylene	ND	0.50	"								
Toluene	ND	0.50	"								
trans-1,2-Dichloroethylene	ND	0.50	"								
trans-1,3-Dichloropropylene	ND	0.50	"								
Trichloroethylene	ND	0.50	"								
Trichlorofluoromethane	ND	0.50	"								
Vinyl Chloride	ND	0.50	"								
Xylenes, Total	ND	1.5	"								

Surrogate: 1,2-Dichloroethane-d4

10.9 " 10.0 109 72.6-129

Surrogate: p-Bromofluorobenzene

9.32 " 10.0 93.2 63.5-145

Surrogate: Toluene-d8

10.6 " 10.0 106 81.2-127

LCS (BG31324-BS1)

Prepared & Analyzed: 07/29/2013

1,1,1,2-Tetrachloroethane	10.8		ug/L	10.0	108	82.3-130
1,1,1-Trichloroethane	10.8		"	10.0	108	75.6-137
1,1,2,2-Tetrachloroethane	10.2		"	10.0	102	71.3-131
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.0		"	10.0	100	71.1-129
1,1,2-Trichloroethane	10.5		"	10.0	105	74.5-129
1,1-Dichloroethane	9.93		"	10.0	99.3	79.6-132
1,1-Dichloroethylene	9.27		"	10.0	92.7	80.2-146
1,1-Dichloropropylene	9.50		"	10.0	95.0	75-136
1,2,3-Trichlorobenzene	9.58		"	10.0	95.8	66.1-136
1,2,3-Trichloropropane	10.1		"	10.0	101	63-131
1,2,4-Trichlorobenzene	9.66		"	10.0	96.6	70.6-136
1,2,4-Trimethylbenzene	10.0		"	10.0	100	75.3-135
1,2-Dibromo-3-chloropropane	10.5		"	10.0	105	58.9-140
1,2-Dibromoethane	11.4		"	10.0	114	79-130
1,2-Dichlorobenzene	9.62		"	10.0	96.2	76.1-122
1,2-Dichloroethane	9.88		"	10.0	98.8	74.6-132
1,2-Dichloropropane	9.17		"	10.0	91.7	76.9-129
1,3,5-Trimethylbenzene	9.97		"	10.0	99.7	70.6-127
1,3-Dichlorobenzene	9.87		"	10.0	98.7	77-124
1,3-Dichloropropane	10.5		"	10.0	105	75.8-126
1,4-Dichlorobenzene	9.89		"	10.0	98.9	76.6-125
2,2-Dichloropropane	11.0		"	10.0	110	69-133
2-Chlorotoluene	9.60		"	10.0	96.0	66.3-119
2-Hexanone	10.7		"	10.0	107	70-130
4-Chlorotoluene	9.90		"	10.0	99.0	69.2-127
Acetone	9.04		"	10.0	90.4	70-130
Benzene	9.64		"	10.0	96.4	76.2-129
Bromobenzene	9.88		"	10.0	98.8	71.3-123
Bromochloromethane	9.80		"	10.0	98.0	70.8-137
Bromodichloromethane	10.1		"	10.0	101	79.7-134
Bromoform	11.8		"	10.0	118	70.5-141
Bromomethane	7.90		"	10.0	79.0	43.9-147
Carbon tetrachloride	12.0		"	10.0	120	78.1-138
Chlorobenzene	9.73		"	10.0	97.3	80.4-125



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike Level	Source*	%REC	%REC Limits	Flag	RPD	RPD	Flag
		Limit			Result					Limit	

Batch BG31324 - EPA 5030B

LCS (BG31324-BS1)

Prepared & Analyzed: 07/29/2013

Chloroethane	9.00		ug/L	10.0		90.0	55.8-140				
Chloroform	10.1		"	10.0		101	76.6-133				
Chloromethane	7.86		"	10.0		78.6	48.8-115				
cis-1,2-Dichloroethylene	9.69		"	10.0		96.9	75.1-128				
cis-1,3-Dichloropropylene	10.5		"	10.0		105	74.5-128				
Dibromochloromethane	12.5		"	10.0		125	79.8-134				
Dibromomethane	9.76		"	10.0		97.6	79-130				
Dichlorodifluoromethane	7.83		"	10.0		78.3	47.1-101				
Ethyl Benzene	10.2		"	10.0		102	80.8-128				
Hexachlorobutadiene	10.1		"	10.0		101	64.8-128				
Isopropylbenzene	10.0		"	10.0		100	75.5-135				
Methyl tert-butyl ether (MTBE)	9.76		"	10.0		97.6	65.1-140				
Methylene chloride	9.30		"	10.0		93.0	61.3-120				
Naphthalene	9.89		"	10.0		98.9	62.3-148				
n-Butylbenzene	9.58		"	10.0		95.8	67.2-123				
n-Propylbenzene	9.84		"	10.0		98.4	70.5-127				
o-Xylene	9.58		"	10.0		95.8	75.9-122				
p- & m- Xylenes	19.8		"	20.0		99.2	77.7-127				
p-Isopropyltoluene	10.2		"	10.0		102	75.6-129				
sec-Butylbenzene	10.2		"	10.0		102	71.5-125				
Styrene	10.2		"	10.0		102	77.8-123				
tert-Butylbenzene	10.4		"	10.0		104	75.9-151				
Tetrachloroethylene	9.67		"	10.0		96.7	63.6-167				
Toluene	10.4		"	10.0		104	77-123				
trans-1,2-Dichloroethylene	9.45		"	10.0		94.5	76.3-139				
trans-1,3-Dichloropropylene	12.1		"	10.0		121	72.5-137				
Trichloroethylene	9.36		"	10.0		93.6	77.9-130				
Trichlorofluoromethane	10.0		"	10.0		100	57.4-133				
Vinyl Chloride	8.66		"	10.0		86.6	54.9-124				
Surrogate: 1,2-Dichloroethane-d4	10.0		"	10.0		100	72.6-129				
Surrogate: p-Bromofluorobenzene	10.3		"	10.0		103	63.5-145				
Surrogate: Toluene-d8	9.95		"	10.0		99.5	81.2-127				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG31324 - EPA 5030B											
LCS Dup (BG31324-BS1)											
Prepared & Analyzed: 07/29/2013											
1,1,1,2-Tetrachloroethane	10.8		ug/L	10.0		108	82.3-130		0.647	21.1	
1,1,1-Trichloroethane	11.0		"	10.0		110	75.6-137		2.20	19.7	
1,1,2,2-Tetrachloroethane	9.97		"	10.0		99.7	71.3-131		1.79	20.8	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	9.82		"	10.0		98.2	71.1-129		2.02	21.7	
1,1,2-Trichloroethane	10.7		"	10.0		107	74.5-129		1.51	20.3	
1,1-Dichloroethane	9.83		"	10.0		98.3	79.6-132		1.01	20.6	
1,1-Dichloroethylene	9.29		"	10.0		92.9	80.2-146		0.216	20	
1,1-Dichloropropylene	9.43		"	10.0		94.3	75-136		0.740	19.3	
1,2,3-Trichlorobenzene	9.95		"	10.0		99.5	66.1-136		3.79	21.6	
1,2,3-Trichloropropane	10.3		"	10.0		103	63-131		2.07	23.9	
1,2,4-Trichlorobenzene	9.85		"	10.0		98.5	70.6-136		1.95	21.7	
1,2,4-Trimethylbenzene	9.65		"	10.0		96.5	75.3-135		3.76	18.8	
1,2-Dibromo-3-chloropropane	9.96		"	10.0		99.6	58.9-140		5.09	27.7	
1,2-Dibromoethane	11.5		"	10.0		115	79-130		0.523	23	
1,2-Dichlorobenzene	9.43		"	10.0		94.3	76.1-122		1.99	19.8	
1,2-Dichloroethane	10.2		"	10.0		102	74.6-132		3.19	20.2	
1,2-Dichloropropane	10.8		"	10.0		108	76.9-129		16.3	20.7	
1,3,5-Trimethylbenzene	9.62		"	10.0		96.2	70.6-127		3.57	18.9	
1,3-Dichlorobenzene	9.75		"	10.0		97.5	77-124		1.22	19.2	
1,3-Dichloropropane	10.5		"	10.0		105	75.8-126		0.285	22.1	
1,4-Dichlorobenzene	9.73		"	10.0		97.3	76.6-125		1.63	18.6	
2,2-Dichloropropane	10.7		"	10.0		107	69-133		2.30	19.8	
2-Chlorotoluene	9.24		"	10.0		92.4	66.3-119		3.82	21.6	
2-Hexanone	10.9		"	10.0		109	70-130		2.59	30	
4-Chlorotoluene	9.51		"	10.0		95.1	69.2-127		4.02	19	
Acetone	9.42		"	10.0		94.2	70-130		4.12	30	
Benzene	9.70		"	10.0		97.0	76.2-129		0.620	19	
Bromobenzene	9.62		"	10.0		96.2	71.3-123		2.67	20.3	
Bromochloromethane	9.94		"	10.0		99.4	70.8-137		1.42	23.9	
Bromodichloromethane	11.3		"	10.0		113	79.7-134		10.6	21	
Bromoform	11.9		"	10.0		119	70.5-141		1.35	21.8	
Bromomethane	8.12		"	10.0		81.2	43.9-147		2.75	28.4	
Carbon tetrachloride	12.2		"	10.0		122	78.1-138		1.74	20.1	
Chlorobenzene	9.59		"	10.0		95.9	80.4-125		1.45	19.9	
Chloroethane	8.42		"	10.0		84.2	55.8-140		6.66	23.3	
Chloroform	10.2		"	10.0		102	76.6-133		0.985	20.3	
Chloromethane	7.66		"	10.0		76.6	48.8-115		2.58	24.5	
cis-1,2-Dichloroethylene	9.57		"	10.0		95.7	75.1-128		1.25	20.5	
cis-1,3-Dichloropropylene	12.4		"	10.0		124	74.5-128		16.2	19.9	
Dibromochloromethane	13.5		"	10.0		135	79.8-134	High Bias	7.40	21.3	
Dibromomethane	11.2		"	10.0		112	79-130		13.8	22.4	
Dichlorodifluoromethane	7.97		"	10.0		79.7	47.1-101		1.77	23.9	
Ethyl Benzene	9.94		"	10.0		99.4	80.8-128		2.78	19.2	
Hexachlorobutadiene	9.94		"	10.0		99.4	64.8-128		1.70	20.6	
Isopropylbenzene	9.58		"	10.0		95.8	75.5-135		4.39	20	
Methyl tert-butyl ether (MTBE)	11.0		"	10.0		110	65.1-140		11.9	23.6	
Methylene chloride	9.37		"	10.0		93.7	61.3-120		0.750	20.4	
Naphthalene	10.5		"	10.0		105	62.3-148		6.08	27.1	
n-Butylbenzene	9.27		"	10.0		92.7	67.2-123		3.29	19.1	
n-Propylbenzene	9.41		"	10.0		94.1	70.5-127		4.47	23.4	
o-Xylene	9.47		"	10.0		94.7	75.9-122		1.15	19.3	



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	RPD	Limit	Flag
		Limit			Result					Limit			

Batch BG31324 - EPA 5030B

LCS Dup (BG31324-BSD1)

Prepared & Analyzed: 07/29/2013

p- & m- Xylenes	19.4		ug/L	20.0		97.0	77.7-127			2.34	18.6		
p-Isopropyltoluene	9.85		"	10.0		98.5	75.6-129			3.59	19.1		
sec-Butylbenzene	9.86		"	10.0		98.6	71.5-125			3.78	18.9		
Styrene	10.1		"	10.0		101	77.8-123			1.58	20.9		
tert-Butylbenzene	9.90		"	10.0		99.0	75.9-151			5.12	20.9		
Tetrachloroethylene	9.32		"	10.0		93.2	63.6-167			3.69	27.7		
Toluene	10.5		"	10.0		105	77-123			0.954	18.7		
trans-1,2-Dichloroethylene	9.33		"	10.0		93.3	76.3-139			1.28	19.5		
trans-1,3-Dichloropropylene	12.5		"	10.0		125	72.5-137			3.42	19.3		
Trichloroethylene	8.82		"	10.0		88.2	77.9-130			5.94	20.5		
Trichlorofluoromethane	10.2		"	10.0		102	57.4-133			1.58	21.4		
Vinyl Chloride	8.45		"	10.0		84.5	54.9-124			2.45	22.3		
<i>Surrogate: 1,2-Dichloroethane-d4</i>	<i>10.4</i>		<i>"</i>	<i>10.0</i>		<i>104</i>	<i>72.6-129</i>						
<i>Surrogate: p-Bromofluorobenzene</i>	<i>10.0</i>		<i>"</i>	<i>10.0</i>		<i>100</i>	<i>63.5-145</i>						
<i>Surrogate: Toluene-d8</i>	<i>11.0</i>		<i>"</i>	<i>10.0</i>		<i>110</i>	<i>81.2-127</i>						

Batch BG31376 - EPA 5030B

Blank (BG31376-BLK1)

Prepared & Analyzed: 07/30/2013

1,1,1,2-Tetrachloroethane	ND	0.50	ug/L										
1,1,1-Trichloroethane	ND	0.50	"										
1,1,2,2-Tetrachloroethane	ND	0.50	"										
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.50	"										
1,1,2-Trichloroethane	ND	0.50	"										
1,1-Dichloroethane	ND	0.50	"										
1,1-Dichloroethylene	ND	0.50	"										
1,1-Dichloropropylene	ND	0.50	"										
1,2,3-Trichlorobenzene	ND	2.0	"										
1,2,3-Trichloropropane	ND	0.50	"										
1,2,4-Trichlorobenzene	ND	2.0	"										
1,2,4-Trimethylbenzene	ND	0.50	"										
1,2-Dibromo-3-chloropropane	ND	2.0	"										
1,2-Dibromoethane	ND	0.50	"										
1,2-Dichlorobenzene	ND	0.50	"										
1,2-Dichloroethane	ND	0.50	"										
1,2-Dichloropropane	ND	0.50	"										
1,3,5-Trimethylbenzene	ND	0.50	"										
1,3-Dichlorobenzene	ND	0.50	"										
1,3-Dichloropropane	ND	0.50	"										
1,4-Dichlorobenzene	ND	0.50	"										
2,2-Dichloropropane	ND	0.50	"										
2-Chlorotoluene	ND	0.50	"										
2-Hexanone	ND	0.50	"										
4-Chlorotoluene	ND	0.50	"										
Acetone	ND	2.0	"										
Benzene	ND	0.50	"										
Bromobenzene	ND	0.50	"										
Bromochloromethane	ND	0.50	"										
Bromodichloromethane	ND	0.50	"										
Bromoform	ND	0.50	"										
Bromomethane	ND	0.50	"										
Carbon tetrachloride	ND	0.50	"										



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31376 - EPA 5030B

Blank (BG31376-BLK1)

Prepared & Analyzed: 07/30/2013

Chlorobenzene	ND	0.50	ug/L								
Chloroethane	ND	0.50	"								
Chloroform	ND	0.50	"								
Chloromethane	ND	0.50	"								
cis-1,2-Dichloroethylene	ND	0.50	"								
cis-1,3-Dichloropropylene	ND	0.50	"								
Dibromochloromethane	ND	0.50	"								
Dibromomethane	ND	0.50	"								
Dichlorodifluoromethane	ND	0.50	"								
Ethyl Benzene	ND	0.50	"								
Hexachlorobutadiene	ND	0.50	"								
Isopropylbenzene	ND	0.50	"								
Methyl tert-butyl ether (MTBE)	ND	0.50	"								
Methylene chloride	ND	2.0	"								
Naphthalene	ND	2.0	"								
n-Butylbenzene	ND	0.50	"								
n-Propylbenzene	ND	0.50	"								
o-Xylene	ND	0.50	"								
p- & m- Xylenes	ND	1.0	"								
p-Isopropyltoluene	ND	0.50	"								
sec-Butylbenzene	ND	0.50	"								
Styrene	ND	0.50	"								
tert-Butylbenzene	ND	0.50	"								
Tetrachloroethylene	ND	0.50	"								
Toluene	ND	0.50	"								
trans-1,2-Dichloroethylene	ND	0.50	"								
trans-1,3-Dichloropropylene	ND	0.50	"								
Trichloroethylene	ND	0.50	"								
Trichlorofluoromethane	ND	0.50	"								
Vinyl Chloride	ND	0.50	"								
Xylenes, Total	ND	1.5	"								
<hr/>											
Surrogate: 1,2-Dichloroethane-d4	10.2		"	10.0		102	72.6-129				
Surrogate: p-Bromofluorobenzene	9.32		"	10.0		93.2	63.5-145				
Surrogate: Toluene-d8	9.57		"	10.0		95.7	81.2-127				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Spike	Source*	%REC	%REC	Limits	Flag	RPD	RPD	
		Limit								Units	Level

Batch BG31376 - EPA 5030B

LCS (BG31376-BS1)

Prepared & Analyzed: 07/30/2013

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	Limits	Flag	RPD	RPD Limit	Flag
1,1,1,2-Tetrachloroethane	9.79		ug/L	10.0		97.9	82.3-130				
1,1,1-Trichloroethane	9.82		"	10.0		98.2	75.6-137				
1,1,2,2-Tetrachloroethane	9.34		"	10.0		93.4	71.3-131				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	9.34		"	10.0		93.4	71.1-129				
1,1,2-Trichloroethane	8.65		"	10.0		86.5	74.5-129				
1,1-Dichloroethane	9.47		"	10.0		94.7	79.6-132				
1,1-Dichloroethylene	8.90		"	10.0		89.0	80.2-146				
1,1-Dichloropropylene	8.87		"	10.0		88.7	75-136				
1,2,3-Trichlorobenzene	9.23		"	10.0		92.3	66.1-136				
1,2,3-Trichloropropane	8.99		"	10.0		89.9	63-131				
1,2,4-Trichlorobenzene	9.41		"	10.0		94.1	70.6-136				
1,2,4-Trimethylbenzene	9.34		"	10.0		93.4	75.3-135				
1,2-Dibromo-3-chloropropane	9.76		"	10.0		97.6	58.9-140				
1,2-Dibromoethane	10.2		"	10.0		102	79-130				
1,2-Dichlorobenzene	9.25		"	10.0		92.5	76.1-122				
1,2-Dichloroethane	9.38		"	10.0		93.8	74.6-132				
1,2-Dichloropropane	9.29		"	10.0		92.9	76.9-129				
1,3,5-Trimethylbenzene	9.12		"	10.0		91.2	70.6-127				
1,3-Dichlorobenzene	9.35		"	10.0		93.5	77-124				
1,3-Dichloropropane	9.64		"	10.0		96.4	75.8-126				
1,4-Dichlorobenzene	9.32		"	10.0		93.2	76.6-125				
2,2-Dichloropropane	10.6		"	10.0		106	69-133				
2-Chlorotoluene	8.94		"	10.0		89.4	66.3-119				
2-Hexanone	9.93		"	10.0		99.3	70-130				
4-Chlorotoluene	9.11		"	10.0		91.1	69.2-127				
Acetone	9.71		"	10.0		97.1	70-130				
Benzene	9.60		"	10.0		96.0	76.2-129				
Bromobenzene	9.05		"	10.0		90.5	71.3-123				
Bromochloromethane	9.75		"	10.0		97.5	70.8-137				
Bromodichloromethane	9.91		"	10.0		99.1	79.7-134				
Bromoform	10.0		"	10.0		100	70.5-141				
Bromomethane	8.61		"	10.0		86.1	43.9-147				
Carbon tetrachloride	9.91		"	10.0		99.1	78.1-138				
Chlorobenzene	9.22		"	10.0		92.2	80.4-125				
Chloroethane	8.76		"	10.0		87.6	55.8-140				
Chloroform	9.62		"	10.0		96.2	76.6-133				
Chloromethane	7.99		"	10.0		79.9	48.8-115				
cis-1,2-Dichloroethylene	9.39		"	10.0		93.9	75.1-128				
cis-1,3-Dichloropropylene	10.5		"	10.0		105	74.5-128				
Dibromochloromethane	11.1		"	10.0		111	79.8-134				
Dibromomethane	9.77		"	10.0		97.7	79-130				
Dichlorodifluoromethane	6.67		"	10.0		66.7	47.1-101				
Ethyl Benzene	9.78		"	10.0		97.8	80.8-128				
Hexachlorobutadiene	9.14		"	10.0		91.4	64.8-128				
Isopropylbenzene	9.16		"	10.0		91.6	75.5-135				
Methyl tert-butyl ether (MTBE)	10.5		"	10.0		105	65.1-140				
Methylene chloride	9.37		"	10.0		93.7	61.3-120				
Naphthalene	9.60		"	10.0		96.0	62.3-148				
n-Butylbenzene	9.05		"	10.0		90.5	67.2-123				
n-Propylbenzene	9.16		"	10.0		91.6	70.5-127				
o-Xylene	9.41		"	10.0		94.1	75.9-122				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31376 - EPA 5030B

LCS (BG31376-BS1)

Prepared & Analyzed: 07/30/2013

p- & m- Xylenes	19.5		ug/L	20.0		97.4	77.7-127				
p-Isopropyltoluene	9.43		"	10.0		94.3	75.6-129				
sec-Butylbenzene	9.46		"	10.0		94.6	71.5-125				
Styrene	10.0		"	10.0		100	77.8-123				
tert-Butylbenzene	9.35		"	10.0		93.5	75.9-151				
Tetrachloroethylene	8.39		"	10.0		83.9	63.6-167				
Toluene	9.09		"	10.0		90.9	77-123				
trans-1,2-Dichloroethylene	9.28		"	10.0		92.8	76.3-139				
trans-1,3-Dichloropropylene	10.4		"	10.0		104	72.5-137				
Trichloroethylene	9.06		"	10.0		90.6	77.9-130				
Trichlorofluoromethane	9.38		"	10.0		93.8	57.4-133				
Vinyl Chloride	8.51		"	10.0		85.1	54.9-124				
<i>Surrogate: 1,2-Dichloroethane-d4</i>	<i>10.1</i>		<i>"</i>	<i>10.0</i>		<i>101</i>	<i>72.6-129</i>				
<i>Surrogate: p-Bromofluorobenzene</i>	<i>9.92</i>		<i>"</i>	<i>10.0</i>		<i>99.2</i>	<i>63.5-145</i>				
<i>Surrogate: Toluene-d8</i>	<i>9.61</i>		<i>"</i>	<i>10.0</i>		<i>96.1</i>	<i>81.2-127</i>				

LCS Dup (BG31376-BS1)

Prepared & Analyzed: 07/30/2013

1,1,1,2-Tetrachloroethane	10.7		ug/L	10.0		107	82.3-130		9.07	21.1	
1,1,1-Trichloroethane	10.7		"	10.0		107	75.6-137		8.58	19.7	
1,1,2,2-Tetrachloroethane	11.2		"	10.0		112	71.3-131		18.6	20.8	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	9.76		"	10.0		97.6	71.1-129		4.40	21.7	
1,1,2-Trichloroethane	9.87		"	10.0		98.7	74.5-129		13.2	20.3	
1,1-Dichloroethane	9.97		"	10.0		99.7	79.6-132		5.14	20.6	
1,1-Dichloroethylene	9.47		"	10.0		94.7	80.2-146		6.21	20	
1,1-Dichloropropylene	9.57		"	10.0		95.7	75-136		7.59	19.3	
1,2,3-Trichlorobenzene	10.7		"	10.0		107	66.1-136		14.6	21.6	
1,2,3-Trichloropropane	11.0		"	10.0		110	63-131		20.3	23.9	
1,2,4-Trichlorobenzene	10.6		"	10.0		106	70.6-136		11.7	21.7	
1,2,4-Trimethylbenzene	10.0		"	10.0		100	75.3-135		7.32	18.8	
1,2-Dibromo-3-chloropropane	11.6		"	10.0		116	58.9-140		17.6	27.7	
1,2-Dibromoethane	10.9		"	10.0		109	79-130		6.73	23	
1,2-Dichlorobenzene	10.3		"	10.0		103	76.1-122		10.7	19.8	
1,2-Dichloroethane	10.2		"	10.0		102	74.6-132		8.57	20.2	
1,2-Dichloropropane	9.54		"	10.0		95.4	76.9-129		2.66	20.7	
1,3,5-Trimethylbenzene	9.94		"	10.0		99.4	70.6-127		8.60	18.9	
1,3-Dichlorobenzene	10.3		"	10.0		103	77-124		9.57	19.2	
1,3-Dichloropropane	9.59		"	10.0		95.9	75.8-126		0.520	22.1	
1,4-Dichlorobenzene	10.1		"	10.0		101	76.6-125		7.84	18.6	
2,2-Dichloropropane	11.1		"	10.0		111	69-133		4.50	19.8	
2-Chlorotoluene	9.72		"	10.0		97.2	66.3-119		8.36	21.6	
2-Hexanone	10.9		"	10.0		109	70-130		9.13	30	
4-Chlorotoluene	10.0		"	10.0		100	69.2-127		9.41	19	
Acetone	10.1		"	10.0		101	70-130		4.14	30	
Benzene	10.0		"	10.0		100	76.2-129		4.58	19	
Bromobenzene	10.2		"	10.0		102	71.3-123		11.7	20.3	
Bromochloromethane	10.5		"	10.0		105	70.8-137		7.03	23.9	
Bromodichloromethane	10.6		"	10.0		106	79.7-134		7.01	21	
Bromoform	12.2		"	10.0		122	70.5-141		19.2	21.8	
Bromomethane	9.21		"	10.0		92.1	43.9-147		6.73	28.4	
Carbon tetrachloride	10.8		"	10.0		108	78.1-138		8.32	20.1	
Chlorobenzene	10.0		"	10.0		100	80.4-125		8.61	19.9	
Chloroethane	9.09		"	10.0		90.9	55.8-140		3.70	23.3	



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31376 - EPA 5030B

LCS Dup (BG31376-BSD1)

Prepared & Analyzed: 07/30/2013

Chloroform	10.4		ug/L	10.0		104	76.6-133		7.50	20.3	
Chloromethane	7.83		"	10.0		78.3	48.8-115		2.02	24.5	
cis-1,2-Dichloroethylene	10.1		"	10.0		101	75.1-128		7.19	20.5	
cis-1,3-Dichloropropylene	11.3		"	10.0		113	74.5-128		7.43	19.9	
Dibromochloromethane	12.1		"	10.0		121	79.8-134		8.10	21.3	
Dibromomethane	10.2		"	10.0		102	79-130		4.80	22.4	
Dichlorodifluoromethane	6.37		"	10.0		63.7	47.1-101		4.60	23.9	
Ethyl Benzene	10.4		"	10.0		104	80.8-128		6.14	19.2	
Hexachlorobutadiene	10.4		"	10.0		104	64.8-128		13.2	20.6	
Isopropylbenzene	10.0		"	10.0		100	75.5-135		9.07	20	
Methyl tert-butyl ether (MTBE)	10.7		"	10.0		107	65.1-140		2.17	23.6	
Methylene chloride	9.77		"	10.0		97.7	61.3-120		4.18	20.4	
Naphthalene	11.3		"	10.0		113	62.3-148		16.5	27.1	
n-Butylbenzene	9.54		"	10.0		95.4	67.2-123		5.27	19.1	
n-Propylbenzene	9.88		"	10.0		98.8	70.5-127		7.56	23.4	
o-Xylene	9.99		"	10.0		99.9	75.9-122		5.98	19.3	
p- & m- Xylenes	20.5		"	20.0		102	77.7-127		5.11	18.6	
p-Isopropyltoluene	10.1		"	10.0		101	75.6-129		6.86	19.1	
sec-Butylbenzene	10.2		"	10.0		102	71.5-125		7.53	18.9	
Styrene	10.9		"	10.0		109	77.8-123		8.52	20.9	
tert-Butylbenzene	10.2		"	10.0		102	75.9-151		9.18	20.9	
Tetrachloroethylene	8.68		"	10.0		86.8	63.6-167		3.40	27.7	
Toluene	9.42		"	10.0		94.2	77-123		3.57	18.7	
trans-1,2-Dichloroethylene	9.64		"	10.0		96.4	76.3-139		3.81	19.5	
trans-1,3-Dichloropropylene	11.4		"	10.0		114	72.5-137		9.45	19.3	
Trichloroethylene	9.62		"	10.0		96.2	77.9-130		6.00	20.5	
Trichlorofluoromethane	9.46		"	10.0		94.6	57.4-133		0.849	21.4	
Vinyl Chloride	8.51		"	10.0		85.1	54.9-124		0.00	22.3	
<i>Surrogate: 1,2-Dichloroethane-d4</i>	<i>10.0</i>		<i>"</i>	<i>10.0</i>		<i>100</i>	<i>72.6-129</i>				
<i>Surrogate: p-Bromofluorobenzene</i>	<i>9.96</i>		<i>"</i>	<i>10.0</i>		<i>99.6</i>	<i>63.5-145</i>				
<i>Surrogate: Toluene-d8</i>	<i>9.48</i>		<i>"</i>	<i>10.0</i>		<i>94.8</i>	<i>81.2-127</i>				



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
13G0913-01	WQ072313:1130 FRW1	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
13G0913-02	WQ072313:1135 FRW2	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
13G0913-03	WQ072313:1140 FRW3	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
13G0913-04	WQ072313:1145 FRW4	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C

Notes and Definitions

QL-02 This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.

J Detected below the Reporting Limit but greater than or equal to the Method Detection Limit (MDL/LOD) or in the case of a TIC, the result is an estimated concentration.

ND Analyte NOT DETECTED at the stated Reporting Limit (RL) or above.

RL REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.

MDL METHOD DETECTION LIMIT - the minimum concentration that can be measured and reported with a 99% confidence that the concentration is greater than zero. If requested or required, a value reported below the RL and above the MDL is considered estimated and is noted with a "J" flag.

NR Not reported

RPD Relative Percent Difference

Wet The data has been reported on an as-received (wet weight) basis

Low Bias Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.

High Bias High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.

Non-Dir. Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two.

For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the MDL, with values between the MDL and the RL being "J" flagged as estimated results.

Field Chain-of-Custody Record

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions unless superseded by written contract.

York Project No. 360913

Client Information		Report to:		Invoice To:		Client Project ID		Turn-Around Time		Report Type/Deliverables	
Company: <u>LBG</u>	<input type="checkbox"/> SAME	<input type="checkbox"/> Tunde Sandor		<input type="checkbox"/> SAME		Rowe Industries		RUSH Same Day	Summary	x, pdf	
Address: <u>4 Research Drive,</u>	Name: _____	Same		Name: <u>Mark Goldberg</u>		Purchase Order no.		RUSH Next Day	QA/QC Summary	x, pdf	
Phone no.: <u>203-929-8555</u>	Company: _____	Same		Company: _____		NABSAG		RUSH Two Day	CT RCP Pkg		
Contact Person <u>Tunde Sandor</u>	Address: _____	Same		Address: _____				RUSH Three Day	ASP A Pkg		
E-mail Addr.: <u>tsandor@lbact.com</u>	E-mail: _____	Same		E-mail: _____				RUSH Four Day	ASP B Pkg	x, pdf	
FAX No.: <u>203-926-9140</u>	Fax No.: _____	Same		Fax No.: _____				Standard (5-7 days)	Excel		
						Samples from: CT NY NJ OTHER		OTHER	EDD	x, Excel	


Print Clearly and Legibly. All information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.

Matrix Codes
S - soil
Other - specify (oil, etc.)
WW - wastewater
GW - groundwater
DW - drinking water
Air-A - ambient air
Air-SV - soil vapor

Samples Collected/Authorized By (Signature)
Stephen Hunt
Name (printed)

Sample Identification	Date Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below	Container Description(s)
WQ072313: 1130 FRW 1	7/22/13 1130	GW	VOC 8260 full list (EPA SW846-8260B)	3V
WQ072313: 1135 FRW 2	1135	GW	VOC 8260 full list (EPA SW846-8260B)	3V
WQ072313: 1140 FRW 3	1140	GW	VOC 8260 full list (EPA SW846-8260B)	3V
WQ072313: 1145 FRW 4	1145	GW	VOC 8260 full list (EPA SW846-8260B)	3V
		GW	VOC 8260 full list (EPA SW846-8260B)	
		GW	VOC 8260 full list (EPA SW846-8260B)	
		GW	VOC 8260 full list (EPA SW846-8260B)	
		GW	VOC 8260 full list (EPA SW846-8260B)	

Cool 4°C	HNO3	H2SO4	NaOH	NONE	FROZEN	Temperature on Receipt
Preservation "X" those applicable	7/24/13 1400	7/25/13 1400	7/25/13 1400	7/25/13 1400	7/25/13 1400	4.1 °C
Comments	Samples Relinquished By <u>Danell Wada</u> Date/Time <u>7/25/13 12:00</u>	Samples Relinquished By <u>D. Hunt</u> Date/Time <u>7/25/13 1440</u>	Samples Received By <u>D. Hunt</u> Date/Time <u>7/25/13 1400</u>	Samples Received In L.A.B. by <u>D. Hunt</u> Date/Time <u>7/25/13 1440</u>		



Technical Report

prepared for:

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301

Shelton CT, 06484

Attention: Tunde Komuves-Sandor

Report Date: 08/05/2013

Client Project ID: Rowe Industries

York Project (SDG) No.: 13G1044

CT Cert. No. PH-0723

New Jersey Cert. No. CT-005



New York Cert. No. 10854

PA Cert. No. 68-04440

Report Date: 08/05/2013
Client Project ID: Rowe Industries
York Project (SDG) No.: 13G1044

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on July 30, 2013 and listed below. The project was identified as your project: **Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Notes section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the attachment to this report, and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
13G1044-01	GWQ072913:1050NP1-1-2	Water	07/29/2013	07/30/2013
13G1044-02	GWQ072913:1100NP1-1-4	Water	07/29/2013	07/30/2013
13G1044-03	GWQ072913:1110NP1-1-6	Water	07/29/2013	07/30/2013
13G1044-04	GWQ072913:1120NP1-1-7	Water	07/29/2013	07/30/2013

General Notes for York Project (SDG) No.: 13G1044

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All samples were received in proper condition for analysis with proper documentation, unless otherwise noted.
6. All analyses conducted met method or Laboratory SOP requirements. See the Qualifiers and/or Narrative sections for further information.
7. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
8. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 08/05/2013

YORK



Sample Information

Client Sample ID: GWQ072913:1050NP1-1-2

York Sample ID: 13G1044-01

York Project (SDG) No.
13G1044

Client Project ID
Rowe Industries

Matrix
Water

Collection Date/Time
July 29, 2013 10:50 am

Date Received
07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS



Sample Information

Client Sample ID: GWQ072913:1050NP1-1-2

York Sample ID: 13G1044-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1044

Rowe Industries

Water

July 29, 2013 10:50 am

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
156-59-2	cis-1,2-Dichloroethylene	0.61		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
127-18-4	Tetrachloroethylene	0.93		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
79-01-6	Trichloroethylene	0.54		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 16:48	SS



Sample Information

Client Sample ID: GWQ072913:1050NP1-1-2

York Sample ID: 13G1044-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1044

Rowe Industries

Water

July 29, 2013 10:50 am

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Surrogate Recoveries	Result			Acceptance Range						
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	106 %			72.6	129					
460-00-4	Surrogate: p-Bromofluorobenzene	93.9 %			63.5	145					
2037-26-5	Surrogate: Toluene-d8	108 %			81.2	127					

Sample Information

Client Sample ID: GWQ072913:1100NP1-1-4

York Sample ID: 13G1044-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1044

Rowe Industries

Water

July 29, 2013 11:00 am

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
71-55-6	1,1,1-Trichloroethane	1.3		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
75-34-3	1,1-Dichloroethane	0.35	J	ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS



Sample Information

Client Sample ID: GWQ072913:1100NP1-1-4

York Sample ID: 13G1044-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1044

Rowe Industries

Water

July 29, 2013 11:00 am

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
75-00-3	Chloroethane	0.29	J	ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS



Sample Information

Client Sample ID: GWQ072913:1100NP1-1-4

York Sample ID: 13G1044-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1044

Rowe Industries

Water

July 29, 2013 11:00 am

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
127-18-4	Tetrachloroethylene	0.93		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 17:26	SS
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	103 %	72.6-129								
460-00-4	Surrogate: p-Bromofluorobenzene	93.5 %	63.5-145								
2037-26-5	Surrogate: Toluene-d8	97.5 %	81.2-127								

Sample Information

Client Sample ID: GWQ072913:1110NP1-1-6

York Sample ID: 13G1044-03

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1044

Rowe Industries

Water

July 29, 2013 11:10 am

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
71-55-6	1,1,1-Trichloroethane	0.50		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
75-34-3	1,1-Dichloroethane	0.34	J	ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS



Sample Information

Client Sample ID: GWQ072913:1110NP1-1-6

York Sample ID: 13G1044-03

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1044

Rowe Industries

Water

July 29, 2013 11:10 am

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
67-66-3	Chloroform	0.27	J	ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS



Sample Information

Client Sample ID: GWQ072913:1110NP1-1-6

York Sample ID: 13G1044-03

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1044

Rowe Industries

Water

July 29, 2013 11:10 am

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
127-18-4	Tetrachloroethylene	1.7		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:04	SS
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	112 %	72.6-129								
460-00-4	Surrogate: p-Bromofluorobenzene	90.9 %	63.5-145								
2037-26-5	Surrogate: Toluene-d8	109 %	81.2-127								

Sample Information

Client Sample ID: GWQ072913:1120NP1-1-7

York Sample ID: 13G1044-04

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1044

Rowe Industries

Water

July 29, 2013 11:20 am

07/30/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:



Sample Information

Client Sample ID: GWQ072913:1120NP1-1-7

York Sample ID: 13G1044-04

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1044

Rowe Industries

Water

July 29, 2013 11:20 am

07/30/2013

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
76-13-1	1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS



Sample Information

Client Sample ID: GWQ072913:1120NP1-1-7

York Sample ID: 13G1044-04

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1044

Rowe Industries

Water

July 29, 2013 11:20 am

07/30/2013


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
75-00-3	Chloroethane	0.24	J	ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
127-18-4	Tetrachloroethylene	0.65		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	08/01/2013 11:20	08/01/2013 18:42	SS
Surrogate Recoveries		Result	Acceptance Range								
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	112 %	72.6-129								



Sample Information

Client Sample ID: GWQ072913:1120NP1-1-7

York Sample ID: 13G1044-04

York Project (SDG) No.
13G1044

Client Project ID
Rowe Industries

Matrix
Water

Collection Date/Time
July 29, 2013 11:20 am

Date Received
07/30/2013


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
460-00-4	Surrogate: p-Bromofluorobenzene	91.6 %			63.5-145						
2037-26-5	Surrogate: Toluene-d8	108 %			81.2-127						



Analytical Batch Summary

Batch ID: BH30023

Preparation Method: EPA 5030B

Prepared By: EKM

YORK Sample ID	Client Sample ID	Preparation Date
13G1044-01	GWQ072913:1050NP1-1-2	08/01/13
13G1044-02	GWQ072913:1100NP1-1-4	08/01/13
13G1044-03	GWQ072913:1110NP1-1-6	08/01/13
13G1044-04	GWQ072913:1120NP1-1-7	08/01/13
BH30023-BLK1	Blank	08/01/13
BH30023-BS1	LCS	08/01/13
BH30023-BSD1	LCS Dup	08/01/13
BH30023-MS1	Matrix Spike	08/01/13
BH30023-MSD1	Matrix Spike Dup	08/01/13



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30023 - EPA 5030B

Blank (BH30023-BLK1)

Prepared & Analyzed: 08/01/2013

1,1,1,2-Tetrachloroethane	ND	0.50	ug/L								
1,1,1-Trichloroethane	ND	0.50	"								
1,1,2,2-Tetrachloroethane	ND	0.50	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.50	"								
1,1,2-Trichloroethane	ND	0.50	"								
1,1-Dichloroethane	ND	0.50	"								
1,1-Dichloroethylene	ND	0.50	"								
1,1-Dichloropropylene	ND	0.50	"								
1,2,3-Trichlorobenzene	ND	2.0	"								
1,2,3-Trichloropropane	ND	0.50	"								
1,2,4-Trichlorobenzene	ND	2.0	"								
1,2,4-Trimethylbenzene	ND	0.50	"								
1,2-Dibromo-3-chloropropane	ND	2.0	"								
1,2-Dibromoethane	ND	0.50	"								
1,2-Dichlorobenzene	ND	0.50	"								
1,2-Dichloroethane	ND	0.50	"								
1,2-Dichloropropane	ND	0.50	"								
1,3,5-Trimethylbenzene	ND	0.50	"								
1,3-Dichlorobenzene	ND	0.50	"								
1,3-Dichloropropane	ND	0.50	"								
1,4-Dichlorobenzene	ND	0.50	"								
2,2-Dichloropropane	ND	0.50	"								
2-Chlorotoluene	ND	0.50	"								
2-Hexanone	ND	0.50	"								
4-Chlorotoluene	ND	0.50	"								
Acetone	ND	2.0	"								
Benzene	ND	0.50	"								
Bromobenzene	ND	0.50	"								
Bromochloromethane	ND	0.50	"								
Bromodichloromethane	ND	0.50	"								
Bromoform	ND	0.50	"								
Bromomethane	ND	0.50	"								
Carbon tetrachloride	ND	0.50	"								
Chlorobenzene	ND	0.50	"								
Chloroethane	ND	0.50	"								
Chloroform	ND	0.50	"								
Chloromethane	ND	0.50	"								
cis-1,2-Dichloroethylene	ND	0.50	"								
cis-1,3-Dichloropropylene	ND	0.50	"								
Dibromochloromethane	ND	0.50	"								
Dibromomethane	ND	0.50	"								
Dichlorodifluoromethane	ND	0.50	"								
Ethyl Benzene	ND	0.50	"								
Hexachlorobutadiene	ND	0.50	"								
Isopropylbenzene	ND	0.50	"								
Methyl tert-butyl ether (MTBE)	ND	0.50	"								
Methylene chloride	ND	2.0	"								
Naphthalene	ND	2.0	"								
n-Butylbenzene	ND	0.50	"								
n-Propylbenzene	ND	0.50	"								
o-Xylene	ND	0.50	"								



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30023 - EPA 5030B

Blank (BH30023-BLK1)

Prepared & Analyzed: 08/01/2013

p- & m- Xylenes	ND	1.0	ug/L								
p-Isopropyltoluene	ND	0.50	"								
sec-Butylbenzene	ND	0.50	"								
Styrene	ND	0.50	"								
tert-Butylbenzene	ND	0.50	"								
Tetrachloroethylene	ND	0.50	"								
Toluene	ND	0.50	"								
trans-1,2-Dichloroethylene	ND	0.50	"								
trans-1,3-Dichloropropylene	ND	0.50	"								
Trichloroethylene	ND	0.50	"								
Trichlorofluoromethane	ND	0.50	"								
Vinyl Chloride	ND	0.50	"								
Xylenes, Total	ND	1.5	"								
<i>Surrogate: 1,2-Dichloroethane-d4</i>	10.7		"	10.0		107	72.6-129				
<i>Surrogate: p-Bromofluorobenzene</i>	9.29		"	10.0		92.9	63.5-145				
<i>Surrogate: Toluene-d8</i>	9.27		"	10.0		92.7	81.2-127				

LCS (BH30023-BS1)

Prepared & Analyzed: 08/01/2013

1,1,1,2-Tetrachloroethane	10.6		ug/L	10.0		106	82.3-130				
1,1,1-Trichloroethane	10.4		"	10.0		104	75.6-137				
1,1,2,2-Tetrachloroethane	10.4		"	10.0		104	71.3-131				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.1		"	10.0		101	71.1-129				
1,1,2-Trichloroethane	10.8		"	10.0		108	74.5-129				
1,1-Dichloroethane	9.99		"	10.0		99.9	79.6-132				
1,1-Dichloroethylene	9.75		"	10.0		97.5	80.2-146				
1,1-Dichloropropylene	9.19		"	10.0		91.9	75-136				
1,2,3-Trichlorobenzene	9.32		"	10.0		93.2	66.1-136				
1,2,3-Trichloropropane	10.5		"	10.0		105	63-131				
1,2,4-Trichlorobenzene	9.72		"	10.0		97.2	70.6-136				
1,2,4-Trimethylbenzene	9.72		"	10.0		97.2	75.3-135				
1,2-Dibromo-3-chloropropane	10.8		"	10.0		108	58.9-140				
1,2-Dibromoethane	11.7		"	10.0		117	79-130				
1,2-Dichlorobenzene	9.66		"	10.0		96.6	76.1-122				
1,2-Dichloroethane	10.1		"	10.0		101	74.6-132				
1,2-Dichloropropane	9.70		"	10.0		97.0	76.9-129				
1,3,5-Trimethylbenzene	9.76		"	10.0		97.6	70.6-127				
1,3-Dichlorobenzene	9.81		"	10.0		98.1	77-124				
1,3-Dichloropropane	10.6		"	10.0		106	75.8-126				
1,4-Dichlorobenzene	9.80		"	10.0		98.0	76.6-125				
2,2-Dichloropropane	11.8		"	10.0		118	69-133				
2-Chlorotoluene	9.43		"	10.0		94.3	66.3-119				
2-Hexanone	11.1		"	10.0		111	70-130				
4-Chlorotoluene	9.81		"	10.0		98.1	69.2-127				
Acetone	9.98		"	10.0		99.8	70-130				
Benzene	9.77		"	10.0		97.7	76.2-129				
Bromobenzene	9.68		"	10.0		96.8	71.3-123				
Bromochloromethane	10.5		"	10.0		105	70.8-137				
Bromodichloromethane	10.6		"	10.0		106	79.7-134				
Bromoform	11.7		"	10.0		117	70.5-141				
Bromomethane	8.37		"	10.0		83.7	43.9-147				
Carbon tetrachloride	11.3		"	10.0		113	78.1-138				
Chlorobenzene	9.73		"	10.0		97.3	80.4-125				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	RPD	Limit	Flag
		Limit			Result					Limit			

Batch BH30023 - EPA 5030B

LCS (BH30023-BS1)

Prepared & Analyzed: 08/01/2013

Chloroethane	9.83		ug/L	10.0		98.3	55.8-140						
Chloroform	10.2		"	10.0		102	76.6-133						
Chloromethane	8.24		"	10.0		82.4	48.8-115						
cis-1,2-Dichloroethylene	9.83		"	10.0		98.3	75.1-128						
cis-1,3-Dichloropropylene	11.4		"	10.0		114	74.5-128						
Dibromochloromethane	12.8		"	10.0		128	79.8-134						
Dibromomethane	10.2		"	10.0		102	79-130						
Dichlorodifluoromethane	9.80		"	10.0		98.0	47.1-101						
Ethyl Benzene	9.90		"	10.0		99.0	80.8-128						
Hexachlorobutadiene	9.47		"	10.0		94.7	64.8-128						
Isopropylbenzene	9.70		"	10.0		97.0	75.5-135						
Methyl tert-butyl ether (MTBE)	11.6		"	10.0		116	65.1-140						
Methylene chloride	9.85		"	10.0		98.5	61.3-120						
Naphthalene	9.78		"	10.0		97.8	62.3-148						
n-Butylbenzene	9.22		"	10.0		92.2	67.2-123						
n-Propylbenzene	9.75		"	10.0		97.5	70.5-127						
o-Xylene	9.63		"	10.0		96.3	75.9-122						
p- & m- Xylenes	19.5		"	20.0		97.6	77.7-127						
p-Isopropyltoluene	9.83		"	10.0		98.3	75.6-129						
sec-Butylbenzene	9.81		"	10.0		98.1	71.5-125						
Styrene	10.5		"	10.0		105	77.8-123						
tert-Butylbenzene	9.87		"	10.0		98.7	75.9-151						
Tetrachloroethylene	9.14		"	10.0		91.4	63.6-167						
Toluene	9.08		"	10.0		90.8	77-123						
trans-1,2-Dichloroethylene	9.74		"	10.0		97.4	76.3-139						
trans-1,3-Dichloropropylene	11.6		"	10.0		116	72.5-137						
Trichloroethylene	9.19		"	10.0		91.9	77.9-130						
Trichlorofluoromethane	10.0		"	10.0		100	57.4-133						
Vinyl Chloride	9.18		"	10.0		91.8	54.9-124						
Surrogate: 1,2-Dichloroethane-d4	10.0		"	10.0		100	72.6-129						
Surrogate: p-Bromofluorobenzene	10.2		"	10.0		102	63.5-145						
Surrogate: Toluene-d8	9.42		"	10.0		94.2	81.2-127						



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BH30023 - EPA 5030B											
LCS Dup (BH30023-BSD1)											
										Prepared & Analyzed: 08/01/2013	
1,1,1,2-Tetrachloroethane	11.0		ug/L	10.0		110	82.3-130		3.42	21.1	
1,1,1-Trichloroethane	10.6		"	10.0		106	75.6-137		1.62	19.7	
1,1,2,2-Tetrachloroethane	10.2		"	10.0		102	71.3-131		1.36	20.8	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.7		"	10.0		107	71.1-129		5.48	21.7	
1,1,2-Trichloroethane	9.86		"	10.0		98.6	74.5-129		8.82	20.3	
1,1-Dichloroethane	10.5		"	10.0		105	79.6-132		4.79	20.6	
1,1-Dichloroethylene	10.0		"	10.0		100	80.2-146		3.03	20	
1,1-Dichloropropylene	9.62		"	10.0		96.2	75-136		4.57	19.3	
1,2,3-Trichlorobenzene	9.43		"	10.0		94.3	66.1-136		1.17	21.6	
1,2,3-Trichloropropane	10.4		"	10.0		104	63-131		1.72	23.9	
1,2,4-Trichlorobenzene	9.49		"	10.0		94.9	70.6-136		2.39	21.7	
1,2,4-Trimethylbenzene	9.65		"	10.0		96.5	75.3-135		0.723	18.8	
1,2-Dibromo-3-chloropropane	10.8		"	10.0		108	58.9-140		0.464	27.7	
1,2-Dibromoethane	11.8		"	10.0		118	79-130		1.45	23	
1,2-Dichlorobenzene	9.70		"	10.0		97.0	76.1-122		0.413	19.8	
1,2-Dichloroethane	10.4		"	10.0		104	74.6-132		3.61	20.2	
1,2-Dichloropropane	10.2		"	10.0		102	76.9-129		4.73	20.7	
1,3,5-Trimethylbenzene	9.71		"	10.0		97.1	70.6-127		0.514	18.9	
1,3-Dichlorobenzene	9.71		"	10.0		97.1	77-124		1.02	19.2	
1,3-Dichloropropane	10.9		"	10.0		109	75.8-126		2.70	22.1	
1,4-Dichlorobenzene	9.58		"	10.0		95.8	76.6-125		2.27	18.6	
2,2-Dichloropropane	10.9		"	10.0		109	69-133		7.48	19.8	
2-Chlorotoluene	9.35		"	10.0		93.5	66.3-119		0.852	21.6	
2-Hexanone	11.0		"	10.0		110	70-130		0.453	30	
4-Chlorotoluene	9.77		"	10.0		97.7	69.2-127		0.409	19	
Acetone	10.6		"	10.0		106	70-130		6.03	30	
Benzene	10.3		"	10.0		103	76.2-129		5.09	19	
Bromobenzene	9.91		"	10.0		99.1	71.3-123		2.35	20.3	
Bromochloromethane	10.8		"	10.0		108	70.8-137		3.19	23.9	
Bromodichloromethane	10.8		"	10.0		108	79.7-134		1.78	21	
Bromoform	11.3		"	10.0		113	70.5-141		3.57	21.8	
Bromomethane	9.09		"	10.0		90.9	43.9-147		8.25	28.4	
Carbon tetrachloride	11.6		"	10.0		116	78.1-138		2.80	20.1	
Chlorobenzene	9.97		"	10.0		99.7	80.4-125		2.44	19.9	
Chloroethane	10.3		"	10.0		103	55.8-140		4.67	23.3	
Chloroform	10.5		"	10.0		105	76.6-133		2.70	20.3	
Chloromethane	8.70		"	10.0		87.0	48.8-115		5.43	24.5	
cis-1,2-Dichloroethylene	10.3		"	10.0		103	75.1-128		4.77	20.5	
cis-1,3-Dichloropropylene	11.8		"	10.0		118	74.5-128		2.76	19.9	
Dibromochloromethane	12.6		"	10.0		126	79.8-134		0.866	21.3	
Dibromomethane	10.6		"	10.0		106	79-130		4.52	22.4	
Dichlorodifluoromethane	10.1		"	10.0		101	47.1-101		3.21	23.9	
Ethyl Benzene	10.2		"	10.0		102	80.8-128		2.59	19.2	
Hexachlorobutadiene	9.09		"	10.0		90.9	64.8-128		4.09	20.6	
Isopropylbenzene	9.72		"	10.0		97.2	75.5-135		0.206	20	
Methyl tert-butyl ether (MTBE)	12.1		"	10.0		121	65.1-140		3.80	23.6	
Methylene chloride	10.2		"	10.0		102	61.3-120		3.88	20.4	
Naphthalene	9.82		"	10.0		98.2	62.3-148		0.408	27.1	
n-Butylbenzene	9.31		"	10.0		93.1	67.2-123		0.971	19.1	
n-Propylbenzene	9.72		"	10.0		97.2	70.5-127		0.308	23.4	
o-Xylene	9.82		"	10.0		98.2	75.9-122		1.95	19.3	



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30023 - EPA 5030B

LCS Dup (BH30023-BSD1)

Prepared & Analyzed: 08/01/2013

p- & m- Xylenes	19.9		ug/L	20.0		99.3	77.7-127		1.78	18.6	
p-Isopropyltoluene	9.64		"	10.0		96.4	75.6-129		1.95	19.1	
sec-Butylbenzene	9.78		"	10.0		97.8	71.5-125		0.306	18.9	
Styrene	10.7		"	10.0		107	77.8-123		2.17	20.9	
tert-Butylbenzene	9.85		"	10.0		98.5	75.9-151		0.203	20.9	
Tetrachloroethylene	9.09		"	10.0		90.9	63.6-167		0.549	27.7	
Toluene	9.38		"	10.0		93.8	77-123		3.25	18.7	
trans-1,2-Dichloroethylene	10.1		"	10.0		101	76.3-139		3.43	19.5	
trans-1,3-Dichloropropylene	11.6		"	10.0		116	72.5-137		0.259	19.3	
Trichloroethylene	9.53		"	10.0		95.3	77.9-130		3.63	20.5	
Trichlorofluoromethane	10.4		"	10.0		104	57.4-133		3.24	21.4	
Vinyl Chloride	9.75		"	10.0		97.5	54.9-124		6.02	22.3	
Surrogate: 1,2-Dichloroethane-d4	10.1		"	10.0		101	72.6-129				
Surrogate: p-Bromofluorobenzene	9.82		"	10.0		98.2	63.5-145				
Surrogate: Toluene-d8	9.34		"	10.0		93.4	81.2-127				

Matrix Spike (BH30023-MS1)

*Source sample: 13G1044-01 (GWQ072913:1050NP1-1-2)

Prepared & Analyzed: 08/01/2013

1,1,1,2-Tetrachloroethane	11.5		ug/L	10.0	ND	115	82-138				
1,1,1-Trichloroethane	11.1		"	10.0	ND	111	85.7-133				
1,1,2,2-Tetrachloroethane	10.4		"	10.0	ND	104	78.6-136				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	11.0		"	10.0	ND	110	74.8-131				
1,1,2-Trichloroethane	11.3		"	10.0	ND	113	82.5-129				
1,1-Dichloroethane	10.9		"	10.0	ND	109	81.4-137				
1,1-Dichloroethylene	10.6		"	10.0	ND	106	90-138				
1,1-Dichloropropylene	9.81		"	10.0	ND	98.1	91.7-131				
1,2,3-Trichlorobenzene	9.79		"	10.0	ND	97.9	75.9-130				
1,2,3-Trichloropropane	10.0		"	10.0	ND	100	77.1-140				
1,2,4-Trichlorobenzene	9.83		"	10.0	ND	98.3	69.8-135				
1,2,4-Trimethylbenzene	9.60		"	10.0	ND	96.0	79.4-131				
1,2-Dibromo-3-chloropropane	10.8		"	10.0	ND	108	66.6-143				
1,2-Dibromoethane	11.6		"	10.0	ND	116	79.8-136				
1,2-Dichlorobenzene	9.91		"	10.0	ND	99.1	79.9-130				
1,2-Dichloroethane	11.0		"	10.0	ND	110	85-133				
1,2-Dichloropropane	10.8		"	10.0	ND	108	81.1-132				
1,3,5-Trimethylbenzene	9.62		"	10.0	ND	96.2	76.1-121				
1,3-Dichlorobenzene	9.74		"	10.0	ND	97.4	79.1-124				
1,3-Dichloropropane	11.6		"	10.0	ND	116	83.3-130				
1,4-Dichlorobenzene	9.80		"	10.0	ND	98.0	79.4-128				
2,2-Dichloropropane	10.8		"	10.0	ND	108	54.2-126				
2-Chlorotoluene	9.41		"	10.0	ND	94.1	60.2-144				
2-Hexanone	10.9		"	10.0	ND	109	70-130				
4-Chlorotoluene	9.83		"	10.0	ND	98.3	79.8-128				
Acetone	10.7		"	10.0	0.400	103	70-130				
Benzene	10.6		"	10.0	ND	106	74.1-134				
Bromobenzene	9.68		"	10.0	ND	96.8	76.6-125				
Bromochloromethane	11.0		"	10.0	ND	110	85-133				
Bromodichloromethane	11.8		"	10.0	ND	118	80.8-143				
Bromoform	10.2		"	10.0	ND	102	65.8-164				
Bromomethane	6.97		"	10.0	ND	69.7	68.7-112				
Carbon tetrachloride	12.0		"	10.0	ND	120	85.7-138				
Chlorobenzene	10.6		"	10.0	ND	106	79.9-129				
Chloroethane	10.4		"	10.0	ND	104	74.7-127				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30023 - EPA 5030B

Matrix Spike (BH30023-MS1)	*Source sample: 13G1044-01 (GWQ072913:1050NP1-1-2)					Prepared & Analyzed: 08/01/2013					
Chloroform	10.7		ug/L	10.0	ND	107	50.6-145				
Chloromethane	9.25		"	10.0	ND	92.5	64-111				
cis-1,2-Dichloroethylene	11.0		"	10.0	0.610	103	75.5-129				
cis-1,3-Dichloropropylene	11.9		"	10.0	ND	119	74.3-128				
Dibromochloromethane	12.6		"	10.0	ND	126	76.8-150				
Dibromomethane	11.2		"	10.0	ND	112	83.3-140				
Dichlorodifluoromethane	9.24		"	10.0	ND	92.4	51-100				
Ethyl Benzene	10.9		"	10.0	ND	109	82.9-127				
Hexachlorobutadiene	9.84		"	10.0	ND	98.4	73-128				
Isopropylbenzene	9.56		"	10.0	ND	95.6	78.7-131				
Methyl tert-butyl ether (MTBE)	9.86		"	10.0	ND	98.6	81.2-134				
Methylene chloride	11.1		"	10.0	ND	111	57.8-103	High Bias			
Naphthalene	9.93		"	10.0	ND	99.3	80.1-122				
n-Butylbenzene	9.68		"	10.0	ND	96.8	72.4-120				
n-Propylbenzene	9.77		"	10.0	ND	97.7	74-130				
o-Xylene	10.6		"	10.0	ND	106	78.8-122				
p- & m- Xylenes	21.6		"	20.0	ND	108	82.5-123				
p-Isopropyltoluene	9.92		"	10.0	ND	99.2	64.9-132				
sec-Butylbenzene	10.1		"	10.0	ND	101	25.4-151				
Styrene	11.2		"	10.0	ND	112	74.1-134				
tert-Butylbenzene	9.98		"	10.0	ND	99.8	79.5-171				
Tetrachloroethylene	10.5		"	10.0	0.930	95.7	72.5-130				
Toluene	10.0		"	10.0	ND	100	77.8-121				
trans-1,2-Dichloroethylene	10.6		"	10.0	ND	106	83.8-140				
trans-1,3-Dichloropropylene	11.8		"	10.0	ND	118	74.9-136				
Trichloroethylene	10.9		"	10.0	0.540	104	84.4-125				
Trichlorofluoromethane	10.7		"	10.0	ND	107	78.7-127				
Vinyl Chloride	10.4		"	10.0	ND	104	72.1-116				
Surrogate: 1,2-Dichloroethane-d4	10.6		"	10.0		106	72.6-129				
Surrogate: p-Bromofluorobenzene	9.40		"	10.0		94.0	63.5-145				
Surrogate: Toluene-d8	9.65		"	10.0		96.5	81.2-127				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BH30023 - EPA 5030B											
Matrix Spike Dup (BH30023-MSD1)	*Source sample: 13G1044-01 (GWQ072913:1050NP1-1-2)					Prepared & Analyzed: 08/01/2013					
1,1,1,2-Tetrachloroethane	11.2		ug/L	10.0	ND	112	82-138		2.38	21.3	
1,1,1-Trichloroethane	11.5		"	10.0	ND	115	85.7-133		3.81	22.6	
1,1,2,2-Tetrachloroethane	10.2		"	10.0	ND	102	78.6-136		1.65	23.1	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.9		"	10.0	ND	109	74.8-131		1.00	25.6	
1,1,2-Trichloroethane	11.8		"	10.0	ND	118	82.5-129		3.72	19.3	
1,1-Dichloroethane	10.7		"	10.0	ND	107	81.4-137		1.95	20.7	
1,1-Dichloroethylene	10.6		"	10.0	ND	106	90-138		0.00	22.9	
1,1-Dichloropropylene	9.95		"	10.0	ND	99.5	91.7-131		1.42	24.9	
1,2,3-Trichlorobenzene	9.27		"	10.0	ND	92.7	75.9-130		5.46	21.4	
1,2,3-Trichloropropane	9.52		"	10.0	ND	95.2	77.1-140		5.02	28	
1,2,4-Trichlorobenzene	9.34		"	10.0	ND	93.4	69.8-135		5.11	22.5	
1,2,4-Trimethylbenzene	9.26		"	10.0	ND	92.6	79.4-131		3.61	33.9	
1,2-Dibromo-3-chloropropane	10.4		"	10.0	ND	104	66.6-143		3.79	23.3	
1,2-Dibromoethane	11.9		"	10.0	ND	119	79.8-136		2.47	19.1	
1,2-Dichlorobenzene	9.47		"	10.0	ND	94.7	79.9-130		4.54	23.2	
1,2-Dichloroethane	11.2		"	10.0	ND	112	85-133		1.08	19.1	
1,2-Dichloropropane	10.1		"	10.0	ND	101	81.1-132		6.52	19.9	
1,3,5-Trimethylbenzene	9.10		"	10.0	ND	91.0	76.1-121		5.56	31.2	
1,3-Dichlorobenzene	9.52		"	10.0	ND	95.2	79.1-124		2.28	22.6	
1,3-Dichloropropane	11.3		"	10.0	ND	113	83.3-130		1.92	20.9	
1,4-Dichlorobenzene	9.50		"	10.0	ND	95.0	79.4-128		3.11	21	
2,2-Dichloropropane	12.0		"	10.0	ND	120	54.2-126		10.9	24.5	
2-Chlorotoluene	8.97		"	10.0	ND	89.7	60.2-144		4.79	30.8	
2-Hexanone	11.3		"	10.0	ND	113	70-130		3.77	30	
4-Chlorotoluene	9.37		"	10.0	ND	93.7	79.8-128		4.79	23.2	
Acetone	10.7		"	10.0	0.400	103	70-130		0.280	30	
Benzene	10.5		"	10.0	ND	105	74.1-134		1.14	20.8	
Bromobenzene	9.29		"	10.0	ND	92.9	76.6-125		4.11	23	
Bromochloromethane	11.0		"	10.0	ND	110	85-133		0.274	18.4	
Bromodichloromethane	10.9		"	10.0	ND	109	80.8-143		7.76	18.1	
Bromoform	11.3		"	10.0	ND	113	65.8-164		9.96	27.3	
Bromomethane	7.77		"	10.0	ND	77.7	68.7-112		10.9	22.8	
Carbon tetrachloride	12.3		"	10.0	ND	123	85.7-138		2.39	25.1	
Chlorobenzene	9.98		"	10.0	ND	99.8	79.9-129		5.74	21	
Chloroethane	9.86		"	10.0	ND	98.6	74.7-127		5.52	23.7	
Chloroform	10.9		"	10.0	ND	109	50.6-145		2.22	21.7	
Chloromethane	9.49		"	10.0	ND	94.9	64-111		2.56	21.4	
cis-1,2-Dichloroethylene	10.9		"	10.0	0.610	102	75.5-129		0.825	20.2	
cis-1,3-Dichloropropylene	13.2		"	10.0	ND	132	74.3-128	High Bias	9.89	19.8	
Dibromochloromethane	13.4		"	10.0	ND	134	76.8-150		6.77	20.8	
Dibromomethane	10.6		"	10.0	ND	106	83.3-140		5.88	20.4	
Dichlorodifluoromethane	10.2		"	10.0	ND	102	51-100	High Bias	10.3	27.6	
Ethyl Benzene	10.4		"	10.0	ND	104	82.9-127		5.07	21.4	
Hexachlorobutadiene	9.30		"	10.0	ND	93.0	73-128		5.64	26	
Isopropylbenzene	9.12		"	10.0	ND	91.2	78.7-131		4.71	26.7	
Methyl tert-butyl ether (MTBE)	9.96		"	10.0	ND	99.6	81.2-134		1.01	21.2	
Methylene chloride	10.5		"	10.0	ND	105	57.8-103	High Bias	5.29	21.2	
Naphthalene	9.63		"	10.0	ND	96.3	80.1-122		3.07	26.1	
n-Butylbenzene	9.17		"	10.0	ND	91.7	72.4-120		5.41	30.8	
n-Propylbenzene	9.22		"	10.0	ND	92.2	74-130		5.79	31	
o-Xylene	10.0		"	10.0	ND	100	78.8-122		5.15	21	



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30023 - EPA 5030B

Matrix Spike Dup (BH30023-MSD1)	*Source sample: 13G1044-01 (GWQ072913:1050NP1-1-2)					Prepared & Analyzed: 08/01/2013					
p- & m- Xylenes	20.6		ug/L	20.0	ND	103	82.5-123		4.88	22.5	
p-Isopropyltoluene	9.52		"	10.0	ND	95.2	64.9-132		4.12	25.2	
sec-Butylbenzene	9.56		"	10.0	ND	95.6	25.4-151		5.59	25.2	
Styrene	10.7		"	10.0	ND	107	74.1-134		4.03	20	
tert-Butylbenzene	9.47		"	10.0	ND	94.7	79.5-171		5.24	24.8	
Tetrachloroethylene	10.2		"	10.0	0.930	92.6	72.5-130		3.00	22.7	
Toluene	10.8		"	10.0	ND	108	77.8-121		8.06	21.5	
trans-1,2-Dichloroethylene	10.6		"	10.0	ND	106	83.8-140		0.377	20.1	
trans-1,3-Dichloropropylene	13.1		"	10.0	ND	131	74.9-136		10.2	22.5	
Trichloroethylene	10.1		"	10.0	0.540	96.0	84.4-125		7.50	20.7	
Trichlorofluoromethane	11.1		"	10.0	ND	111	78.7-127		4.03	24.7	
Vinyl Chloride	10.1		"	10.0	ND	101	72.1-116		3.70	24.9	
Surrogate: 1,2-Dichloroethane-d4	11.0		"	10.0		110	72.6-129				
Surrogate: p-Bromofluorobenzene	9.23		"	10.0		92.3	63.5-145				
Surrogate: Toluene-d8	10.6		"	10.0		106	81.2-127				



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
13G1044-01	GWQ072913:1050NP1-1-2	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
13G1044-02	GWQ072913:1100NP1-1-4	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
13G1044-03	GWQ072913:1110NP1-1-6	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
13G1044-04	GWQ072913:1120NP1-1-7	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C

Notes and Definitions

QM-07 The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on acceptable LCS recovery.

J Detected below the Reporting Limit but greater than or equal to the Method Detection Limit (MDL/LOD) or in the case of a TIC, the result is an estimated concentration.

ND Analyte NOT DETECTED at the stated Reporting Limit (RL) or above.

RL REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.

MDL METHOD DETECTION LIMIT - the minimum concentration that can be measured and reported with a 99% confidence that the concentration is greater than zero. If requested or required, a value reported below the RL and above the MDL is considered estimated and is noted with a "J" flag.

NR Not reported

RPD Relative Percent Difference

Wet The data has been reported on an as-received (wet weight) basis

Low Bias Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.

High Bias High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.

Non-Dir. Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the MDL, with values between the MDL and the RL being "J" flagged as estimated results.


NOTE: York's Std. Terms & Conditions are listed on the back side of this document.
This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions unless superseded by written contract.

York Project No. 13G/044

Client Information		Report to:		Invoice To:		Client Project ID		Turn-Around Time		Report Type/Deliverables	
Company: <u>LBG</u>	<input type="checkbox"/> SAME	Name: <u>Tunde Sandor</u>	<input type="checkbox"/> SAME	Name: <u>Mark Goldberg</u>		RUSH Same Day		Summary		x, pdf	
Address: <u>4 Research Drive,</u>		Name: <u>Same</u>		Company: <u> </u>		RUSH Next Day		QA/QC Summary		x, pdf	
Phone no.: <u>203-929-8555</u>		Company: <u> </u>		Address: <u> </u>		RUSH Two Day		CT RCP Pkg			
Contact Person <u>Tunde Sandor</u>		Address: <u> </u>		E-mail: <u> </u>		RUSH Three Day		ASP A Pkg			
E-mail Addr.: <u>tsandor@lbact.com</u>		E-mail: <u> </u>		Fax No.: <u> </u>		RUSH Four Day		ASP B Pkg		x, pdf	
FAX No.: <u>203-926-9140</u>		Fax No.: <u> </u>		Samples from: <u>CT_NY_NJ_OTHER</u>		Standard (5-7 days)		Excel			

Print Clearly and Legibly. All information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.


Matrix Codes
S - soil
Other - specify (oil, etc.)
WW - wastewater
GW - groundwater
DW - drinking water
Air-A - ambient air
Air-SV - soil vapor

Samples Collected/Authorized By (Signature)

STEPHEN HMAT
Name (printed)

Sample Identification	Date Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below	Container Description(s)
<u>6W0072913:1050NPI-1-2</u>	<u>7/29/13</u>	<u>GW</u>	<u>VOC 8260 full list (EPA SW846-8260B)</u>	<u>3v</u>
<u>6W0072913:1050NPI-1-2MS</u>	<u>1050</u>	<u>GW</u>	<u>VOC 8260 full list (EPA SW846-8260B)</u>	<u>3v</u>
<u>6W0072913:1050NPI-1-2MSD</u>	<u>1050</u>	<u>GW</u>	<u>VOC 8260 full list (EPA SW846-8260B)</u>	<u>3v</u>
<u>6W0072913:1100NPI-1-4</u>	<u>1100</u>	<u>GW</u>	<u>VOC 8260 full list (EPA SW846-8260B)</u>	<u>3v</u>
<u>6W0072913:1100NPI-1-6</u>	<u>1110</u>	<u>GW</u>	<u>VOC 8260 full list (EPA SW846-8260B)</u>	<u>3v</u>
<u>6W0072913:1120NPI-1-7</u>	<u>1120</u>	<u>GW</u>	<u>VOC 8260 full list (EPA SW846-8260B)</u>	<u>3v</u>

Comments	Cool 4°C	HNO3	H2SO4	NaOH	FROZEN	Temperature on Receipt
						<u>4.3 °C</u>
	Samples Relinquished By <u>Mark Goldberg</u> Date/Time <u>7/30/13 8:35</u>					
Samples Relinquished By <u>Mark Goldberg</u> Date/Time <u>7/30/13 16:30</u>						
Samples Relinquished By <u> </u> Date/Time <u> </u>						

APPENDIX III
JULY 2013 LABORATORY ANALYTICAL REPORTS
FOR AIR SAMPLES



Technical Report

prepared for:

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301

Shelton CT, 06484

Attention: Tunde Komuves-Sandor

Report Date: 08/06/2013

Client Project ID: Rowe Industries

York Project (SDG) No.: 13G1045

CT Cert. No. PH-0723

New Jersey Cert. No. CT-005



New York Cert. No. 10854

PA Cert. No. 68-04440

Report Date: 08/06/2013
Client Project ID: Rowe Industries
York Project (SDG) No.: 13G1045

Leggette Brashears & Graham Shelton Office
4 Research Drive, Suite 301
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on July 30, 2013 and listed below. The project was identified as your project: **Rowe Industries**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Notes section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the attachment to this report, and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
13G1045-01	AQ072913:1300NP4-1	Vapor Extraction	07/29/2013	07/30/2013
13G1045-02	AQ072913:1305NP4-2	Vapor Extraction	07/29/2013	07/30/2013
13G1045-03	AQ072913:1310NP4-3	Vapor Extraction	07/29/2013	07/30/2013

General Notes for York Project (SDG) No.: 13G1045

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All samples were received in proper condition for analysis with proper documentation, unless otherwise noted.
6. All analyses conducted met method or Laboratory SOP requirements. See the Qualifiers and/or Narrative sections for further information.
7. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
8. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 08/06/2013

YORK



Sample Information

Client Sample ID: AQ072913:1300NP4-1

York Sample ID: 13G1045-01

York Project (SDG) No.
13G1045

Client Project ID
Rowe Industries

Matrix
Vapor Extraction

Collection Date/Time
July 29, 2013 1:00 pm

Date Received
07/30/2013

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-01-4	Vinyl Chloride	ND		ug/m ³	4.4	4.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
108-05-4	Vinyl acetate	ND		ug/m ³	6.0	6.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
79-01-6	Trichloroethylene	9.2		ug/m ³	4.6	4.6	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	7.8	7.8	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	6.8	6.8	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
108-88-3	Toluene	ND		ug/m ³	6.4	6.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
109-99-9	Tetrahydrofuran	ND		ug/m ³	5.0	5.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
127-18-4	Tetrachloroethylene	24		ug/m ³	12	12	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
100-42-5	Styrene	ND		ug/m ³	7.3	7.3	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
115-07-01	Propylene	ND		ug/m ³	2.9	2.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
622-96-8	p-Ethyltoluene	ND		ug/m ³	42	42	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
179601-23-1	p- & m- Xylenes	ND		ug/m ³	15	15	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
95-47-6	o-Xylene	ND		ug/m ³	7.4	7.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
110-54-3	n-Hexane	ND		ug/m ³	6.0	6.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
142-82-5	n-Heptane	ND		ug/m ³	7.0	7.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
75-09-2	Methylene chloride	ND		ug/m ³	5.9	5.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	6.1	6.1	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
108-10-1	4-Methyl-2-pentanone	ND		ug/m ³	7.0	7.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
67-63-0	Isopropanol	ND		ug/m ³	4.2	4.2	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
87-68-3	Hexachlorobutadiene	ND		ug/m ³	18	18	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
100-41-4	Ethyl Benzene	ND		ug/m ³	7.4	7.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
141-78-6	Ethyl acetate	ND		ug/m ³	6.2	6.2	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
110-82-7	Cyclohexane	ND		ug/m ³	5.9	5.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	7.8	7.8	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
156-59-2	cis-1,2-Dichloroethylene	ND		ug/m ³	6.8	6.8	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
74-87-3	Chloromethane	ND		ug/m ³	3.5	3.5	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
67-66-3	Chloroform	9.2		ug/m ³	8.3	8.3	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
75-00-3	Chloroethane	ND		ug/m ³	4.5	4.5	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
56-23-5	Carbon tetrachloride	ND		ug/m ³	5.4	5.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
75-15-0	Carbon disulfide	ND		ug/m ³	5.3	5.3	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
74-83-9	Bromomethane	ND		ug/m ³	6.6	6.6	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
75-25-2	Bromoform	ND		ug/m ³	18	18	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB



Sample Information

Client Sample ID: AQ072913:1300NP4-1

York Sample ID: 13G1045-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1045

Rowe Industries

Vapor Extraction

July 29, 2013 1:00 pm

07/30/2013

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-27-4	Bromodichloromethane	ND		ug/m ³	11	11	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
100-44-7	Benzyl chloride	ND		ug/m ³	8.8	8.8	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
71-43-2	Benzene	ND		ug/m ³	5.5	5.5	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
67-64-1	Acetone	6.1	B	ug/m ³	4.1	4.1	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
591-78-6	2-Hexanone	ND		ug/m ³	7.0	7.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
78-93-3	2-Butanone	ND		ug/m ³	5.0	5.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
123-91-1	1,4-Dioxane	ND		ug/m ³	6.2	6.2	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
106-46-7	1,4-Dichlorobenzene	ND		ug/m ³	10	10	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	10	10	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
106-99-0	1,3-Butadiene	ND		ug/m ³	7.4	7.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
108-67-8	1,3,5-Trimethylbenzene	17		ug/m ³	8.4	8.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	12	12	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
78-87-5	1,2-Dichloropropane	ND		ug/m ³	7.9	7.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
107-06-2	1,2-Dichloroethane	ND		ug/m ³	6.9	6.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	10	10	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
95-63-6	1,2,4-Trimethylbenzene	20		ug/m ³	8.4	8.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	13	13	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	6.8	6.8	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
75-34-3	1,1-Dichloroethane	ND		ug/m ³	6.9	6.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
75-69-4	Trichlorofluoromethane (Freon 11)	ND		ug/m ³	9.6	9.6	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	9.3	9.3	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/m ³	13	13	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	12	12	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
71-55-6	1,1,1-Trichloroethane	10		ug/m ³	9.3	9.3	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
75-71-8	Dichlorodifluoromethane	ND		ug/m ³	8.4	8.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
106-93-4	1,2-Dibromoethane	ND		ug/m ³	13	13	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
124-48-1	Dibromochloromethane	ND		ug/m ³	14	14	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
80-62-6	Methyl Methacrylate	ND		ug/m ³	7.0	7.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
108-90-7	Chlorobenzene	ND		ug/m ³	7.9	7.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:06	RB
	Surrogate Recoveries	Result		Acceptance Range							
460-00-4	Surrogate: <i>p</i> -Bromofluorobenzene	98.0 %		70-130							



Sample Information

Client Sample ID: AQ072913:1305NP4-2

York Sample ID: 13G1045-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1045

Rowe Industries

Vapor Extraction

July 29, 2013 1:05 pm

07/30/2013

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-01-4	Vinyl Chloride	ND		ug/m ³	4.4	4.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
108-05-4	Vinyl acetate	ND		ug/m ³	6.0	6.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
79-01-6	Trichloroethylene	ND		ug/m ³	4.6	4.6	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	7.8	7.8	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	6.8	6.8	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
108-88-3	Toluene	ND		ug/m ³	6.4	6.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
109-99-9	Tetrahydrofuran	ND		ug/m ³	5.0	5.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
127-18-4	Tetrachloroethylene	54		ug/m ³	12	12	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
100-42-5	Styrene	ND		ug/m ³	7.3	7.3	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
115-07-01	Propylene	ND		ug/m ³	2.9	2.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
622-96-8	p-Ethyltoluene	ND		ug/m ³	42	42	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
179601-23-1	p- & m- Xylenes	ND		ug/m ³	15	15	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
95-47-6	o-Xylene	ND		ug/m ³	7.4	7.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
110-54-3	n-Hexane	ND		ug/m ³	6.0	6.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
142-82-5	n-Heptane	ND		ug/m ³	7.0	7.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
75-09-2	Methylene chloride	ND		ug/m ³	5.9	5.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	6.1	6.1	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
108-10-1	4-Methyl-2-pentanone	ND		ug/m ³	7.0	7.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
67-63-0	Isopropanol	ND		ug/m ³	4.2	4.2	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
87-68-3	Hexachlorobutadiene	ND		ug/m ³	18	18	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
100-41-4	Ethyl Benzene	ND		ug/m ³	7.4	7.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
141-78-6	Ethyl acetate	ND		ug/m ³	6.2	6.2	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
110-82-7	Cyclohexane	ND		ug/m ³	5.9	5.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	7.8	7.8	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
156-59-2	cis-1,2-Dichloroethylene	ND		ug/m ³	6.8	6.8	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
74-87-3	Chloromethane	ND		ug/m ³	3.5	3.5	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
67-66-3	Chloroform	ND		ug/m ³	8.3	8.3	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
75-00-3	Chloroethane	ND		ug/m ³	4.5	4.5	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
56-23-5	Carbon tetrachloride	ND		ug/m ³	5.4	5.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
75-15-0	Carbon disulfide	ND		ug/m ³	5.3	5.3	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
74-83-9	Bromomethane	ND		ug/m ³	6.6	6.6	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
75-25-2	Bromoform	ND		ug/m ³	18	18	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB



Sample Information

Client Sample ID: AQ072913:1305NP4-2

York Sample ID: 13G1045-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1045

Rowe Industries

Vapor Extraction

July 29, 2013 1:05 pm

07/30/2013

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-27-4	Bromodichloromethane	ND		ug/m ³	11	11	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
100-44-7	Benzyl chloride	ND		ug/m ³	8.8	8.8	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
71-43-2	Benzene	ND		ug/m ³	5.5	5.5	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
67-64-1	Acetone	7.7	B	ug/m ³	4.1	4.1	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
591-78-6	2-Hexanone	ND		ug/m ³	7.0	7.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
78-93-3	2-Butanone	ND		ug/m ³	5.0	5.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
123-91-1	1,4-Dioxane	ND		ug/m ³	6.2	6.2	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
106-46-7	1,4-Dichlorobenzene	ND		ug/m ³	10	10	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	10	10	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
106-99-0	1,3-Butadiene	ND		ug/m ³	7.4	7.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
108-67-8	1,3,5-Trimethylbenzene	ND		ug/m ³	8.4	8.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	12	12	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
78-87-5	1,2-Dichloropropane	ND		ug/m ³	7.9	7.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
107-06-2	1,2-Dichloroethane	ND		ug/m ³	6.9	6.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	10	10	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
95-63-6	1,2,4-Trimethylbenzene	ND		ug/m ³	8.4	8.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	13	13	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	6.8	6.8	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
75-34-3	1,1-Dichloroethane	ND		ug/m ³	6.9	6.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
75-69-4	Trichlorofluoromethane (Freon 11)	ND		ug/m ³	9.6	9.6	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	9.3	9.3	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/m ³	13	13	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	12	12	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
71-55-6	1,1,1-Trichloroethane	10		ug/m ³	9.3	9.3	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
75-71-8	Dichlorodifluoromethane	ND		ug/m ³	8.4	8.4	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
106-93-4	1,2-Dibromoethane	ND		ug/m ³	13	13	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
124-48-1	Dibromochloromethane	ND		ug/m ³	14	14	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
80-62-6	Methyl Methacrylate	ND		ug/m ³	7.0	7.0	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
108-90-7	Chlorobenzene	ND		ug/m ³	7.9	7.9	16.8	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 13:50	RB
	Surrogate Recoveries	Result			Acceptance Range						
460-00-4	Surrogate: <i>p</i> -Bromofluorobenzene	97.2 %			70-130						



Sample Information

Client Sample ID: AQ072913:1310NP4-3

York Sample ID: 13G1045-03

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1045

Rowe Industries

Vapor Extraction

July 29, 2013 1:10 pm

07/30/2013

Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-01-4	Vinyl Chloride	ND		ug/m ³	4.5	4.5	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
108-05-4	Vinyl acetate	ND		ug/m ³	6.2	6.2	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
79-01-6	Trichloroethylene	ND		ug/m ³	4.7	4.7	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/m ³	7.9	7.9	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
156-60-5	trans-1,2-Dichloroethylene	ND		ug/m ³	6.9	6.9	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
108-88-3	Toluene	ND		ug/m ³	6.6	6.6	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
109-99-9	Tetrahydrofuran	ND		ug/m ³	5.2	5.2	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
127-18-4	Tetrachloroethylene	ND		ug/m ³	12	12	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
100-42-5	Styrene	ND		ug/m ³	7.5	7.5	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
115-07-01	Propylene	ND		ug/m ³	3.0	3.0	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
622-96-8	p-Ethyltoluene	ND		ug/m ³	43	43	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
179601-23-1	p- & m- Xylenes	ND		ug/m ³	15	15	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
95-47-6	o-Xylene	ND		ug/m ³	7.6	7.6	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
110-54-3	n-Hexane	ND		ug/m ³	6.2	6.2	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
142-82-5	n-Heptane	ND		ug/m ³	7.2	7.2	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
75-09-2	Methylene chloride	ND		ug/m ³	6.1	6.1	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/m ³	6.3	6.3	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
108-10-1	4-Methyl-2-pentanone	ND		ug/m ³	7.2	7.2	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
67-63-0	Isopropanol	ND		ug/m ³	4.3	4.3	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
87-68-3	Hexachlorobutadiene	ND		ug/m ³	19	19	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
100-41-4	Ethyl Benzene	ND		ug/m ³	7.6	7.6	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
141-78-6	Ethyl acetate	ND		ug/m ³	6.3	6.3	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
110-82-7	Cyclohexane	ND		ug/m ³	6.0	6.0	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/m ³	7.9	7.9	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
156-59-2	cis-1,2-Dichloroethylene	ND		ug/m ³	6.9	6.9	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
74-87-3	Chloromethane	ND		ug/m ³	3.6	3.6	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
67-66-3	Chloroform	ND		ug/m ³	8.5	8.5	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
75-00-3	Chloroethane	ND		ug/m ³	4.6	4.6	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
56-23-5	Carbon tetrachloride	ND		ug/m ³	5.5	5.5	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
75-15-0	Carbon disulfide	ND		ug/m ³	5.4	5.4	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
74-83-9	Bromomethane	ND		ug/m ³	6.8	6.8	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
75-25-2	Bromoform	ND		ug/m ³	18	18	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB



Sample Information

Client Sample ID: AQ072913:1310NP4-3

York Sample ID: 13G1045-03

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G1045

Rowe Industries

Vapor Extraction

July 29, 2013 1:10 pm

07/30/2013


Volatile Organics, EPA TO15 Full List

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA TO15 PREP

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-27-4	Bromodichloromethane	ND		ug/m ³	11	11	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
100-44-7	Benzyl chloride	ND		ug/m ³	9.1	9.1	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
71-43-2	Benzene	ND		ug/m ³	5.6	5.6	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
67-64-1	Acetone	6.2	B	ug/m ³	4.2	4.2	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
591-78-6	2-Hexanone	ND		ug/m ³	7.2	7.2	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
78-93-3	2-Butanone	ND		ug/m ³	5.2	5.2	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
123-91-1	1,4-Dioxane	ND		ug/m ³	6.3	6.3	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
106-46-7	1,4-Dichlorobenzene	ND		ug/m ³	11	11	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
541-73-1	1,3-Dichlorobenzene	ND		ug/m ³	11	11	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
106-99-0	1,3-Butadiene	ND		ug/m ³	7.6	7.6	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
108-67-8	1,3,5-Trimethylbenzene	ND		ug/m ³	8.6	8.6	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
76-14-2	1,2-Dichlorotetrafluoroethane	ND		ug/m ³	12	12	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
78-87-5	1,2-Dichloropropane	ND		ug/m ³	8.1	8.1	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
107-06-2	1,2-Dichloroethane	ND		ug/m ³	7.1	7.1	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
95-50-1	1,2-Dichlorobenzene	ND		ug/m ³	11	11	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
95-63-6	1,2,4-Trimethylbenzene	ND		ug/m ³	8.6	8.6	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
120-82-1	1,2,4-Trichlorobenzene	ND		ug/m ³	13	13	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
75-35-4	1,1-Dichloroethylene	ND		ug/m ³	6.9	6.9	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
75-34-3	1,1-Dichloroethane	ND		ug/m ³	7.1	7.1	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
75-69-4	Trichlorofluoromethane (Freon 11)	ND		ug/m ³	9.8	9.8	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
79-00-5	1,1,2-Trichloroethane	ND		ug/m ³	9.5	9.5	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/m ³	13	13	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/m ³	12	12	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
71-55-6	1,1,1-Trichloroethane	ND		ug/m ³	9.5	9.5	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
75-71-8	Dichlorodifluoromethane	ND		ug/m ³	8.7	8.7	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
106-93-4	1,2-Dibromoethane	ND		ug/m ³	13	13	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
124-48-1	Dibromochloromethane	ND		ug/m ³	14	14	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
80-62-6	Methyl Methacrylate	ND		ug/m ³	7.2	7.2	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
108-90-7	Chlorobenzene	ND		ug/m ³	8.1	8.1	17.2	EPA Compendium TO-15	08/02/2013 10:32	08/06/2013 14:35	RB
	Surrogate Recoveries	Result			Acceptance Range						
460-00-4	Surrogate: p-Bromofluorobenzene	97.6 %			70-130						



Analytical Batch Summary

Batch ID: BH30246

Preparation Method: EPA TO15 PREP

Prepared By: RQB

YORK Sample ID	Client Sample ID	Preparation Date
13G1045-01	AQ072913:1300NP4-1	08/02/13
13G1045-02	AQ072913:1305NP4-2	08/02/13
13G1045-03	AQ072913:1310NP4-3	08/02/13
BH30246-BLK1	Blank	08/06/13
BH30246-BS1	LCS	08/06/13



Volatile Organic Compounds by EPA Compendium TO14A/TO15 - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30246 - EPA TO15 PREP

Blank (BH30246-BLK1)

Prepared & Analyzed: 08/06/2013

Vinyl Chloride	ND	0.26	ug/m ³								
Vinyl acetate	ND	0.36	"								
Trichloroethylene	ND	0.27	"								
trans-1,3-Dichloropropylene	ND	0.46	"								
trans-1,2-Dichloroethylene	ND	0.40	"								
Toluene	ND	0.38	"								
Tetrahydrofuran	ND	0.30	"								
Tetrachloroethylene	ND	0.69	"								
Styrene	ND	0.43	"								
Propylene	ND	0.18	"								
p-Ethyltoluene	ND	2.5	"								
p- & m- Xylenes	ND	0.88	"								
o-Xylene	ND	0.44	"								
n-Hexane	ND	0.36	"								
n-Heptane	ND	0.42	"								
Methylene chloride	ND	0.35	"								
Methyl tert-butyl ether (MTBE)	ND	0.37	"								
4-Methyl-2-pentanone	ND	0.42	"								
Isopropanol	ND	0.25	"								
Hexachlorobutadiene	ND	1.1	"								
Ethyl Benzene	ND	0.44	"								
Ethyl acetate	ND	0.37	"								
Cyclohexane	ND	0.35	"								
cis-1,3-Dichloropropylene	ND	0.46	"								
cis-1,2-Dichloroethylene	ND	0.40	"								
Chloromethane	ND	0.21	"								
Chloroform	ND	0.50	"								
Chloroethane	ND	0.27	"								
Carbon tetrachloride	ND	0.32	"								
Carbon disulfide	ND	0.32	"								
Bromomethane	ND	0.39	"								
Bromoform	ND	1.1	"								
Bromodichloromethane	ND	0.63	"								
Benzyl chloride	ND	0.53	"								
Benzene	ND	0.32	"								
Acetone	0.48	0.24	"								
2-Hexanone	ND	0.42	"								
2-Butanone	ND	0.30	"								
1,4-Dioxane	ND	0.37	"								
1,4-Dichlorobenzene	ND	0.61	"								
1,3-Dichlorobenzene	ND	0.61	"								
1,3-Butadiene	ND	0.44	"								
1,3,5-Trimethylbenzene	ND	0.50	"								
1,2-Dichlorotetrafluoroethane	ND	0.71	"								
1,2-Dichloropropane	ND	0.47	"								
1,2-Dichloroethane	ND	0.41	"								
1,2-Dichlorobenzene	ND	0.61	"								
1,2,4-Trimethylbenzene	ND	0.50	"								
1,2,4-Trichlorobenzene	ND	0.75	"								
1,1-Dichloroethylene	ND	0.40	"								
1,1-Dichloroethane	ND	0.41	"								



Volatile Organic Compounds by EPA Compendium TO14A/TO15 - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BH30246 - EPA TO15 PREP

Blank (BH30246-BLK1)

Prepared & Analyzed: 08/06/2013

Trichlorofluoromethane (Freon 11)	ND	0.57	ug/m ³								
1,1,2-Trichloroethane	ND	0.55	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.78	"								
1,1,2,2-Tetrachloroethane	ND	0.70	"								
1,1,1-Trichloroethane	ND	0.55	"								
Dichlorodifluoromethane	ND	0.50	"								
1,2-Dibromoethane	ND	0.78	"								
Dibromochloromethane	ND	0.82	"								
Methyl Methacrylate	ND	0.42	"								
Chlorobenzene	ND	0.47	"								

Surrogate: *p*-Bromofluorobenzene 8.90 ppbv 10.0 89.0 70-130

LCS (BH30246-BS1)

Prepared & Analyzed: 08/06/2013

Vinyl Chloride	11.1		ppbv	10.5	106	70-130					
Vinyl acetate	10.7		"	10.4	103	58.1-135					
Trichloroethylene	11.1		"	10.6	105	70-130					
trans-1,3-Dichloropropylene	12.6		"	11.5	110	62-135					
trans-1,2-Dichloroethylene	11.0		"	10.3	107	58.3-130					
Toluene	12.7		"	11.0	116	64.9-126					
Tetrahydrofuran	11.0		"	10.8	102	44.6-146					
Tetrachloroethylene	11.7		"	10.8	108	70-130					
Styrene	10.8		"	10.9	99.3	66.4-132					
Propylene	11.0		"	11.5	95.3	62.4-150					
<i>p</i> -Ethyltoluene	10.6		"	10.4	102	73.8-146					
<i>p</i> - & <i>m</i> - Xylenes	25.8		"	21.8	118	56.6-136					
<i>o</i> -Xylene	10.8		"	11.0	97.9	67.8-133					
<i>n</i> -Hexane	13.0		"	10.9	119	59.7-130					
<i>n</i> -Heptane	12.8		"	10.9	117	62.3-134					
Methylene chloride	9.88		"	9.70	102	62.6-130					
Methyl tert-butyl ether (MTBE)	10.2		"	10.3	99.1	60.7-139					
4-Methyl-2-pentanone	10.3		"	10.6	96.9	64.5-158					
Isopropanol	12.7		"	10.9	117	60-150					
Hexachlorobutadiene	11.9		"	10.2	116	61.2-150					
Ethyl Benzene	12.8		"	11.0	117	68.4-125					
Ethyl acetate	12.2		"	11.0	110	40.6-150					
Cyclohexane	12.8		"	10.8	119	60.4-127					
cis-1,3-Dichloropropylene	12.9		"	10.9	119	65.5-129					
cis-1,2-Dichloroethylene	11.4		"	10.8	106	51.3-118					
Chloromethane	9.82		"	10.3	95.3	64.9-130					
Chloroform	11.3		"	11.0	102	65.1-130					
Chloroethane	10.8		"	10.3	105	52.1-131					
Carbon tetrachloride	10.1		"	10.5	96.1	70-130					
Carbon disulfide	10.7		"	10.5	102	61.8-111					
Bromomethane	10.0		"	10.5	95.4	60.1-140					
Bromoform	12.3		"	10.9	113	58.7-150					
Bromodichloromethane	10.9		"	10.6	103	65.3-127					
Benzyl chloride	10.5		"	10.8	97.5	62.5-150					
Benzene	11.8		"	10.8	109	69.5-130					
Acetone	10.2		"	11.0	92.9	55.3-133					
2-Hexanone	10.5		"	10.9	96.0	52-150					
2-Butanone	11.1		"	10.9	102	28.5-154					
1,4-Dioxane	12.4		"	10.6	117	50-150					



Volatile Organic Compounds by EPA Compendium TO14A/TO15 - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike Level	Source*	%REC	%REC Limits	Flag	RPD	RPD	Flag
		Limit			Result					Limit	
Batch BH30246 - EPA TO15 PREP											
LCS (BH30246-BS1)										Prepared & Analyzed: 08/06/2013	
1,4-Dichlorobenzene	10.6		ppbv	10.9		97.4	62.5-139				
1,3-Dichlorobenzene	10.6		"	10.8		98.6	71.9-153				
1,3-Butadiene	12.0		"	10.9		110	66.7-127				
1,3,5-Trimethylbenzene	10.6		"	11.0		96.7	65-152				
1,2-Dichlorotetrafluoroethane	10.3		"	10.5		98.2	63.3-129				
1,2-Dichloropropane	11.8		"	11.0		107	21.3-152				
1,2-Dichloroethane	11.1		"	10.7		103	51.2-124				
1,2-Dichlorobenzene	10.3		"	10.7		96.5	63.7-148				
1,2,4-Trimethylbenzene	10.7		"	11.0		97.5	67.9-152				
1,2,4-Trichlorobenzene	9.54		"	10.0		95.4	58-147				
1,1-Dichloroethylene	10.2		"	9.60		106	58.1-130				
1,1-Dichloroethane	10.7		"	10.3		104	63.3-130				
Trichlorofluoromethane (Freon 11)	9.90		"	11.0		90.0	56-132				
1,1,2-Trichloroethane	11.6		"	11.0		106	66-127				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	8.82		"	9.20		95.9	60.2-125				
1,1,2,2-Tetrachloroethane	12.3		"	11.0		112	63.7-132				
1,1,1-Trichloroethane	10.6		"	10.5		101	58.2-126				
Dichlorodifluoromethane	9.65		"	10.2		94.6	62.8-133				
1,2-Dibromoethane	12.2		"	11.0		111	70-130				
Dibromochloromethane	11.5		"	10.7		107	70-130				
Methyl Methacrylate	1.78		"	10.7		16.6	70-130	Low Bias			
Chlorobenzene	11.5		"	11.0		105	67.6-122				
<i>Surrogate: p-Bromofluorobenzene</i>	<i>10.1</i>		<i>"</i>	<i>10.0</i>		<i>101</i>	<i>70-130</i>				



Notes and Definitions

B Analyte is found in the associated analysis batch blank. For volatiles, methylene chloride and acetone are common lab contaminants. Data users should consider anything <10x the blank value as artifact.

ND Analyte NOT DETECTED at the stated Reporting Limit (RL) or above.

RL REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.

MDL METHOD DETECTION LIMIT - the minimum concentration that can be measured and reported with a 99% confidence that the concentration is greater than zero. If requested or required, a value reported below the RL and above the MDL is considered estimated and is noted with a "J" flag.

NR Not reported

RPD Relative Percent Difference

Wet The data has been reported on an as-received (wet weight) basis

Low Bias Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.

High Bias High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.

Non-Dir. Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two.

For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the MDL, with values between the MDL and the RL being "J" flagged as estimated results.

Field Chain-of-Custody Record - AIR

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions unless superseded by written contract.

York Project No. 13G1045

YOUR Information Company: <u>LBG</u> Address: <u>4 Research Dr, Suite 301</u> <u>Shelton, CT 06484</u> Phone No. <u>203-929-8555</u> Contact Person: <u>Tunde Sandor</u> E-Mail Address: <u>TSandor@LBGCT.COM</u>		Report To: Company: <u>Same</u> Address: _____ Phone No. _____ Attention: _____ E-Mail Address: _____		YOUR Project ID <u>Rowe Industries</u> Purchase Order No. <u>NABSAG</u> Samples from: CT <u>NYX</u> NJ _____		Turn-Around Time RUSH - Same Day <input type="checkbox"/> RUSH - Next Day <input type="checkbox"/> RUSH - Two Day <input type="checkbox"/> RUSH - Three Day <input type="checkbox"/> RUSH - Four Day <input type="checkbox"/> Standard(5-7 Days) <input checked="" type="checkbox"/>		Report Type/Deliverables Summary Report <input checked="" type="checkbox"/> <u>pdf</u> Summary w/ QA Summary <input checked="" type="checkbox"/> <u>pdf</u> CT RCP Package _____ NY ASP A Package _____ NY ASP B/CLP Pkg _____ NJDEP Reduced _____ Electronic Deliverables: _____ EDD (Specify Type) _____ Standard Excel _____ Regulatory Comparison Excel _____	
--	--	---	--	---	--	---	--	--	--

Print Clearly and Legibly. All Information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.


TO15 Volatiles and Other Gas Analyses EPA TO-14A List Tentatively Identified Compounds	Detection Limits Required ≤ 1 ug/m ³ NYSDEC VI Limits (if paper instruction) NJDEP low level Routine Survey Other _____
EPA TO-15 List NYSDEC VI list NYSDEC STARS List Project Specific List by TO-15 Helium NJDEP Target List CTDEP RCP Target List	Air Matrix Codes AI- INDOOR Ambient Air AO- OUTDOOR Amb Air AE- Vapor Extraction Well/ Process Gas/Effluent AS- SOIL Vapor/Sub-Slab

Sample Identification	Date Sampled	AIR Matrix	Canister Vacuum Before Sampling (in. Hg)	Canister Vacuum After Sampling (in. Hg)	Choose Analyze Needed from the Menu Above and Enter Below	Sampling Media
<u>AR072913.1300NP4-1</u>	<u>7/29/13 1300</u>	<u>AE</u>			<u>EPA TO-15 List</u>	6 Liter Summa canister ✓ Tedlar Bag ✓
<u>AR072913.1305NP4-2</u>	<u>↓ 1305</u>	<u>AE</u>				6 Liter Summa canister ✓ Tedlar Bag ✓
<u>AR072913.1310NP4-3</u>	<u>↓ 1310</u>	<u>AC</u>				6 Liter Summa canister ✓ Tedlar Bag ✓
						6 Liter Summa canister _____ Tedlar Bag _____
						6 Liter Summa canister _____ Tedlar Bag _____
						6 Liter Summa canister _____ Tedlar Bag _____
						6 Liter Summa canister _____ Tedlar Bag _____
						6 Liter Summa canister _____ Tedlar Bag _____
						6 Liter Summa canister _____ Tedlar Bag _____

Comments Grab samples, no regulator used

Number 73015 at 2:35
 Samples Relinquished By _____ Date/Time _____
 Samples Relinquished in LAB by _____ Date/Time _____

APPENDIX IV
JULY 2013 LABORATORY ANALYTICAL REPORTS
FOR MONITOR WELLS



Technical Report

prepared for:

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301

Shelton CT, 06484

Attention: Tunde Komuves-Sandor

Report Date: 07/31/2013

Client Project ID: O&M Sag Harbor (Rowe Industries Site)

York Project (SDG) No.: 13G0915

CT Cert. No. PH-0723

New Jersey Cert. No. CT-005



New York Cert. No. 10854

PA Cert. No. 68-04440

Leggette Brashears & Graham Shelton Office

4 Research Drive, Suite 301
Shelton CT, 06484
Attention: Tunde Komuves-Sandor

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on July 25, 2013 and listed below. The project was identified as your project: **O&M Sag Harbor (Rowe Industries Site)**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Notes section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the attachment to this report, and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
13G0915-01	MW98-04	Water	07/23/2013	07/25/2013

General Notes for York Project (SDG) No.: 13G0915

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All samples were received in proper condition for analysis with proper documentation, unless otherwise noted.
6. All analyses conducted met method or Laboratory SOP requirements. See the Qualifiers and/or Narrative sections for further information.
7. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
8. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 07/31/2013

YORK



Sample Information

Client Sample ID: MW98-04 **York Sample ID:** 13G0915-01
York Project (SDG) No.: 13G0915 **Client Project ID:** O&M Sag Harbor (Rowe Industries Site) **Matrix:** Water **Collection Date/Time:** July 23, 2013 10:15 am **Date Received:** 07/25/2013

Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
75-34-3	1,1-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.20	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
106-93-4	1,2-Dibromoethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
107-06-2	1,2-Dichloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
78-87-5	1,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
142-28-9	1,3-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
594-20-7	2,2-Dichloropropane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
95-49-8	2-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
591-78-6	2-Hexanone	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
106-43-4	4-Chlorotoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
67-64-1	Acetone	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
71-43-2	Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
108-86-1	Bromobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
74-97-5	Bromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
75-27-4	Bromodichloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
75-25-2	Bromoform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
74-83-9	Bromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS



Sample Information

Client Sample ID: MW98-04

York Sample ID: 13G0915-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0915

O&M Sag Harbor (Rowe Industries Site)

Water

July 23, 2013 10:15 am

07/25/2013


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
56-23-5	Carbon tetrachloride	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
108-90-7	Chlorobenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
75-00-3	Chloroethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
67-66-3	Chloroform	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
74-87-3	Chloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
124-48-1	Dibromochloromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
74-95-3	Dibromomethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
100-41-4	Ethyl Benzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
87-68-3	Hexachlorobutadiene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
98-82-8	Isopropylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
75-09-2	Methylene chloride	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
91-20-3	Naphthalene	ND		ug/L	1.0	2.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
104-51-8	n-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
103-65-1	n-Propylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
95-47-6	o-Xylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
179601-23-1	p- & m- Xylenes	ND		ug/L	0.50	1.0	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
99-87-6	p-Isopropyltoluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
135-98-8	sec-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
100-42-5	Styrene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
98-06-6	tert-Butylbenzene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
127-18-4	Tetrachloroethylene	2.7		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
108-88-3	Toluene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
79-01-6	Trichloroethylene	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
75-69-4	Trichlorofluoromethane	ND		ug/L	0.20	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
75-01-4	Vinyl Chloride	ND		ug/L	0.50	0.50	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS
1330-20-7	Xylenes, Total	ND		ug/L	0.60	1.5	1	EPA SW846-8260B	07/29/2013 10:45	07/30/2013 04:38	SS



Sample Information

Client Sample ID: MW98-04

York Sample ID: 13G0915-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

13G0915

O&M Sag Harbor (Rowe Industries Site)

Water

July 23, 2013 10:15 am

07/25/2013


Volatile Organics, 8260 List - Low Level

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	MDL	RL	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
	Surrogate Recoveries	Result									
17060-07-0	Surrogate: 1,2-Dichloroethane-d4	113 %			72.6	129					
460-00-4	Surrogate: p-Bromofluorobenzene	91.1 %			63.5	145					
2037-26-5	Surrogate: Toluene-d8	106 %			81.2	127					



Analytical Batch Summary

Batch ID: BG31324

Preparation Method: EPA 5030B

Prepared By: KH

YORK Sample ID	Client Sample ID	Preparation Date
13G0915-01	MW98-04	07/29/13
BG31324-BLK1	Blank	07/29/13
BG31324-BS1	LCS	07/29/13
BG31324-BSD1	LCS Dup	07/29/13



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31324 - EPA 5030B

Blank (BG31324-BLK1)

Prepared & Analyzed: 07/29/2013

1,1,1,2-Tetrachloroethane	ND	0.50	ug/L								
1,1,1-Trichloroethane	ND	0.50	"								
1,1,2,2-Tetrachloroethane	ND	0.50	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.50	"								
1,1,2-Trichloroethane	ND	0.50	"								
1,1-Dichloroethane	ND	0.50	"								
1,1-Dichloroethylene	ND	0.50	"								
1,1-Dichloropropylene	ND	0.50	"								
1,2,3-Trichlorobenzene	ND	2.0	"								
1,2,3-Trichloropropane	ND	0.50	"								
1,2,4-Trichlorobenzene	ND	2.0	"								
1,2,4-Trimethylbenzene	ND	0.50	"								
1,2-Dibromo-3-chloropropane	ND	2.0	"								
1,2-Dibromoethane	ND	0.50	"								
1,2-Dichlorobenzene	ND	0.50	"								
1,2-Dichloroethane	ND	0.50	"								
1,2-Dichloropropane	ND	0.50	"								
1,3,5-Trimethylbenzene	ND	0.50	"								
1,3-Dichlorobenzene	ND	0.50	"								
1,3-Dichloropropane	ND	0.50	"								
1,4-Dichlorobenzene	ND	0.50	"								
2,2-Dichloropropane	ND	0.50	"								
2-Chlorotoluene	ND	0.50	"								
2-Hexanone	ND	0.50	"								
4-Chlorotoluene	ND	0.50	"								
Acetone	ND	2.0	"								
Benzene	ND	0.50	"								
Bromobenzene	ND	0.50	"								
Bromochloromethane	ND	0.50	"								
Bromodichloromethane	ND	0.50	"								
Bromoform	ND	0.50	"								
Bromomethane	ND	0.50	"								
Carbon tetrachloride	ND	0.50	"								
Chlorobenzene	ND	0.50	"								
Chloroethane	ND	0.50	"								
Chloroform	ND	0.50	"								
Chloromethane	ND	0.50	"								
cis-1,2-Dichloroethylene	ND	0.50	"								
cis-1,3-Dichloropropylene	ND	0.50	"								
Dibromochloromethane	ND	0.50	"								
Dibromomethane	ND	0.50	"								
Dichlorodifluoromethane	ND	0.50	"								
Ethyl Benzene	ND	0.50	"								
Hexachlorobutadiene	ND	0.50	"								
Isopropylbenzene	ND	0.50	"								
Methyl tert-butyl ether (MTBE)	ND	0.50	"								
Methylene chloride	ND	2.0	"								
Naphthalene	ND	2.0	"								
n-Butylbenzene	ND	0.50	"								
n-Propylbenzene	ND	0.50	"								
o-Xylene	ND	0.50	"								



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BG31324 - EPA 5030B

Blank (BG31324-BLK1)

Prepared & Analyzed: 07/29/2013

p- & m- Xylenes	ND	1.0	ug/L								
p-Isopropyltoluene	ND	0.50	"								
sec-Butylbenzene	ND	0.50	"								
Styrene	ND	0.50	"								
tert-Butylbenzene	ND	0.50	"								
Tetrachloroethylene	ND	0.50	"								
Toluene	ND	0.50	"								
trans-1,2-Dichloroethylene	ND	0.50	"								
trans-1,3-Dichloropropylene	ND	0.50	"								
Trichloroethylene	ND	0.50	"								
Trichlorofluoromethane	ND	0.50	"								
Vinyl Chloride	ND	0.50	"								
Xylenes, Total	ND	1.5	"								

Surrogate: 1,2-Dichloroethane-d4

10.9

"

10.0

109

72.6-129

Surrogate: p-Bromofluorobenzene

9.32

"

10.0

93.2

63.5-145

Surrogate: Toluene-d8

10.6

"

10.0

106

81.2-127

LCS (BG31324-BS1)

Prepared & Analyzed: 07/29/2013

1,1,1,2-Tetrachloroethane	10.8		ug/L	10.0		108	82.3-130				
1,1,1-Trichloroethane	10.8		"	10.0		108	75.6-137				
1,1,2,2-Tetrachloroethane	10.2		"	10.0		102	71.3-131				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	10.0		"	10.0		100	71.1-129				
1,1,2-Trichloroethane	10.5		"	10.0		105	74.5-129				
1,1-Dichloroethane	9.93		"	10.0		99.3	79.6-132				
1,1-Dichloroethylene	9.27		"	10.0		92.7	80.2-146				
1,1-Dichloropropylene	9.50		"	10.0		95.0	75-136				
1,2,3-Trichlorobenzene	9.58		"	10.0		95.8	66.1-136				
1,2,3-Trichloropropane	10.1		"	10.0		101	63-131				
1,2,4-Trichlorobenzene	9.66		"	10.0		96.6	70.6-136				
1,2,4-Trimethylbenzene	10.0		"	10.0		100	75.3-135				
1,2-Dibromo-3-chloropropane	10.5		"	10.0		105	58.9-140				
1,2-Dibromoethane	11.4		"	10.0		114	79-130				
1,2-Dichlorobenzene	9.62		"	10.0		96.2	76.1-122				
1,2-Dichloroethane	9.88		"	10.0		98.8	74.6-132				
1,2-Dichloropropane	9.17		"	10.0		91.7	76.9-129				
1,3,5-Trimethylbenzene	9.97		"	10.0		99.7	70.6-127				
1,3-Dichlorobenzene	9.87		"	10.0		98.7	77-124				
1,3-Dichloropropane	10.5		"	10.0		105	75.8-126				
1,4-Dichlorobenzene	9.89		"	10.0		98.9	76.6-125				
2,2-Dichloropropane	11.0		"	10.0		110	69-133				
2-Chlorotoluene	9.60		"	10.0		96.0	66.3-119				
2-Hexanone	10.7		"	10.0		107	70-130				
4-Chlorotoluene	9.90		"	10.0		99.0	69.2-127				
Acetone	9.04		"	10.0		90.4	70-130				
Benzene	9.64		"	10.0		96.4	76.2-129				
Bromobenzene	9.88		"	10.0		98.8	71.3-123				
Bromochloromethane	9.80		"	10.0		98.0	70.8-137				
Bromodichloromethane	10.1		"	10.0		101	79.7-134				
Bromoform	11.8		"	10.0		118	70.5-141				
Bromomethane	7.90		"	10.0		79.0	43.9-147				
Carbon tetrachloride	12.0		"	10.0		120	78.1-138				
Chlorobenzene	9.73		"	10.0		97.3	80.4-125				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting	Units	Spike Level	Source*	%REC	%REC Limits	Flag	RPD	RPD	Flag
		Limit			Result					Limit	

Batch BG31324 - EPA 5030B

LCS (BG31324-BS1)

Prepared & Analyzed: 07/29/2013

Chloroethane	9.00		ug/L	10.0		90.0	55.8-140				
Chloroform	10.1		"	10.0		101	76.6-133				
Chloromethane	7.86		"	10.0		78.6	48.8-115				
cis-1,2-Dichloroethylene	9.69		"	10.0		96.9	75.1-128				
cis-1,3-Dichloropropylene	10.5		"	10.0		105	74.5-128				
Dibromochloromethane	12.5		"	10.0		125	79.8-134				
Dibromomethane	9.76		"	10.0		97.6	79-130				
Dichlorodifluoromethane	7.83		"	10.0		78.3	47.1-101				
Ethyl Benzene	10.2		"	10.0		102	80.8-128				
Hexachlorobutadiene	10.1		"	10.0		101	64.8-128				
Isopropylbenzene	10.0		"	10.0		100	75.5-135				
Methyl tert-butyl ether (MTBE)	9.76		"	10.0		97.6	65.1-140				
Methylene chloride	9.30		"	10.0		93.0	61.3-120				
Naphthalene	9.89		"	10.0		98.9	62.3-148				
n-Butylbenzene	9.58		"	10.0		95.8	67.2-123				
n-Propylbenzene	9.84		"	10.0		98.4	70.5-127				
o-Xylene	9.58		"	10.0		95.8	75.9-122				
p- & m- Xylenes	19.8		"	20.0		99.2	77.7-127				
p-Isopropyltoluene	10.2		"	10.0		102	75.6-129				
sec-Butylbenzene	10.2		"	10.0		102	71.5-125				
Styrene	10.2		"	10.0		102	77.8-123				
tert-Butylbenzene	10.4		"	10.0		104	75.9-151				
Tetrachloroethylene	9.67		"	10.0		96.7	63.6-167				
Toluene	10.4		"	10.0		104	77-123				
trans-1,2-Dichloroethylene	9.45		"	10.0		94.5	76.3-139				
trans-1,3-Dichloropropylene	12.1		"	10.0		121	72.5-137				
Trichloroethylene	9.36		"	10.0		93.6	77.9-130				
Trichlorofluoromethane	10.0		"	10.0		100	57.4-133				
Vinyl Chloride	8.66		"	10.0		86.6	54.9-124				
Surrogate: 1,2-Dichloroethane-d4	10.0		"	10.0		100	72.6-129				
Surrogate: p-Bromofluorobenzene	10.3		"	10.0		103	63.5-145				
Surrogate: Toluene-d8	9.95		"	10.0		99.5	81.2-127				



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
Batch BG31324 - EPA 5030B											
LCS Dup (BG31324-BS1)											
Prepared & Analyzed: 07/29/2013											
1,1,1,2-Tetrachloroethane	10.8		ug/L	10.0		108	82.3-130		0.647	21.1	
1,1,1-Trichloroethane	11.0		"	10.0		110	75.6-137		2.20	19.7	
1,1,2,2-Tetrachloroethane	9.97		"	10.0		99.7	71.3-131		1.79	20.8	
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	9.82		"	10.0		98.2	71.1-129		2.02	21.7	
1,1,2-Trichloroethane	10.7		"	10.0		107	74.5-129		1.51	20.3	
1,1-Dichloroethane	9.83		"	10.0		98.3	79.6-132		1.01	20.6	
1,1-Dichloroethylene	9.29		"	10.0		92.9	80.2-146		0.216	20	
1,1-Dichloropropylene	9.43		"	10.0		94.3	75-136		0.740	19.3	
1,2,3-Trichlorobenzene	9.95		"	10.0		99.5	66.1-136		3.79	21.6	
1,2,3-Trichloropropane	10.3		"	10.0		103	63-131		2.07	23.9	
1,2,4-Trichlorobenzene	9.85		"	10.0		98.5	70.6-136		1.95	21.7	
1,2,4-Trimethylbenzene	9.65		"	10.0		96.5	75.3-135		3.76	18.8	
1,2-Dibromo-3-chloropropane	9.96		"	10.0		99.6	58.9-140		5.09	27.7	
1,2-Dibromoethane	11.5		"	10.0		115	79-130		0.523	23	
1,2-Dichlorobenzene	9.43		"	10.0		94.3	76.1-122		1.99	19.8	
1,2-Dichloroethane	10.2		"	10.0		102	74.6-132		3.19	20.2	
1,2-Dichloropropane	10.8		"	10.0		108	76.9-129		16.3	20.7	
1,3,5-Trimethylbenzene	9.62		"	10.0		96.2	70.6-127		3.57	18.9	
1,3-Dichlorobenzene	9.75		"	10.0		97.5	77-124		1.22	19.2	
1,3-Dichloropropane	10.5		"	10.0		105	75.8-126		0.285	22.1	
1,4-Dichlorobenzene	9.73		"	10.0		97.3	76.6-125		1.63	18.6	
2,2-Dichloropropane	10.7		"	10.0		107	69-133		2.30	19.8	
2-Chlorotoluene	9.24		"	10.0		92.4	66.3-119		3.82	21.6	
2-Hexanone	10.9		"	10.0		109	70-130		2.59	30	
4-Chlorotoluene	9.51		"	10.0		95.1	69.2-127		4.02	19	
Acetone	9.42		"	10.0		94.2	70-130		4.12	30	
Benzene	9.70		"	10.0		97.0	76.2-129		0.620	19	
Bromobenzene	9.62		"	10.0		96.2	71.3-123		2.67	20.3	
Bromochloromethane	9.94		"	10.0		99.4	70.8-137		1.42	23.9	
Bromodichloromethane	11.3		"	10.0		113	79.7-134		10.6	21	
Bromoform	11.9		"	10.0		119	70.5-141		1.35	21.8	
Bromomethane	8.12		"	10.0		81.2	43.9-147		2.75	28.4	
Carbon tetrachloride	12.2		"	10.0		122	78.1-138		1.74	20.1	
Chlorobenzene	9.59		"	10.0		95.9	80.4-125		1.45	19.9	
Chloroethane	8.42		"	10.0		84.2	55.8-140		6.66	23.3	
Chloroform	10.2		"	10.0		102	76.6-133		0.985	20.3	
Chloromethane	7.66		"	10.0		76.6	48.8-115		2.58	24.5	
cis-1,2-Dichloroethylene	9.57		"	10.0		95.7	75.1-128		1.25	20.5	
cis-1,3-Dichloropropylene	12.4		"	10.0		124	74.5-128		16.2	19.9	
Dibromochloromethane	13.5		"	10.0		135	79.8-134	High Bias	7.40	21.3	
Dibromomethane	11.2		"	10.0		112	79-130		13.8	22.4	
Dichlorodifluoromethane	7.97		"	10.0		79.7	47.1-101		1.77	23.9	
Ethyl Benzene	9.94		"	10.0		99.4	80.8-128		2.78	19.2	
Hexachlorobutadiene	9.94		"	10.0		99.4	64.8-128		1.70	20.6	
Isopropylbenzene	9.58		"	10.0		95.8	75.5-135		4.39	20	
Methyl tert-butyl ether (MTBE)	11.0		"	10.0		110	65.1-140		11.9	23.6	
Methylene chloride	9.37		"	10.0		93.7	61.3-120		0.750	20.4	
Naphthalene	10.5		"	10.0		105	62.3-148		6.08	27.1	
n-Butylbenzene	9.27		"	10.0		92.7	67.2-123		3.29	19.1	
n-Propylbenzene	9.41		"	10.0		94.1	70.5-127		4.47	23.4	
o-Xylene	9.47		"	10.0		94.7	75.9-122		1.15	19.3	



Volatile Organic Compounds by EPA SW846-8260B - Quality Control Data

York Analytical Laboratories, Inc.


Analyte	Result	Reporting	Units	Spike Level	Source*	%REC	%REC Limits	Flag	RPD	
		Limit			Result				RPD	Limit

Batch BG31324 - EPA 5030B

LCS Dup (BG31324-BSD1)

Prepared & Analyzed: 07/29/2013

p- & m- Xylenes	19.4		ug/L	20.0		97.0	77.7-127		2.34	18.6
p-Isopropyltoluene	9.85		"	10.0		98.5	75.6-129		3.59	19.1
sec-Butylbenzene	9.86		"	10.0		98.6	71.5-125		3.78	18.9
Styrene	10.1		"	10.0		101	77.8-123		1.58	20.9
tert-Butylbenzene	9.90		"	10.0		99.0	75.9-151		5.12	20.9
Tetrachloroethylene	9.32		"	10.0		93.2	63.6-167		3.69	27.7
Toluene	10.5		"	10.0		105	77-123		0.954	18.7
trans-1,2-Dichloroethylene	9.33		"	10.0		93.3	76.3-139		1.28	19.5
trans-1,3-Dichloropropylene	12.5		"	10.0		125	72.5-137		3.42	19.3
Trichloroethylene	8.82		"	10.0		88.2	77.9-130		5.94	20.5
Trichlorofluoromethane	10.2		"	10.0		102	57.4-133		1.58	21.4
Vinyl Chloride	8.45		"	10.0		84.5	54.9-124		2.45	22.3
<i>Surrogate: 1,2-Dichloroethane-d4</i>	<i>10.4</i>		<i>"</i>	<i>10.0</i>		<i>104</i>	<i>72.6-129</i>			
<i>Surrogate: p-Bromofluorobenzene</i>	<i>10.0</i>		<i>"</i>	<i>10.0</i>		<i>100</i>	<i>63.5-145</i>			
<i>Surrogate: Toluene-d8</i>	<i>11.0</i>		<i>"</i>	<i>10.0</i>		<i>110</i>	<i>81.2-127</i>			



Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
13G0915-01	MW98-04	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C

Notes and Definitions

QL-02 This LCS analyte is outside Laboratory Recovery limits due the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.

ND Analyte NOT DETECTED at the stated Reporting Limit (RL) or above.

RL REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.

MDL METHOD DETECTION LIMIT - the minimum concentration that can be measured and reported with a 99% confidence that the concentration is greater than zero. If requested or required, a value reported below the RL and above the MDL is considered estimated and is noted with a "J" flag.

NR Not reported

RPD Relative Percent Difference

Wet The data has been reported on an as-received (wet weight) basis

Low Bias Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.

High Bias High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.

Non-Dir. Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the MDL, with values between the MDL and the RL being "J" flagged as estimated results.

Field Chain-of-Custody Record

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions unless superseded by written contract.

York Project No. 1360915

Client Information Company: <u>LBG</u> Address: <u>4 Research Drive, Suite 301, Shelton CT, 06484</u> Phone no.: <u>203-929-8555</u> Contact Person: <u>Tunde Sandor</u> E-mail Addr.: <u>tsandor@lbct.com</u> FAX No.: <u>203-926-9140</u>		Report to: SAME <input type="checkbox"/> Name: <u>Tunde Sandor</u> Company: <u>Same</u> Address: _____ E-mail: _____ Fax No.: _____		Invoice To: SAME <input type="checkbox"/> Name: <u>Mark Goldberg</u> Company: <u>Same</u> Address: _____ E-mail: _____ Fax No.: _____		Client Project ID Rowe Industries Purchase Order no. _____ NABSAG Samples from: CT_NY_NJ_OTHER		Turn-Around Time RUSH Same Day RUSH Next Day RUSH Two Day RUSH Three Day RUSH Four Day Standard (5-7 days) <input checked="" type="checkbox"/> X OTHER _____		Report Type/Deliverables Summary <u>x, pdf</u> QA/QC Summary <u>x, pdf</u> CT RCP Pkg ASP A Pkg ASP B Pkg Excel EDD	
--	--	---	--	---	--	---	--	--	--	---	--

Print Clearly and Legibly. All information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.

Samples Collected/Authorized By (Signature): Stephan Hrust
Name (printed): _____

Matrix Codes	Volatiles	Semi-Volatiles	Metals	Misc. Org.	Full Lists	Miscellaneous Parameters	Special Instructions
S - soil	8260 full TICs	8270 & 625	RCRA8	TPH GRO	Pri. Poll.	Conductivity	Color
Other - specify (oil, etc.)	Site Spec.	STARS	8082 PCB	TPH DRO	TCL Ogans	Reactivity	Phenols
WW - wastewater	SPL or TCLP	8081 Pest	PP13	CT ETPH	TAL Mat'ns	Ignitability	Nitrite
GW - groundwater	Benzene	8151 Herb	TAL	NY 310-13	Full TCLP	Flash Point	TKN
DW - drinking water	MTBE	CT RCP	CT15	TPH 418.1	Full App. IX	Sieve Anal.	Tot. Nitrogen
Air-A - ambient air	TCL list	PAH	Total	Air TO14A	Part 360 Hexane	Heteroatoms	Ammonia-N
Air-SV - soil vapor	TAGM	Site Spec.	Dissolved	Air TO15	Part 360 Heptane	TOX	Chloride
	CT RCP	SPL or TCLP	SPL or TCLP	Air STARS	Part 360 Octane	BTU/lb.	Phosphate
	Arom.	TCLP Pest	Jahra-Meesh	Fig. Ph. As. Cu	Part 360 Lead	Aglycic Tox.	Tot. Phos.
	TCLP list	TCLP Herb	Chlordane	Air VPH	NYCDEP Sewer	TOC	Oil & Grease
	App. IX	Chlordane	Sec. Ti, Sb, Cu	Methane	NYSDDEC Sewer	Asbestos	FOG
	502.2	608 Pest	SS, Mn, Al, Fe, Hg	Helium	TAGM	Silicon	pH
	802 LB list	608 PCB					TDS
							TPH-IR

Sample Identification	Date Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below	Container Description(s)
<u>MW58-04</u>	<u>7/23/13 10:25</u>	GW	VOC 8260 full list (EPA SW846-8260B)	<u>3V</u>
		GW	VOC 8260 full list (EPA SW846-8260B)	
		GW	VOC 8260 full list (EPA SW846-8260B)	
		GW	VOC 8260 full list (EPA SW846-8260B)	
		GW	VOC 8260 full list (EPA SW846-8260B)	
		GW	VOC 8260 full list (EPA SW846-8260B)	
		GW	VOC 8260 full list (EPA SW846-8260B)	

Comments: _____

Preservation "X" those applicable _____

Cool 4°C _____ HNO3 _____ H2SO4 _____ NaOH _____ NONE _____ FROZEN _____

Samples Relinquished By: Deborah Vaca Date/Time: 7/25/13 12:22

Samples Relinquished By: Stephan Hrust Date/Time: 7/25/13 10:22

Samples Received By: LBG Field Date/Time: 7/24/13 14:00

Samples Received By: Stephan Hrust Date/Time: 7/25/13 14:00

Temperature on Receipt: 4.1 °C