

TABLE 2

**GROUNDWATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**Effluent Water Quality Results**

Date Sampled <sup>2/</sup>	pH <sup>1/</sup>	TDS <sup>4/</sup> (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	cis- 1,2-DCE (ug/l)	trans- 1,2-DCE (ug/l)	Xylene (ug/l)	Toluene (ug/l)	Ethyl- benzene (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Naphthalene (ug/l)	Chloroform (ug/l)
<b>SPDES Limits</b>	<b>6.5 to 8.5</b>	<b>---</b>	<b>5</b>	<b>5</b>	<b>5</b>	<b>5</b>	<b>5</b>	<b>5</b>	<b>5</b>	<b>5</b>	<b>5</b>	<b>5</b>	<b>5</b>	<b>---</b>	<b>10</b>	<b>7</b>
4-Feb-20	7.0	122	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Mar-20	7.0	137	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Apr-20	7.0	161	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
7-May-20	7.0	299	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Jun-20	6.8	174	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
7-Jul-20	7.0	125	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
7-Aug-20	6.8	178	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
1-Sep-20	6.8	145	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
1-Oct-20	6.8	148	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Nov-20	7.0	889	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
2-Dec-20	7.0	105	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
5-Jan-21	7.0	206	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5
3-Feb-21	6.8	139	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<0.5	ND<2	ND<0.5	ND<0.5	ND<0.5

SPDES: State Pollutant Discharge Elimination System

mg/l: Milligrams per liter

ug/l: Micrograms per liter

----: Not established

J: Analyte detected below quantitation limits, value shown is a laboratory estimate.

B: Analyte was found in the associated analysis batch blank. For volatiles, methylene chloride and acetone are common lab contaminants.

ND: Not detected      NA: Not Analyzed

C = CCV-E: The value reported is estimated. The value is estimated due to its behavior during continuing calibration verification.

Q = QL-02: This LCS analyte is outside Laboratory Recovery limits due to the analyte behavior using the referenced method. The reference method has certain limitations with respect to analytes of this nature.

NM: Not Measured

TDS: Total dissolved solids

PCE: Tetrachloroethylene

1,1,1-TCA: 1,1,1-Trichloroethane

TCE: Trichloroethene

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

cis-1,2-DCE: cis-1,2-Dichloroethene


trans-1,2,-DCE: trans-1,2-Dichloroethene

Notes:


- Based on the SPDES criteria from an NYSDEC letter dated on May 6, 2016, the allowable pH range for the Rowe Site is between 6.5 and 8.5. The effluent pH was 6.5 on February 17, 2021. Historic pH measurements from recovery wells indicate that natural background pH concentrations are less than 6.5.
- "Effluent" samples were collected from sample port labeled NP2-10 unless otherwise noted.
- Starting in October 2016, FSP&T system samples are collected monthly instead of once every two weeks. The pH of the effluent water is measured two times per month in accordance with the SPDES requirements.

**GRAPH 1  
GROUNDWATER REMEDIAL ACTION  
ROWE INDUSTRIES SUPERFUND SITE  
SAG HARBOR, NEW YORK**

**Effluent Flow Data  
(February 1, 2021 to February 28, 2021)**

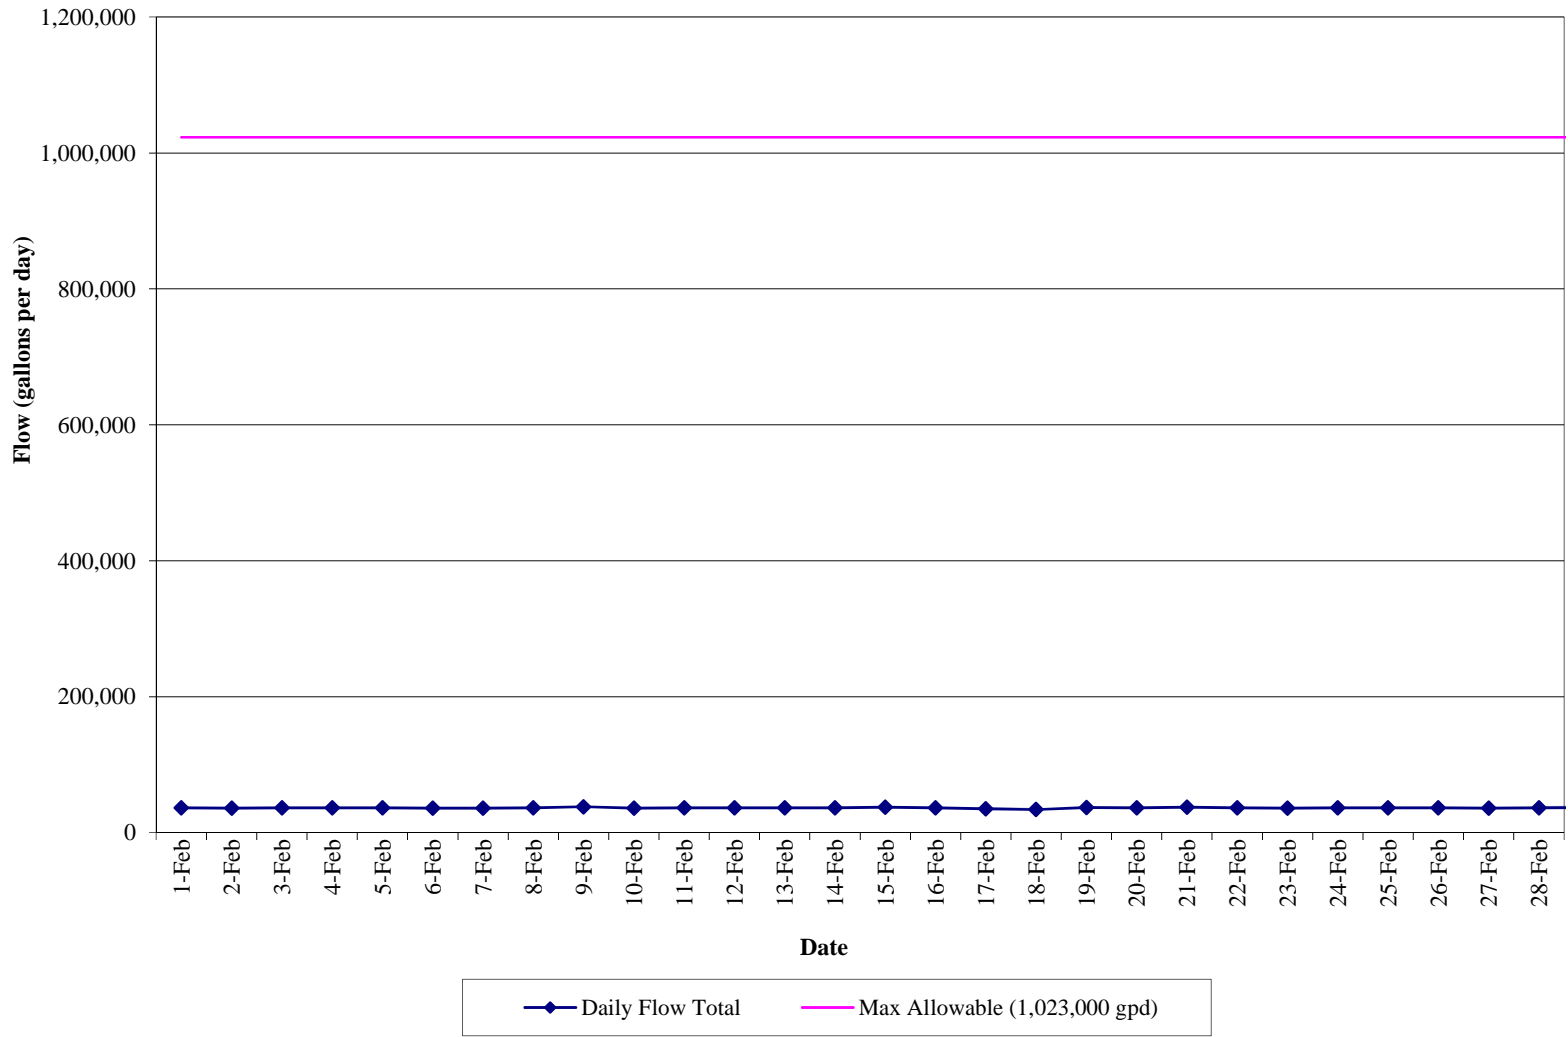

**APPENDIX I**  
**FEBRUARY 2021 LABORATORY ANALYTICAL REPORT**  
**FOR FSP&T SYSTEM AND RW-2**



# Technical Report

prepared for:

**WSP USA, Inc. (Shelton)**  
4 Research Drive, Suite 204  
Shelton CT, 06484  
**Attention: Tunde Komuves-Sandor**

Report Date: 02/09/2021  
**Client Project ID: 31401451.000 Task 01.00 Rowe Industries**  
York Project (SDG) No.: 21B0064

CT Cert. No. PH-0723

New Jersey Cert. No. CT005 and NY037



New York Cert. Nos. 10854 and 12058

PA Cert. No. 68-04440

120 RESEARCH DRIVE  
[www.YORKLAB.com](http://www.YORKLAB.com)

STRATFORD, CT 06615  
(203) 325-1371

132-02 89th AVENUE  
FAX (203) 357-0166

RICHMOND HILL, NY 11418  
[ClientServices@yorklab.com](mailto:ClientServices@yorklab.com)

Report Date: 02/09/2021  
Client Project ID: 31401451.000 Task 01.00 Rowe Industries  
York Project (SDG) No.: 21B0064

**WSP USA, Inc. (Shelton)**  
4 Research Drive, Suite 204  
Shelton CT, 06484  
Attention: Tunde Komuves-Sandor

---

## Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on February 03, 2021 and listed below. The project was identified as your project: **31401451.000 Task 01.00 Rowe Industries.**

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Sample and Analysis Qualifiers section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the Sample and Data Qualifiers Relating to This Work Order section of this report and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
21B0064-01	WQ020321:0920 NP1-1-2	Water	02/03/2021	02/03/2021
21B0064-02	WQ020321:0910 NP2-10	Water	02/03/2021	02/03/2021

## **General Notes for York Project (SDG) No.: 21B0064**

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All analyses conducted met method or Laboratory SOP requirements. See the Sample and Data Qualifiers Section for further information.
6. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
7. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.
8. Analyses conducted at York Analytical Laboratories, Inc. Stratford, CT are indicated by NY Cert. No. 10854; those conducted at York Analytical Laboratories, Inc., Richmond Hill, NY are indicated by NY Cert. No. 12058.

**Approved By:**



Benjamin Gulizia  
Laboratory Director

**Date:** 02/09/2021





### Sample Information

**Client Sample ID:** WQ020321:0920 NP1-1-2

**York Sample ID:** 21B0064-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21B0064

31401451.000 Task 01.00 Rowe Industries

Water

February 3, 2021 9:20 am

02/03/2021

**Volatile Organics, 8260 List - Low Level**

**Log-in Notes:**

**Sample Notes:**

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	02/05/2021 09:30	02/05/2021 16:03	NRT
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT



### Sample Information

**Client Sample ID:** WQ020321:0920 NP1-1-2

**York Sample ID:** 21B0064-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21B0064

31401451.000 Task 01.00 Rowe Industries

Water

February 3, 2021 9:20 am

02/03/2021

**Volatile Organics, 8260 List - Low Level**

**Log-in Notes:**

**Sample Notes:**

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
74-87-3	<b>Chloromethane</b>	<b>0.270</b>		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
156-59-2	<b>cis-1,2-Dichloroethylene</b>	<b>0.270</b>		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT





### Sample Information

**Client Sample ID:** WQ020321:0920 NP1-1-2

**York Sample ID:** 21B0064-01

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21B0064

31401451.000 Task 01.00 Rowe Industries

Water

February 3, 2021 9:20 am

02/03/2021

**Volatile Organics, 8260 List - Low Level**

**Log-in Notes:**

**Sample Notes:**

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
127-18-4	Tetrachloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
79-01-6	<b>Trichloroethylene</b>	<b>0.380</b>		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:03	NRT
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	02/05/2021 09:30	02/05/2021 16:03	NRT
<b>Surrogate Recoveries</b>		<b>Result</b>	<b>Acceptance Range</b>								
17060-07-0	Surrogate: SURRE: 1,2-Dichloroethane-d4	103 %	69-130								
2037-26-5	Surrogate: SURRE: Toluene-d8	100 %	81-117								
460-00-4	Surrogate: SURRE: p-Bromofluorobenzene	106 %	79-122								



### Sample Information

**Client Sample ID:** WQ020321:0910 NP2-10

**York Sample ID:** 21B0064-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21B0064

31401451.000 Task 01.00 Rowe Industries

Water

February 3, 2021 9:10 am

02/03/2021

**Volatile Organics, 8260 List - Low Level**

**Log-in Notes:**

**Sample Notes:**

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
630-20-6	1,1,1,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
71-55-6	1,1,1-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
79-34-5	1,1,2,2-Tetrachloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
76-13-1	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
79-00-5	1,1,2-Trichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
75-34-3	1,1-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
75-35-4	1,1-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
563-58-6	1,1-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP	02/05/2021 09:30	02/05/2021 16:30	NRT
87-61-6	1,2,3-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
96-18-4	1,2,3-Trichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
120-82-1	1,2,4-Trichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
95-63-6	1,2,4-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
96-12-8	1,2-Dibromo-3-chloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
106-93-4	1,2-Dibromoethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
95-50-1	1,2-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
107-06-2	1,2-Dichloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
78-87-5	1,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
108-67-8	1,3,5-Trimethylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
541-73-1	1,3-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
142-28-9	1,3-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
106-46-7	1,4-Dichlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
594-20-7	2,2-Dichloropropane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
95-49-8	2-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT



### Sample Information

**Client Sample ID:** WQ020321:0910 NP2-10

**York Sample ID:** 21B0064-02

York Project (SDG) No.

Client Project ID

Matrix

Collection Date/Time

Date Received

21B0064

31401451.000 Task 01.00 Rowe Industries

Water

February 3, 2021 9:10 am

02/03/2021

**Volatile Organics, 8260 List - Low Level**

**Log-in Notes:**

**Sample Notes:**

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
591-78-6	2-Hexanone	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
106-43-4	4-Chlorotoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
67-64-1	Acetone	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
71-43-2	Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
108-86-1	Bromobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
74-97-5	Bromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
75-27-4	Bromodichloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
75-25-2	Bromoform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
74-83-9	Bromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
56-23-5	Carbon tetrachloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
108-90-7	Chlorobenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
75-00-3	Chloroethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
67-66-3	Chloroform	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
74-87-3	<b>Chloromethane</b>	<b>0.340</b>		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
156-59-2	cis-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
10061-01-5	cis-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
124-48-1	Dibromochloromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
74-95-3	Dibromomethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
75-71-8	Dichlorodifluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
100-41-4	Ethyl Benzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
87-68-3	Hexachlorobutadiene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
98-82-8	Isopropylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
1634-04-4	Methyl tert-butyl ether (MTBE)	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT



### Sample Information

**Client Sample ID:** WQ020321:0910 NP2-10

**York Sample ID:** 21B0064-02

**York Project (SDG) No.**

**Client Project ID**

**Matrix**

**Collection Date/Time**

**Date Received**

21B0064

31401451.000 Task 01.00 Rowe Industries

Water

February 3, 2021 9:10 am

02/03/2021

**Volatile Organics, 8260 List - Low Level**

**Log-in Notes:**

**Sample Notes:**

Sample Prepared by Method: EPA 5030B

CAS No.	Parameter	Result	Flag	Units	Reported to LOD/MDL	LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
75-09-2	Methylene chloride	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
91-20-3	Naphthalene	ND		ug/L	1.00	2.00	1	EPA 8260C Certifications: NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
104-51-8	n-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
103-65-1	n-Propylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
95-47-6	o-Xylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
179601-23-1	p- & m- Xylenes	ND		ug/L	0.500	1.00	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
99-87-6	p-Isopropyltoluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
135-98-8	sec-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
100-42-5	Styrene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
98-06-6	tert-Butylbenzene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
127-18-4	Tetrachloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
108-88-3	Toluene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
156-60-5	trans-1,2-Dichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
10061-02-6	trans-1,3-Dichloropropylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
79-01-6	Trichloroethylene	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
75-69-4	Trichlorofluoromethane	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
75-01-4	Vinyl Chloride	ND		ug/L	0.200	0.500	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP,PADEP	02/05/2021 09:30	02/05/2021 16:30	NRT
1330-20-7	Xylenes, Total	ND		ug/L	0.600	1.50	1	EPA 8260C Certifications: CTDOH,NELAC-NY10854,NELAC-NY12058,NJDEP	02/05/2021 09:30	02/05/2021 16:30	NRT

	Surrogate Recoveries	Result	Acceptance Range
17060-07-0	Surrogate: SURRE: 1,2-Dichloroethane-d4	103 %	69-130
2037-26-5	Surrogate: SURRE: Toluene-d8	101 %	81-117
460-00-4	Surrogate: SURRE: p-Bromofluorobenzene	107 %	79-122

**Total Dissolved Solids**

**Log-in Notes:**

**Sample Notes:**



Sample Information

Client Sample ID: WQ020321:0910 NP2-10

York Sample ID: 21B0064-02

York Project (SDG) No. 21B0064

Client Project ID 31401451.000 Task 01.00 Rowe Industries

Matrix Water

Collection Date/Time February 3, 2021 9:10 am

Date Received 02/03/2021

Sample Prepared by Method: % Solids Prep

CAS No.	Parameter	Result	Flag	Units	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst	
	Total Dissolved Solids	139		mg/L	10.0	1	SM 2540C	02/03/2021 23:58	02/04/2021 21:06	AA	
							Certifications:	NELAC-NY10854,CTDOH,NJDEP,PADEP			



## Analytical Batch Summary

**Batch ID:** BB10141                      **Preparation Method:** % Solids Prep                      **Prepared By:** AA

YORK Sample ID	Client Sample ID	Preparation Date
21B0064-02	WQ020321:0910 NP2-10	02/03/21
BB10141-BLK1	Blank	02/03/21

**Batch ID:** BB10211                      **Preparation Method:** EPA 5030B                      **Prepared By:** NT

YORK Sample ID	Client Sample ID	Preparation Date
21B0064-01	WQ020321:0920 NP1-1-2	02/05/21
21B0064-02	WQ020321:0910 NP2-10	02/05/21
BB10211-BLK1	Blank	02/05/21
BB10211-BS1	LCS	02/05/21
BB10211-BSD1	LCS Dup	02/05/21



**Volatile Organic Compounds by GC/MS - Quality Control Data**  
**York Analytical Laboratories, Inc.**

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

**Batch BB10211 - EPA 5030B**

**Blank (BB10211-BLK1)**

Prepared & Analyzed: 02/05/2021

1,1,1,2-Tetrachloroethane	ND	0.500	ug/L								
1,1,1-Trichloroethane	ND	0.500	"								
1,1,2,2-Tetrachloroethane	ND	0.500	"								
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	ND	0.500	"								
1,1,2-Trichloroethane	ND	0.500	"								
1,1-Dichloroethane	ND	0.500	"								
1,1-Dichloroethylene	ND	0.500	"								
1,1-Dichloropropylene	ND	0.500	"								
1,2,3-Trichlorobenzene	ND	0.500	"								
1,2,3-Trichloropropane	ND	0.500	"								
1,2,4-Trichlorobenzene	ND	0.500	"								
1,2,4-Trimethylbenzene	ND	0.500	"								
1,2-Dibromo-3-chloropropane	ND	0.500	"								
1,2-Dibromoethane	ND	0.500	"								
1,2-Dichlorobenzene	ND	0.500	"								
1,2-Dichloroethane	ND	0.500	"								
1,2-Dichloropropane	ND	0.500	"								
1,3,5-Trimethylbenzene	ND	0.500	"								
1,3-Dichlorobenzene	ND	0.500	"								
1,3-Dichloropropane	ND	0.500	"								
1,4-Dichlorobenzene	ND	0.500	"								
2,2-Dichloropropane	ND	0.500	"								
2-Chlorotoluene	ND	0.500	"								
2-Hexanone	ND	0.500	"								
4-Chlorotoluene	ND	0.500	"								
Acetone	ND	2.00	"								
Benzene	ND	0.500	"								
Bromobenzene	ND	0.500	"								
Bromochloromethane	ND	0.500	"								
Bromodichloromethane	ND	0.500	"								
Bromoform	ND	0.500	"								
Bromomethane	ND	0.500	"								
Carbon tetrachloride	ND	0.500	"								
Chlorobenzene	ND	0.500	"								
Chloroethane	ND	0.500	"								
Chloroform	ND	0.500	"								
Chloromethane	ND	0.500	"								
cis-1,2-Dichloroethylene	ND	0.500	"								
cis-1,3-Dichloropropylene	ND	0.500	"								
Dibromochloromethane	ND	0.500	"								
Dibromomethane	ND	0.500	"								
Dichlorodifluoromethane	ND	0.500	"								
Ethyl Benzene	ND	0.500	"								
Hexachlorobutadiene	ND	0.500	"								
Isopropylbenzene	ND	0.500	"								
Methyl tert-butyl ether (MTBE)	ND	0.500	"								
Methylene chloride	ND	2.00	"								
Naphthalene	ND	2.00	"								
n-Butylbenzene	ND	0.500	"								



**Volatile Organic Compounds by GC/MS - Quality Control Data**  
**York Analytical Laboratories, Inc.**

Analyte	Result	Reporting	Units	Spike	Source*	%REC	%REC	Limits	Flag	RPD	Flag
		Limit			Result					RPD	

**Batch BB10211 - EPA 5030B**

**Blank (BB10211-BLK1)**

Prepared & Analyzed: 02/05/2021

n-Propylbenzene	ND	0.500	ug/L								
o-Xylene	ND	0.500	"								
p- & m- Xylenes	ND	1.00	"								
p-Isopropyltoluene	ND	0.500	"								
sec-Butylbenzene	ND	0.500	"								
Styrene	ND	0.500	"								
tert-Butylbenzene	ND	0.500	"								
Tetrachloroethylene	ND	0.500	"								
Toluene	ND	0.500	"								
trans-1,2-Dichloroethylene	ND	0.500	"								
trans-1,3-Dichloropropylene	ND	0.500	"								
Trichloroethylene	ND	0.500	"								
Trichlorofluoromethane	ND	0.500	"								
Vinyl Chloride	ND	0.500	"								
Xylenes, Total	ND	1.50	"								
<hr/>											
Surrogate: SURR: 1,2-Dichloroethane-d4	9.97		"	10.0		99.7	69-130				
Surrogate: SURR: Toluene-d8	10.1		"	10.0		101	81-117				
Surrogate: SURR: p-Bromofluorobenzene	10.8		"	10.0		108	79-122				

**LCS (BB10211-BS1)**

Prepared & Analyzed: 02/05/2021

1,1,1,2-Tetrachloroethane	10.0		ug/L	10.0		100	82-126				
1,1,1-Trichloroethane	11.3		"	10.0		113	78-136				
1,1,2,2-Tetrachloroethane	9.77		"	10.0		97.7	76-129				
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	13.0		"	10.0		130	54-165				
1,1,2-Trichloroethane	8.99		"	10.0		89.9	82-123				
1,1-Dichloroethane	10.7		"	10.0		107	82-129				
1,1-Dichloroethylene	12.2		"	10.0		122	68-138				
1,1-Dichloropropylene	11.2		"	10.0		112	83-133				
1,2,3-Trichlorobenzene	8.93		"	10.0		89.3	76-136				
1,2,3-Trichloropropane	9.40		"	10.0		94.0	77-128				
1,2,4-Trichlorobenzene	9.36		"	10.0		93.6	76-137				
1,2,4-Trimethylbenzene	10.1		"	10.0		101	82-132				
1,2-Dibromo-3-chloropropane	7.99		"	10.0		79.9	45-147				
1,2-Dibromoethane	9.15		"	10.0		91.5	83-124				
1,2-Dichlorobenzene	9.56		"	10.0		95.6	79-123				
1,2-Dichloroethane	10.0		"	10.0		100	73-132				
1,2-Dichloropropane	10.0		"	10.0		100	78-126				
1,3,5-Trimethylbenzene	10.4		"	10.0		104	80-131				
1,3-Dichlorobenzene	9.82		"	10.0		98.2	86-122				
1,3-Dichloropropane	9.24		"	10.0		92.4	81-125				
1,4-Dichlorobenzene	9.80		"	10.0		98.0	85-124				
2,2-Dichloropropane	11.9		"	10.0		119	56-150				
2-Chlorotoluene	10.6		"	10.0		106	79-130				
2-Hexanone	6.92		"	10.0		69.2	51-146				
4-Chlorotoluene	10.5		"	10.0		105	79-128				
Acetone	5.07		"	10.0		50.7	14-150				
Benzene	10.9		"	10.0		109	85-126				
Bromobenzene	10.3		"	10.0		103	78-129				
Bromochloromethane	10.2		"	10.0		102	77-128				
Bromodichloromethane	9.99		"	10.0		99.9	79-128				





Volatile Organic Compounds by GC/MS - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

Batch BB10211 - EPA 5030B

LCS (BB10211-BS1)

Prepared & Analyzed: 02/05/2021

Bromoform	8.68		ug/L	10.0		86.8	78-133				
Bromomethane	9.97		"	10.0		99.7	43-168				
Carbon tetrachloride	11.1		"	10.0		111	77-141				
Chlorobenzene	10.2		"	10.0		102	88-120				
Chloroethane	10.8		"	10.0		108	65-136				
Chloroform	10.6		"	10.0		106	82-128				
Chloromethane	10.3		"	10.0		103	43-155				
cis-1,2-Dichloroethylene	10.8		"	10.0		108	83-129				
cis-1,3-Dichloropropylene	10.1		"	10.0		101	80-131				
Dibromochloromethane	9.47		"	10.0		94.7	80-130				
Dibromomethane	9.60		"	10.0		96.0	72-134				
Dichlorodifluoromethane	11.7		"	10.0		117	44-144				
Ethyl Benzene	10.6		"	10.0		106	80-131				
Hexachlorobutadiene	11.0		"	10.0		110	67-146				
Isopropylbenzene	10.8		"	10.0		108	76-140				
Methyl tert-butyl ether (MTBE)	9.11		"	10.0		91.1	76-135				
Methylene chloride	9.70		"	10.0		97.0	55-137				
Naphthalene	8.99		"	10.0		89.9	70-147				
n-Butylbenzene	10.0		"	10.0		100	79-132				
n-Propylbenzene	10.9		"	10.0		109	78-133				
o-Xylene	10.2		"	10.0		102	78-130				
p- & m- Xylenes	21.5		"	20.0		108	77-133				
p-Isopropyltoluene	9.68		"	10.0		96.8	81-136				
sec-Butylbenzene	10.6		"	10.0		106	79-137				
Styrene	10.3		"	10.0		103	67-132				
tert-Butylbenzene	9.23		"	10.0		92.3	77-138				
Tetrachloroethylene	8.68		"	10.0		86.8	82-131				
Toluene	10.6		"	10.0		106	80-127				
trans-1,2-Dichloroethylene	11.8		"	10.0		118	80-132				
trans-1,3-Dichloropropylene	9.53		"	10.0		95.3	78-131				
Trichloroethylene	10.8		"	10.0		108	82-128				
Trichlorofluoromethane	11.4		"	10.0		114	67-139				
Vinyl Chloride	11.0		"	10.0		110	58-145				
Surrogate: SURRE: 1,2-Dichloroethane-d4	9.69		"	10.0		96.9	69-130				
Surrogate: SURRE: Toluene-d8	10.2		"	10.0		102	81-117				
Surrogate: SURRE: p-Bromofluorobenzene	10.5		"	10.0		105	79-122				



**Volatile Organic Compounds by GC/MS - Quality Control Data**

**York Analytical Laboratories, Inc.**

Analyte	Result	Reporting	Spike	Source*	%REC	%REC	Limits	Flag	RPD	
		Limit							Units	Level
<b>Batch BB10211 - EPA 5030B</b>										
<b>LCS Dup (BB10211-BSD1)</b>										
Prepared & Analyzed: 02/05/2021										
1,1,1,2-Tetrachloroethane	10.1		ug/L	10.0	101	82-126			0.697	30
1,1,1-Trichloroethane	11.0		"	10.0	110	78-136			3.05	30
1,1,2,2-Tetrachloroethane	10.1		"	10.0	101	76-129			3.22	30
1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)	12.7		"	10.0	127	54-165			2.41	30
1,1,2-Trichloroethane	9.80		"	10.0	98.0	82-123			8.62	30
1,1-Dichloroethane	10.5		"	10.0	105	82-129			2.07	30
1,1-Dichloroethylene	12.0		"	10.0	120	68-138			1.66	30
1,1-Dichloropropylene	11.0		"	10.0	110	83-133			2.43	30
1,2,3-Trichlorobenzene	9.37		"	10.0	93.7	76-136			4.81	30
1,2,3-Trichloropropane	9.84		"	10.0	98.4	77-128			4.57	30
1,2,4-Trichlorobenzene	9.72		"	10.0	97.2	76-137			3.77	30
1,2,4-Trimethylbenzene	10.2		"	10.0	102	82-132			0.591	30
1,2-Dibromo-3-chloropropane	8.65		"	10.0	86.5	45-147			7.93	30
1,2-Dibromoethane	9.85		"	10.0	98.5	83-124			7.37	30
1,2-Dichlorobenzene	9.79		"	10.0	97.9	79-123			2.38	30
1,2-Dichloroethane	10.4		"	10.0	104	73-132			3.34	30
1,2-Dichloropropane	10.0		"	10.0	100	78-126			0.200	30
1,3,5-Trimethylbenzene	10.4		"	10.0	104	80-131			0.578	30
1,3-Dichlorobenzene	9.88		"	10.0	98.8	86-122			0.609	30
1,3-Dichloropropane	9.75		"	10.0	97.5	81-125			5.37	30
1,4-Dichlorobenzene	10.0		"	10.0	100	85-124			2.12	30
2,2-Dichloropropane	11.5		"	10.0	115	56-150			3.42	30
2-Chlorotoluene	10.5		"	10.0	105	79-130			1.33	30
2-Hexanone	7.60		"	10.0	76.0	51-146			9.37	30
4-Chlorotoluene	10.3		"	10.0	103	79-128			1.15	30
Acetone	5.57		"	10.0	55.7	14-150			9.40	30
Benzene	10.8		"	10.0	108	85-126			1.20	30
Bromobenzene	10.3		"	10.0	103	78-129			0.0974	30
Bromochloromethane	10.6		"	10.0	106	77-128			3.27	30
Bromodichloromethane	10.1		"	10.0	101	79-128			1.29	30
Bromoform	9.19		"	10.0	91.9	78-133			5.71	30
Bromomethane	9.18		"	10.0	91.8	43-168			8.25	30
Carbon tetrachloride	10.9		"	10.0	109	77-141			1.72	30
Chlorobenzene	10.2		"	10.0	102	88-120			0.195	30
Chloroethane	10.6		"	10.0	106	65-136			1.77	30
Chloroform	10.6		"	10.0	106	82-128			0.378	30
Chloromethane	10.0		"	10.0	100	43-155			2.56	30
cis-1,2-Dichloroethylene	10.7		"	10.0	107	83-129			1.58	30
cis-1,3-Dichloropropylene	10.3		"	10.0	103	80-131			1.96	30
Dibromochloromethane	10.0		"	10.0	100	80-130			5.84	30
Dibromomethane	9.92		"	10.0	99.2	72-134			3.28	30
Dichlorodifluoromethane	11.4		"	10.0	114	44-144			2.25	30
Ethyl Benzene	10.6		"	10.0	106	80-131			0.188	30
Hexachlorobutadiene	10.4		"	10.0	104	67-146			5.99	30
Isopropylbenzene	10.5		"	10.0	105	76-140			2.54	30
Methyl tert-butyl ether (MTBE)	9.66		"	10.0	96.6	76-135			5.86	30
Methylene chloride	9.85		"	10.0	98.5	55-137			1.53	30
Naphthalene	9.67		"	10.0	96.7	70-147			7.29	30
n-Butylbenzene	10.1		"	10.0	101	79-132			0.398	30
n-Propylbenzene	10.6		"	10.0	106	78-133			2.60	30



**Volatile Organic Compounds by GC/MS - Quality Control Data**  
**York Analytical Laboratories, Inc.**

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

**Batch BB10211 - EPA 5030B**

**LCS Dup (BB10211-BSD1)**

Prepared & Analyzed: 02/05/2021

o-Xylene	10.3		ug/L	10.0		103	78-130		0.390	30	
p- & m- Xylenes	21.5		"	20.0		107	77-133		0.372	30	
p-Isopropyltoluene	9.88		"	10.0		98.8	81-136		2.04	30	
sec-Butylbenzene	10.7		"	10.0		107	79-137		0.470	30	
Styrene	10.4		"	10.0		104	67-132		1.26	30	
tert-Butylbenzene	9.24		"	10.0		92.4	77-138		0.108	30	
Tetrachloroethylene	8.61		"	10.0		86.1	82-131		0.810	30	
Toluene	10.6		"	10.0		106	80-127		0.471	30	
trans-1,2-Dichloroethylene	11.7		"	10.0		117	80-132		1.02	30	
trans-1,3-Dichloropropylene	9.97		"	10.0		99.7	78-131		4.51	30	
Trichloroethylene	10.7		"	10.0		107	82-128		1.03	30	
Trichlorofluoromethane	11.0		"	10.0		110	67-139		2.85	30	
Vinyl Chloride	10.7		"	10.0		107	58-145		2.76	30	
<i>Surrogate: SURR: 1,2-Dichloroethane-d4</i>	<i>9.90</i>		<i>"</i>	<i>10.0</i>		<i>99.0</i>	<i>69-130</i>				
<i>Surrogate: SURR: Toluene-d8</i>	<i>10.0</i>		<i>"</i>	<i>10.0</i>		<i>100</i>	<i>81-117</i>				
<i>Surrogate: SURR: p-Bromofluorobenzene</i>	<i>10.4</i>		<i>"</i>	<i>10.0</i>		<i>104</i>	<i>79-122</i>				



Miscellaneous Physical Parameters - Quality Control Data

York Analytical Laboratories, Inc.

Analyte	Result	Reporting Limit	Units	Spike Level	Source* Result	%REC	%REC Limits	Flag	RPD	RPD Limit	Flag
---------	--------	-----------------	-------	-------------	----------------	------	-------------	------	-----	-----------	------

**Batch BB10141 - % Solids Prep**

**Blank (BB10141-BLK1)**


Prepared: 02/03/2021 Analyzed: 02/04/2021

Total Dissolved Solids	ND	10.0	mg/L								
------------------------	----	------	------	--	--	--	--	--	--	--	--



### Volatile Analysis Sample Containers

Lab ID	Client Sample ID	Volatile Sample Container
21B0064-01	WQ020321:0920 NP1-1-2	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C
21B0064-02	WQ020321:0910 NP2-10	40mL Clear Vial (pre-pres.) HCl; Cool to 4° C



## Sample and Data Qualifiers Relating to This Work Order

ICV-E The value reported is ESTIMATED. The value is estimated due to its behavior during initial calibration verification (recovery exceeded 30% of expected value).

### Definitions and Other Explanations

*	Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
ND	NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
RL	REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
LOQ	LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
LOD	LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW-846.
MDL	METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
Reported to	This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
NR	Not reported
RPD	Relative Percent Difference
Wet	The data has been reported on an as-received (wet weight) basis
Low Bias	Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
High Bias	High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
Non-Dir.	Non-dir. flag (Non-Directional Bias ) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.

For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.



York Analytical Laboratories, Inc.  
 120 Research Drive 132-02 89th Ave  
 Stratford, CT 06615 Queens, NY 11418  
 clientservices@yorklab.com  
 www.yorklab.com

# Field Chain-of-Custody Record

YORK Project No.  
21B0064  
 Page 1 of 1

NOTE: YORK's Standard Terms & Conditions are listed on the back side of this document.  
 This document serves as your written authorization for YORK to proceed with the analyses requested below.  
 Your signature binds you to YORK's Standard Terms & Conditions.

YOUR Information		Report To:		Invoice To:		YOUR Project Number		Turn-Around Time	
Company:	WSP USA	Company:	Same	Company:	WSP USA Accounting	31401451.000 Task 01.00		RUSH - Next Day	
Address:	4 Research Drive, Suite 204 Shelton, CT 06484	Address:		Address:		YOUR Project Name Rowe Industries		RUSH - Two Day	
Phone.:	203-929-8555	Phone.:		Phone.:				RUSH - Three Day	
Contact:	Tunde Komuves-Sandor	Contact:		Contact:				RUSH - Four Day	
E-mail:	tunde.sandor@wsp.com	E-mail:	↓	E-mail:		YOUR PO#: 31401451.000 Task 01.00		Standard (5-7 Day)	X

*Please print clearly and legibly. All information must be complete. Samples will not be logged in and the turn-around-time clock will not begin until any questions by YORK are resolved.*

Samples Collected by: (print your name above and sign below)	Matrix Codes	Samples From	Report / EDD Type (circle selections)			YORK Reg. Comp. Compared to the following Regulation(s): (please fill in)	
	S - soil / solid	New York	<input checked="" type="checkbox"/>	Summary Report	CT RCP		Standard Excel EDD
	GW - groundwater	New Jersey		QA Report	CT RCP DQA/DUE		EQUIS (Standard)
	DW - drinking water	Connecticut		NY ASP A Package	NJDEP Reduced Deliverables		NYSDEC EQUIS
	WW - wastewater	Pennsylvania		NY ASP B Package	NJDEP SRP HazSite		
	O - Oil ; Other	Other			NJDKQP	Other:	

Sample Identification	Sample Matrix	Date/Time Sampled	Analysis Requested	Container Description
WQ020321:0920 NP1-1-2	GW	2-3-21 9:20	VOCs 8260 full list + freon 113	3 HCl VOA
WQ020321:0910 NP2-10	GW	2-3-21 9:10	VOCs 8260 full list + freon 113: TDS	3 HCl VOA; 1 plastic

Comments:	Preservation: (check all that apply)	Special Instruction
	HCl <input checked="" type="checkbox"/> MeOH ___ HNO <sub>3</sub> ___ H <sub>2</sub> SO <sub>4</sub> ___ NaOH ___ ZnAc ___ Ascorbic Acid ___ Other: <u>COOL</u>	Field Filtered ___ Lab to Filter ___

Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time
<i>[Signature]</i>	2-3-21 1506				
Samples Received by / Company	Date/Time	Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time
Samples Relinquished by / Company	Date/Time	Samples Received by / Company	Date/Time	Samples Received in LAB by	Date/Time
				<i>[Signature]</i>	2/3/2021 1506
					Temp. Received at Lab 3.3 Degrees C